

# MEHRAN UNIVERSITY OF ENGINEERING & TECHNOLOGY, JAMSHORO

## TENDER DOCUMENTS

FOR

Internal & External Electrification, Air-Conditioning, Computer Data,  
& Voice System Works of Girls' Hostel No. 3 at Mehran University  
of Engineering & Technology, Jamshoro

**March-2014**



CONSULTANTS  
**NAQVI AND SIDDIQUIE**  
INC. ARCHITECT & ENGINEER  
BLOCK NO. 10 FIRST FLOOR  
MARKAZ F-6  
ISLAMABAD TEL: 2876769-2273268



### **KAD Consultants**

F-1, Zaib Residency, 70/72/1, Hussain  
Housing Scheme, Near Summit Bank Wadhu  
Wah, Qasimabad Hyderabad  
Ph: +92-22-2652274  
Fax: +92-22-2652275  
E-mail: [kadconsultants@hotmail.com](mailto:kadconsultants@hotmail.com)

## Summary of Contents

S. No.	Subject	Page No.
1	Invitation for Bids.....	02
2	Instructions to Bidders & Bidding Data.....	04
3	Form of Bid & Schedules of Bid.....	20
4	Conditions of Contract .....	33
5	Contract Data .....	49
6	Standard Forms.....	54
7	Specifications For Electrical Works .....	67
8	Special Notes .....	102
9	List of Approved Electrical Manufacturers .....	104
10	Bill of Quantity .....	107
11	Tender Drawings.....	130

## **INVITATION FOR BIDS**



# MEHRAN UNIVERSITY OF ENGINEERING AND TECHNOLOGY

JAMSHORO - 76062, SINDH, PAKISTAN

Telephone: +92-22-2771311 Fax: + 92-22-2771403

Email: saghir.memon@admin.mueta.edu.pk, saghir79@hotmail.com

ISO-9001:2008  
Certified

**DIRECTOR**  
Works & Services

No.& Dated: Dir(W&S)/MUET/JAM/-55, 11-03-2014

## NOTICE INVITING TENDERS.

All the Pre-qualified Contractors / firms / parties meeting eligibility criteria, viz. having registration with Sindh Revenue Board (SRB) and are tax payers of Government, registered with sales tax office as the case may be and are not black listed in any procuring agency or authority, are invited to participate in sealed percentage / item rate tender for the following works:

S. #	Name of Work	Estimated Cost	Tender Fee	Completion Time	Earnest Money	Date of Purchase	Date of Submission of Bids	Purchase From
1	An 500KVA Kiosk Sub-Station No.15 for the buildings of Student Service Centre & Sports Complex (Gymnasium Hall). Provision of Street Lighting for the Building of Student Service Centre & Sports Complex (Gymnasium Hall) and Shifting of Sub-Station No.06 to New Girls Hostel at MUET, Jamshoro.	17.053 (M)	3,000.00	06 Months	2%	19-03-2014 To 07-04-2014	08-04-2014	Executive Engineer (Works)
2	An Extension of Approach Road From Student Service Centre towards the Sports Complex (Gymnasium Hall) at MUET, Jamshoro.	9.594 (M)	3,000.00	06 Months	2%	19-03-2014 To 07-04-2014	08-04-2014	Executive Engineer (Works)
3	Internal / External Electrification, Computer Networking & Air-Conditioning Works of Girls Hostel for 150 Students at MUET, Jamshoro.	11.064 (M)	3,000.00	12 Months	2%	19-03-2014 To 07-04-2014	08-04-2014	Executive Engineer (Works)
4	Establishment of Innovation & Entrepreneurship Centre (IIE) - An Extension of Mehran University Institute of Science, Technology and Development (MUISTD), Jamshoro.	29.805 (M)	3,000.00	24 Months	2%	19-03-2014 To 07-04-2014	08-04-2014	Executive Engineer (Works)

The terms and conditions are given as under:-

The tender documents can be had from the Office of Executive Engineer (Works) on the payment noted above (non-refundable) on any working day except the day of opening of tenders. The sealed tender on prescribed proforma alongwith 2% earnest money of total bid in the form of Pay Order in favour of Executive Engineer (Works) should be deposited in the Office of Executive Engineer (Works) by 08-04-2014 upto 12.00 (Noon) and same will be opened on the same day @ 12.30 P.M in respective office, in presence of the Contractors / representative, who so ever will be present at that time. In case of any unforeseen situation resulting in closure of office on the date of opening or if Government declares Holiday the tender shall be submitted / opened on the next working day at the same time & venue. Any Conditional or un-accompanied of the earnest money, tender will not be considered in the competition.

*The Competent Authority reserves the right to reject any or all bids subject to relevant provisions of SPP Rules, 2010 and may cancel the bidding process at any time prior to the acceptance of a bid or proposal under Rule-25" of said Rules.*

Director (Works & Service)  
MUET, Jamshoro



## INSTRUCTIONS TO BIDDERS & BIDDING DATA

### Notes on the Instructions to Bidders

This section of the bidding documents should provide the information necessary for bidders to prepare responsive bids, in accordance with the requirements of the Procuring Agency. It should also give information on bid submission, opening and evaluation, and on the award of contract.

Matters governing the performance of the Contract or payments under the Contract, or matters affecting the risks, rights, and obligations of the parties under the Contract are not normally included in this Section, but rather in the appropriate sections of the *Conditions of Contract* and/or *Contract Data*.

## TABLE OF CONTENTS

### INSTRUCTIONS TO BIDDERS

<i>Clause No.</i>	<i>Description</i>	<i>Page No.</i>
<b>A. GENERAL</b>		
IB.1	Scope of Bid & Source of Funds.....	6
IB.2	Eligible Bidders.....	6
IB.3	Cost of Bidding.....	7
<b>B. BIDDING DOCUMENTS</b>		
IB.4	Contents of Bidding Documents.....	7
IB.5	Clarification of Bidding Documents.....	7
IB.6	Amendment of Bidding Documents.....	8
<b>C- PREPARATION OF BID</b>		
IB.7	Language of Bid.....	8
IB.8	Documents Comprising the Bid.....	8
IB.9	Sufficiency of Bid.....	8
IB.10	Bid Prices, Currency of Bid & Payment.....	9
IB.11	Documents Establishing Bidder's Eligibility and Qualifications...	9
IB.12	Documents Establishing Works Conformity to Bidding Documents.....	9
IB.13	Bidding Security.....	10
IB.14	Validity of Bids, Format, Signing and Submission of Bid.....	10
<b>D-SUBMISSION OF BID</b>		
IB.15	Deadline for Submission, Modification & Withdrawal of Bids....	11
<b>E. BID OPENING AND EVALUATION</b>		
IB.16	Bid Opening, Clarification and Evaluation.....	12
IB.17	Process to be Confidential.....	13
<b>F. AWARD OF CONTRACT</b>		
IB.18	Qualification.....	13
IB.19	Award Criteria & Procuring Agency's Right.....	14
IB.20	Notification of Award & Signing of Contract Agreement.....	14
IB.21	Performance Security.....	14
IB.22	Integrity Pact.....	15

## INSTRUCTIONS TO BIDDERS

(Note: *These Instructions to Bidders (IB) along with Bidding Data will not be part of Contract and will cease to have effect once the Contract is signed.*)

### A. GENERAL

#### IB.1 Scope of Bid & Source of Funds

##### 1.1 Scope of Bid

The Procuring Agency as defined in the Bidding Data (hereinafter called "the Procuring Agency") wishes to receive Bids for the Works summarized in the Bidding Data (hereinafter referred to as "the Works").

Bidders must quote for the complete scope of work. Any Bid covering partial scope of work will be rejected as non-responsive.

##### 1.2 Source of Funds

The Procuring Agency has arranged funds from its own sources or *Federal/ Provincial /Donor agency or any other source*, which may be indicated accordingly in bidding data towards the cost of the project/scheme.

#### IB.2 Eligible Bidders

##### 2.1 Bidding is open to all firms and persons meeting the following requirements:

- a) duly licensed by the Pakistan Engineering Council (PEC) in the appropriate category for value of works.

Provided that the works costing Rs. 2.5 million or less shall not require any registration with PEC .

- b) duly pre-qualified with the Procuring Agency. (*Where required*).

In the event that prequalification of potential bidders has been undertaken, only bids from prequalified bidders will be considered for award of Contract.

- c) if prequalification has not undertaken , the procuring agency may ask information and documents not limited to following:-
  - (i) company profile;
  - (ii) works of similar nature and size for each performed in last 3/5 years;
  - (iii) construction equipments;
  - (iv) qualification and experience of technical personnel and key site management;



- (v) financial statement of last 3 years;
- (vi) information regarding litigations and abandoned works if any.

### **IB.3 Cost of Bidding**

- 3.1 The bidder shall bear all costs associated with the preparation and submission of its bid and the Procuring Agency will in no case be responsible or liable for those costs, regardless of the conduct or outcome of the bidding process (SPP Rules 24 & 25).

## **B. BIDDING DOCUMENTS**

### **IB.4 Contents of Bidding Documents**

- 4.1 In addition to Invitation for Bids, the Bidding Documents are those stated below, and should be read in conjunction with any Addendum issued in accordance with Sub-Clause IB.6.1.

1. Instructions to Bidders & Bidding Data
2. Form of Bid, Qualification Information & Schedules to Bid  
Schedules to Bid comprise the following:
  - (i) Schedule A: Schedule of Prices/ Bill of Quantities (BoQ).
  - (ii) Schedule B: Specific Works Data
  - (iii) Schedule C: Works to be Performed by Subcontractors
  - (iv) Schedule D: Proposed Programme of Works
  - (v) Schedule E: Method of Performing Works
  - (vi) Schedule F: Integrity Pact (works costing Rs 10 million and above)
3. Conditions of Contract & Contract Data
4. Standard Forms:
  - (i) Form of Bid Security,
  - (ii) Form of Performance Security;
  - (iii) Form of Contract Agreement;
  - (iv) Form of Bank Guarantee for Advance Payment.
5. Specifications
6. Drawings, if any

### **IB.5 Clarification of Bidding Documents**

- 5.1 A prospective bidder requiring any clarification(s) in respect of the Bidding Documents may notify the Engineer/Procuring Agency at the Engineer's/ Procuring Agency's address indicated in the Bidding Data.
- 5.2 An interested bidder, who has obtained bidding documents, may request for clarification



of contents of bidding documents in writing and procuring agency shall respond to such queries in writing within three calendar days, provided they are received at least five calendar days prior to the date of opening of bid (SPP Rule 23-1).

#### **IB.6 Amendment of Bidding Documents (SPP Rules 22(2) & 22).**

- 6.1 At any time prior to the deadline for submission of Bids, the Procuring Agency may, for any reason, whether at his own initiative or in response to a clarification requested by a interested bidder, modify the Bidding Documents by issuing addendum.
- 6.2 Any addendum thus issued shall be part of the Bidding Documents pursuant to Sub-Clause 6.1 hereof, and shall be communicated in writing to all purchasers of the Bidding Documents. Prospective bidders shall acknowledge receipt of each addendum in writing to the Procuring Agency.
- 6.3 To afford interested bidders reasonable time in which to take an addendum into account in preparing their Bids, the Procuring Agency may at its discretion extend the deadline for submission of Bids.

### **C. PREPARATION OF BIDS**

#### **IB.7 Language of Bid**

- 7.1 All documents relating to the Bid shall be in the language specified in the Contract Data.

#### **IB.8 Documents Comprising the Bid**

- 8.1 The Bid submitted by the bidder shall comprise the following:
  - (a) Offer /Covering Letter
  - (b) Form of Bid duly filled, signed and sealed, in accordance with IB.14.3.
  - (c) Schedules (A to F) to Bid duly filled and initialed, in accordance with the instructions contained therein & in accordance with IB.14.3.
  - (d) Bid Security furnished in accordance with IB.13.
  - (e) Power of Attorney in accordance with IB 14.5.
  - (f) Documentary evidence in accordance with IB.2(c) & IB.11
  - (g) Documentary evidence in accordance with IB.12.

#### **IB.9 Sufficiency of Bid**

- 9.1 Each bidder shall satisfy himself before Bidding as to the correctness and sufficiency of his Bid and of the premium on the rates of CSR / rates and prices quoted/entered in the Schedule of Prices, which rates and prices shall except in so far as it is otherwise expressly provided in the Contract, cover all his obligations under the Contract and all matters and things necessary for the proper completion of the works.

- 9.2 The bidder is advised to obtain for himself at his own cost and responsibility all information that may be necessary for preparing the bid and entering into a Contract for execution of the Works.

#### **IB.10 Bid Prices, Currency of Bid and Payment**

- 10.1 The bidder shall fill up the Schedule of Prices (Schedule A to Bid) indicating the percentage above or below the Composite Schedule of Rates/unit rates and prices of the Works to be performed under the Contract. Prices in the Schedule of Prices/Bill of Quantities shall be quoted entirely in Pak Rupees keeping in view the instructions contained in the Preamble to Schedule of Prices.
- 10.2 Unless otherwise stipulated in the Conditions of Contract, prices quoted by the bidder shall remain fixed during the bidder's performance of the Contract and not subject to variation on any account.
- 10.3 The unit rates and prices in the Schedule of Prices or percentage above or below on the composite schedule of rates shall be quoted by the bidder in the currency as stipulated in Bidding Data.
- 10.4 Items for which no rate or price is entered by the Bidder will not be paid for by the Procuring Agency when executed and shall be deemed covered by the other rates and prices in the Bill of Quantities.

#### **IB.11 Documents Establishing Bidder's Eligibility and Qualifications**

- 11.1 Pursuant to Clause IB.8, the bidder shall furnish, as part of its bid, documents establishing the bidder's eligibility to bid and its qualifications to perform the Contract if its bid is accepted.
- 11.2 Bidder must possess and provide evidence of its capability and the experience as stipulated in Bidding Data and the Qualification Criteria mentioned in the Bidding Documents.

#### **IB.12 Documents Establishing Works' Conformity to Bidding Documents**

- 12.1 The documentary evidence of the Works' conformity to the Bidding Documents may be in the form of literature, drawings and data and the bidder shall furnish documentation as set out in Bidding Data.
- 12.2 The bidder shall note that standards for workmanship, material and equipment, and references to brand names or catalogue numbers, if any, designated by the Procuring Agency in the Technical Provisions are intended to be descriptive only and not restrictive.



### **IB.13 Bid Security**

- 13.1 Each bidder shall furnish, as part of his bid, at the option of the bidder, a Bid Security as percentage of bid price/estimated cost or in the amount stipulated in Bidding Data in Pak. Rupees in the form of *Deposit at Call/ Payee's Order or a Bank Guarantee* issued by a Scheduled Bank in Pakistan in favour of the Procuring Agency valid for a period up to twenty eight (28) days beyond the bid validity date (*Bid security should not be below 1%.and not exceeding 5% of bid price/estimated cost SPP Rule 37*).
- 13.2 Any bid not accompanied by an acceptable Bid Security shall be rejected by the Procuring Agency as non-responsive.
- 13.3 The bid securities of unsuccessful bidders will be returned upon award of contract to the successful bidder or on the expiry of validity of Bid Security whichever is earlier.
- 13.4 The Bid Security of the successful bidder will be returned when the bidder has furnished the required Performance Security, and signed the Contract Agreement (SPP Rule 37).
- 13.5 The Bid Security may be forfeited:
- (a) if a bidder withdraws his bid during the period of bid validity; or
  - (b) if a bidder does not accept the correction of his Bid Price, pursuant to Sub-Clause 16.4 (b) hereof; or
  - (c) in the case of a successful bidder, if he fails within the specified time limit to:
    - (i) furnish the required Performance Security or
    - (ii) sign the Contract Agreement.

### **IB.14 Validity of Bids, Format, Signing and Submission of Bid**

- 14.1 Bids shall remain valid for the period stipulated in the Bidding Data after the date of bid opening.
- 14.2 In exceptional circumstances, Procuring Agency may request the bidders to extend the period of validity for a additional period but not exceeding 1/3 of the original period. The request and the bidders' responses shall be made in writing or by cable. A Bidder may refuse the request without forfeiting the Bid Security. A Bidder agreeing to the request will not be required or permitted to otherwise modify the Bid, but will be required to extend the validity of Bid Security for the period of the extension, and in compliance with IB.13 in all respects (SPP Rule 38).
- 14.3 All Schedules to Bid are to be properly completed and signed.
- 14.4 No alteration is to be made in the Form of Bid except in filling up the blanks as directed. If any alteration be made or if these instructions be not fully complied with, the bid may be rejected.



- 14.5 Each bidder shall prepare Original and number of copies specified in the Bidding Data of the documents comprising the bid as described in IB.8 and clearly mark them "ORIGINAL" and "COPY" as appropriate. In the event of discrepancy between them, the original shall prevail.
- 14.6 The original and all copies of the bid shall be typed or written in indelible ink and shall be signed by a person or persons duly authorized to sign (in the case of copies, Photostats are also acceptable). This shall be indicated by submitting a written Power of Attorney authorising the signatory of the bidder to act for and on behalf of the bidder. All pages of the bid shall be initialed and official seal be affixed by the person or persons signing the bid.
- 14.7 The Bid shall be delivered in person or sent by registered mail at the address to Procuring Agency as given in Bidding Data.

#### **D. SUBMISSION OF BID**

##### **IB.15 Deadline for Submission, Modification & Withdrawal of Bids**

- 15.1 Bids must be received by the Procuring Agency at the address/provided in Bidding Data not later than the time and date stipulated therein.
- 15.2 The inner and outer envelopes shall
- (a) be addressed to the Procuring Agency at the address provided in the Bidding Data;
  - (b) bear the name and identification number of the Contract as defined in the Bidding and Contract Data; and
  - (c) provide a warning not to open before the specified time and date for Bid opening as defined in the Bidding Data.
  - (d) in addition to the identification required in 15.2, the inner envelopes shall indicate the name and address of the Bidder to enable the Bid to be returned unopened in case it is declared late.
  - (e) If the outer envelope is not sealed and marked as above, the Procuring Agency will assume no responsibility for the misplacement or premature opening of the Bid.
- 15.3 Bids submitted through telegraph, telex, fax or e-mail shall not be considered.
- 15.4 Any bid received by the Procuring Agency after the deadline for submission prescribed in Bidding Data will be returned unopened to such bidder.
- 15.5 Any bidder may modify or withdraw his bid after bid submission provided that the modification or written notice of withdrawal is received by the Procuring Agency prior to the deadline for submission of bids.
- 15.6 Withdrawal of a bid during the interval between the deadline for submission of bids and the expiration of the period of bid validity specified in the Form of Bid may result in forfeiture of the Bid Security pursuant to IB.13.5 (a).



## E. BID OPENING AND EVALUATION

### IB.16 Bid Opening, Clarification and Evaluation (SPP Rules 41, 42 & 43)

- 16.1 The Procuring Agency will open the bids, in the presence of bidders' representatives who choose to attend, at the time, date and in the place specified in the Bidding Data.
- 16.2 The bidder's name, Bid Prices, any discount, the presence or absence of Bid Security, and such other details as the Procuring Agency at its discretion may consider appropriate, will be announced by the Procuring Agency at the bid opening. The Procuring Agency will record the minutes of the bid opening. Representatives of the bidders who choose to attend shall sign the attendance sheet.

Any Bid Price or discount which is not read out and recorded at bid opening will not be taken into account in the evaluation of bid.

- 16.3 To assist in the examination, evaluation and comparison of Bids the Engineer/Procuring Agency may, at its discretion, ask the bidder for a clarification of its Bid. The request for clarification and the response shall be in writing and no change in the price or substance of the Bid shall be sought, offered or permitted (SPP Rule 43).

- 16.4 (a) Prior to the detailed evaluation, pursuant to IB.16.7 to 16.9, the Engineer/Procuring Agency will determine the substantial responsiveness of each bid to the Bidding Documents. For purpose of these instructions, a substantially responsive bid is one which conforms to all the terms and conditions of the Bidding Documents without material deviations. It will include determining the requirements listed in Bidding Data.

- (b) Arithmetical errors will be rectified on the following basis:

If there is a discrepancy between the unit price and total price that is obtained by multiplying the unit price and quantity, the unit price shall prevail and the total price shall be corrected. If there is a discrepancy between the words and figures the amount in words shall prevail. If there is a discrepancy between the Total Bid price entered in Form of Bid and the total shown in Schedule of Prices-Summary, the amount stated in the Form of Bid will be corrected by the Procuring Agency in accordance with the Corrected Schedule of Prices.

If the bidder does not accept the corrected amount of Bid, his Bid will be rejected and his Bid Security forfeited.

- 16.5 A Bid determined as substantially non-responsive will be rejected and will not subsequently be made responsive by the bidder by correction of the non-conformity.
- 16.6 Any minor informality or non-conformity or irregularity in a Bid which does not constitute a material deviation (**major deviation**) may be waived by Procuring Agency,



provided such waiver does not prejudice or affect the relative ranking of any other bidders.

**(A). Major (material) Deviations include:-**

- (i) has been not properly signed;
- (ii) is not accompanied by the bid security of required amount and manner;
- (iii) stipulating price adjustment when fixed price bids were called for;
- (iv) failing to respond to specifications;
- (v) failing to comply with Mile-stones/Critical dates provided in Bidding Documents;
- (vi) sub-contracting contrary to the Conditions of Contract specified in Bidding Documents;
- (vii) refusing to bear important responsibilities and liabilities allocated in the Bidding Documents, such as performance guarantees and insurance coverage;
- (viii) taking exception to critical provisions such as applicable law, taxes and duties and dispute resolution procedures;
- (ix) a material deviation or reservation is one :
  - (a) which affect in any substantial way the scope, quality or performance of the works;
  - (b) adoption/rectification whereof would affect unfairly the competitive position of other bidders presenting substantially responsive bids.

**(B) Minor Deviations**

Bids that offer deviations acceptable to the Procuring Agency and which can be assigned a monetary value may be considered substantially responsive at least as to the issue of fairness. This value would however be added as an adjustment for evaluation purposes only during the detailed evaluation process.

- 16.7 The Engineer/Procuring Agency will evaluate and compare only the bids previously determined to be substantially responsive pursuant to IB.16.4 to 16.6 as per requirements given hereunder. Bids will be evaluated for complete scope of works. The prices will be compared on the basis of the Evaluated Bid Price pursuant to IB.16.8 herein below.

**Technical Evaluation:** It will be examined in detail whether the works offered by the bidder complies with the Technical Provisions of the Bidding Documents. For this purpose, the bidder's data submitted with the bid in Schedule B to Bid will be compared with technical features/criteria of the works detailed in the Technical Provisions. Other technical information submitted with the bid regarding the Scope of Work will also be reviewed.

**16.8 Evaluated Bid Price**

In evaluating the bids, the Engineer/Procuring Agency will determine for each bid in addition to the Bid Price, the following factors (adjustments) in the manner and to the extent indicated below to determine the Evaluated Bid Price:

- (i) making any correction for arithmetic errors pursuant to IB.16.4 hereof.



- (ii) discount, if any, offered by the bidders as also read out and recorded at the time of bid opening.
- (iii) excluding **provisional sums** and the provisions for **contingencies** in the Bill of Quantities **if any**, but including **Day work**, where priced competitively.

#### **IB.17 Process to be Confidential**

17.1 Subject to IB.16.3 heretofore, no bidder shall contact Engineer/Procuring Agency on any matter relating to its Bid from the time of the Bid opening to the time the bid evaluation result is announced by the Procuring Agency. The evaluation result shall be announced at least seven (07) days prior to award of Contract (SPP Rule 45). The announcement to all bidders will include table(s) comprising read out prices, discounted prices, price adjustments made, final evaluated prices and recommendations against all the bids evaluated.

17.2 Any effort by a bidder to influence Engineer/Procuring Agency in the Bid evaluation, Bid comparison or Contract Award decisions may result in the rejection of his Bid. Whereas any bidder feeling aggrieved, may lodge a written complaint to Complaint Redressal Committee as per terms and conditions mentioned in SPP Rules 31 & 32. However, mere fact of lodging a complaint shall not warrant suspension of procurement process.

17.3 Bidders may be excluded if involved in **“Corrupt and Fraudulent Practices”** means either one or any combination of the practices given below SPP Rule2(q);

- (i) **“Coercive Practice”** means any impairing or harming, or threatening to impair or harm, directly or indirectly, any party or the property of the party to influence the actions of a party to achieve a wrongful gain or to cause a wrongful loss to another party;
- (ii) **“Collusive Practice”** means any arrangement between two or more parties to the procurement process or contract execution, designed to achieve with or without the knowledge of the procuring agency to establish prices at artificial, noncompetitive levels for any wrongful gain;
- (iii) **“Corrupt Practice”** means the offering, giving, receiving or soliciting, directly or indirectly, of anything of value to influence the acts of another party for wrongful gain;
- (iv) **“Fraudulent Practice”** means any act or omission, including a misrepresentation, that knowingly or recklessly misleads, or attempts to mislead, a party to obtain a financial or other benefit or to avoid an obligation;
- (v) **“Obstructive Practice”** means harming or threatening to harm, directly or indirectly, persons or their property to influence their participation in a procurement process, or affect the execution of a contract or deliberately destroying, falsifying, altering or concealing of evidence material to the investigation or making false statements before investigators in order to materially impede an investigation into allegations of a corrupt, fraudulent, coercive or collusive practice; or threatening, harassing or intimidating any party to prevent it from disclosing its knowledge of matters relevant to the investigation or from pursuing the investigation, or acts intended to materially impede the exercise of inspection and audit rights provided for under the Rules.



## F. AWARD OF CONTRACT

### IB.18. Post Qualification

- 18.1 The Procuring Agency, at any stage of the bid evaluation, having credible reasons for or *prima facie* evidence of any defect in contractor's capacities, may require the contractors to provide information concerning their professional, technical, financial, legal or managerial competence whether already pre-qualified or not:

Provided, that such qualification shall only be laid down after recording reasons therefore in writing. They shall form part of the records of that bid evaluation report.

- 18.2 The determination will take into account the bidder's financial and technical capabilities. It will be based upon an examination of the documentary evidence of the bidders' qualifications submitted under B.11, as well as such other information required in the Bidding Documents.

### IB.19 Award Criteria & Procuring Agency's Right

- 19.1 Subject to IB.19.2, the Procuring Agency will award the Contract to the bidder whose bid has been determined to be substantially responsive to the Bidding Documents and who has offered the lowest evaluated Bid Price, provided that such bidder has been determined to be qualified to satisfactory perform the Contract in accordance with the provisions of the IB.18.
- 19.2 Notwithstanding IB.19.1, the Procuring Agency reserves the right to accept or reject any bid, and to annul the bidding process and reject all bids, at any time prior to award of Contract, without thereby incurring any liability to the affected bidders or any obligation to inform the affected bidders of the grounds for the Procuring Agency's action except that the grounds for its rejection of all bids shall upon request be communicated, to any bidder who submitted a bid, without justification of the grounds. Notice of the rejection of all the bids shall be given promptly to all the bidders (SPP Rule 25).

### IB.20 Notification of Award & Signing of Contract Agreement

- 20.1 Prior to expiration of the period of bid validity prescribed by the Procuring Agency, the Procuring Agency will notify the successful bidder in writing ("Letter of Acceptance") that his bid has been accepted (SPP Rule 49).
- 20.2 Within seven (07) days from the date of furnishing of acceptable Performance Security under the Conditions of Contract, the Procuring Agency will send the successful bidder the Form of Contract Agreement provided in the Bidding Documents, incorporating all agreements between the parties.
- 20.3 The formal Agreement between the Procuring Agency and the successful bidder duly stamped at rate of ----% of bid price(updated from time to time) stated in Letter of Acceptance shall be executed within seven (07) days of the receipt of Form of Contract Agreement by the successful bidder from the Procuring Agency.



## **IB.21 Performance Security**

- 21.1 The successful bidder shall furnish to the Procuring Agency a Performance Security in the form and the amount stipulated in the Conditions of Contract within a period of fourteen (14) days after the receipt of Letter of Acceptance (SPP 39).
- 21.2 Failure of the successful bidder to comply with the requirements of Sub-Clauses IB.20.2 & 20.3 or 21.1 or Clause IB.22 shall constitute sufficient grounds for the annulment of the award and forfeiture of the Bid Security.
- 21.3 Publication of Award of Contract: within seven days of the award of contract, the procuring shall publish on the website of the authority and on its own website, if such a website exists, the results of the bidding process, identifying the bid through procurement identifying Number if any and the following information:
- (1) Evaluation Report;
  - (2) Form of Contract and letter of Award;
  - (3) Bill of Quantities or Schedule of Requirements. (SPP Rule 50)

**IB.22 Integrity Pact** The Bidder shall sign and stamp the Form of Integrity Pact provided at Schedule-F to Bid in the Bidding Document for all Sindh Government procurement contracts exceeding Rupees ten (10) million. Failure to provide such Integrity Pact shall make the bid non-responsive (SPP Rule 89).

## BIDDING DATA

*The following specific data for the works to be tendered shall complement, amend, or supplement the provisions in the Instructions to Bidders. Wherever there is a conflict, the provisions herein shall prevail over those in the Instructions to Bidders.*

### Instructions to Bidders Clause Reference

**1.1 Name of Procuring Agency:** Mehran University of Engineering and Technology, Jamshoro.

**Brief Description of Works:** This work consists of Internal & External Electrification, Air Conditioning System, Computer Data & Voice System Works of Girls' Hostel No. 3 of Mehran University of Engineering & Technology, Jamshoro.

**5.1 (a) Procuring Agency's address:** Office of the Executive Engineer (Works), Mehran University of Engineering & Technology Jamshoro.

**(b) Engineer's address:**

**KAD Consultants Hyderabad**

F-1, Zaib Residency, 70/72/1 Hussain Housing Scheme, Near  
Summit Bank Wadhu Wah, Qasimabad Hyderabad  
Ph# +92-22-2652274  
Fax# +92-22-2652275  
E-mail: [kad.consultants@hotmail.com](mailto:kad.consultants@hotmail.com)

**10.3 Bid shall be quoted entirely in Pak. Rupees.** The payment shall be made in Pak. Rupees.

**11.2 The bidder has the financial, technical and constructional capability necessary to perform the Contract as follows:**

- i. Financial capacity: (must have annual average turnover of Rs20 Million of last 3 years);*
- ii. Technical capacity: Category of registration with PEC C-6 or above*

**12.1 (a) A detailed description of the Works, essential technical and performance characteristics.**

(b) Complete set of technical information, description data, literature and drawings as required in accordance with Schedule B to Bid, Specific Works Data. This will include but not be limited to a sufficient number of drawings, photographs, catalogues, illustrations and such other information as is necessary to illustrate clearly the significant characteristics such as general construction dimensions and other relevant information about the works to be performed.

**13.1 Amount of Bid Security/Earnest Money:** 2% of total bid amount

**14.1 Period of Bid Validity:** 90 days

**14.4 Number of Copies of the Bid to be submitted:** One original plus 2 copies.

**14.6 (a) Procuring Agency's Address for the Purpose of Bid Submission:**

Office of the Executive Engineer (Works), Mehran University of Engineering & Technology, Jamshoro

**15.1 Deadline for Submission of Bids:** Time: 12.00 NOON Date:08-04-2014..

**16.1 Venue, Time, and Date of Bid Opening**

**Venue:** Office of the Executive Engineer, Mehran University of Engineering & Technology, Jamshoro

**Time:** 12.30 P.M **Date:** 08-04-2014

**16.4 Responsiveness of Bids**

- (i) Bid is valid till required period
- (ii) Bid prices are firm during currency of contract/Fixed Price Contract
- (iii) Completion period offered is within specified limits
- (iv) Pre-qualified Bidders are eligible to Bid and possesses the requisite experience, capability and qualification
- (v) Bid does not deviate from basic technical requirements and
- (vi) Bids are generally in order, etc.



- (a) **Fixed Price contract:** In these contracts no escalation will be provided during currency of the contract
- (b) **Price adjustment contract:** In these contracts escalation will be paid only on those items and in the manner as notified by Finance Department, Government of Sindh, after bid opening during currency of the contract. **(NOT APPLICABLE)**



## **FORM OF BID AND SCHEDULES TO BID**

**FORM OF BID**  
**(LETTER OF OFFER)**

Bid Reference No. \_\_\_\_\_

\_\_\_\_\_  
*(Name of Works)*

To:

Gentlemen,

1. Having examined the Bidding Documents including Instructions to Bidders, Bidding Data, Conditions of Contract, Contract Data, Specifications, Drawings, if any, Schedule of Prices and Addenda Nos. \_\_\_\_\_ for the execution of the above-named works, we, the undersigned, being a company doing business under the name of and address \_\_\_\_\_ and being duly incorporated under the laws of Pakistan hereby offer to execute and complete such works and remedy any defects therein in conformity with the said Documents including Addenda thereto for the Total Bid Price of Rs \_\_\_\_\_ (Rupees \_\_\_\_\_) or such other sum as may be ascertained in accordance with the said Documents.
2. We understand that all the Schedules attached hereto form part of this Bid.
3. As security for due performance of the undertakings and obligations of this Bid, we submit herewith a Bid Security in the amount of \_\_\_\_\_ drawn in your favour or made payable to you and valid for a period of twenty eight (28) days beyond the period of validity of Bid.
4. We undertake, if our Bid is accepted, to commence the Works and to deliver and complete the Works comprised in the Contract within the time(s) stated in Contract Data.
5. We agree to abide by this Bid for the period of \_\_\_\_\_ days from the date fixed for receiving the same and it shall remain binding upon us and may be accepted at any time before the expiration of that period.
6. Unless and until a formal Agreement is prepared and executed, this Bid, together with your written acceptance thereof, shall constitute a binding contract between us.
7. We undertake, if our Bid is accepted, to execute the Performance Security



referred to in Conditions of Contract for the due performance of the Contract.

8. We understand that you are not bound to accept the lowest or any bid you may receive.
9. We do hereby declare that the Bid is made without any collusion, comparison of figures or arrangement with any other person or persons making a bid for the Works.

Dated this \_\_\_\_\_ day of \_\_\_\_\_, 20

Signature \_\_\_\_\_

in the capacity of \_\_\_\_\_ duly authorized to sign bid for and on behalf of

\_\_\_\_\_  
(Name of Bidder in Block Capitals)

(Seal)

Address

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Witness:

(Signature) \_\_\_\_\_

Name: \_\_\_\_\_

Address: \_\_\_\_\_

\_\_\_\_\_

**[SCHEDULES TO BID INCLUDE THE FOLLOWING:**

- Schedule A to Bid: Schedule of Prices
- Schedule B to Bid: Specific Works Data
- Schedule C to Bid: Works to be Performed by Subcontractors
- Schedule D to Bid: Proposed Program of Works
- Schedule E to Bid: Method of Performing Works
- Schedule F to Bid: Integrity Pact]



## SCHEDULE – A TO BID

### SCHEDULE OF PRICES

<u>Sr. No.</u>		<u>Page No.</u>
1.	Preamble to Schedule of Prices.....	24
2.	Schedule of Prices.....	26
	* (a) Summary of Bid Prices	
	* (b) Detailed Schedule of Prices /Bill of Quantities (BOQ)	

*\* [To be prepared by the Engineer/Procuring Agency]*

# PREAMBLE TO SCHEDULE OF PRICES

## 1. General

- 1.1 The Schedule of Prices shall be read in conjunction with the Conditions of Contract, Contract Data together with the Specifications and Drawings, if any.
- 1.2 The Contract shall be for the whole of the works as described in these Bidding Documents. Bids must be for the complete scope of works.

## 2. Description

- 2.1 The general directions and descriptions of works and materials are not necessarily repeated nor summarized in the Schedule of Prices. References to the relevant sections of the Bidding Documents shall be made before entering prices against each item in the Schedule of Prices.

## 3. Units & Abbreviations

- 3.1 Units of measurement, symbols and abbreviations expressed in the Bidding Documents shall comply with the Systeme Internationale d'Unites (SI Units).

---

---

*(Note: The abbreviations to be used in the Schedule of Prices to be defined by the Procuring Agency).*

## 4. Rates and Prices

- 4.1 Except as otherwise expressly provided under the Conditions of Contract, the rates and amounts entered in the Schedule of Prices shall be the rates at which the Contractor shall be paid and shall be the full inclusive value of the works set forth or implied in the Contract; except for the amounts reimbursable, if any to the Contractor under the Contract.
- 4.2 Unless otherwise stipulated in the Contract Data, the premium, rates and prices entered by the bidder shall not be subject to adjustment during the performance of the Contract.
- 4.3 All duties, taxes and other levies payable by the Contractor shall be included in the rates and prices.
- 4.4 The whole cost of complying with the provisions of the Contract shall be included in the items provided in the Schedule of Prices, and where



## **SCHEDULE - A TO BID**

no items are provided, the cost shall be deemed to be distributed among the rates and prices entered for the related items of the Works and no separate payment will be made for those items.

The rates, prices and amounts shall be entered against each item in the Schedule of Prices. Any item against which no rate or price is entered by the bidder will not be paid for by the Procuring Agency when executed and shall be deemed covered by the rates and prices for other items in the Schedule of Prices.

4.5 (a) The bidder shall be deemed to have obtained all information as to and all requirements related thereto which may affect the bid price.

(b) The Contractor shall be responsible to make complete arrangements for the transportation of the plant to the site. Such cost shall be inbuilt in his quoted rates.

4.6 The Contractor shall provide for all parts of the Works to be completed in every respect. Notwithstanding that any details, accessories, etc. required for the complete installation and satisfactory operation of the Works, are not specifically mentioned in the Specifications, such details shall be considered as included in the Contract Price.

## **5. Bid Prices**

### **5.1 Break-up of Bid Prices**

The various elements of Bid Prices shall be quoted as detailed by the Procuring Agency in the format of Schedule of Prices. The bidder shall recognize such elements of the costs which he expects to incur the performance of the Works and shall include all such costs in the rates and amounts entered in the Schedule of Prices.

### **5.2 Total Bid Price**

The total of bid prices in the Schedule of Prices shall be entered in the Summary of Bid Prices.

## **6. Provisional Sums and Day work**

6.1 Provisional Sums included and so designated in the Schedule of Prices if any, shall be expended in whole or in part at the direction and discretion of the Engineer/Procuring Agency. The Contractor will only receive payment in respect of Provisional Sums, if he has been instructed by the Engineer/Procuring Agency to utilize such sums.

6.2 Day work rates in the contractor's bid are to be used for small additional amounts of work and only when the Engineer have given written instructions in advance for additional work to be paid for in that way.

SCHEDULE OF PRICES – SUMMARY OF BID PRICES (Sample)

Bill No.	Description	Total Amount (Rs)
	<b>(A) Building Work</b>	
1.	Civil works	
2.	Internal sanitary and water supply	
3.	Electrification	
4.	External Development works	
5.	Miscellaneous Items	
	<b>(B) Road Work.</b>	
1.	Earthwork	
2.	Hard Crust and Surface Treatment	
3.	Culverts and Bridges	
4.	Miscellaneous Items	
	<b>(C) Public Health Engineering Works.</b>	
1.	Earthwork	
2.	Subsurface Drains	
3.	Pipe Laying and Man holes	
4.	Tube wells, Pump houses	
5.	Compound wall	
6.	Miscellaneous Items	
	<b>Total Bid Price (The amount to be entered in Paragraph 1 of the Form of Bid)</b> <b>(In words).</b>	



## SCHEDULE OF PRICES

Item No.	Description	Quantity	Unit Rate(Rs)	Total Amount (Rs)
1. 2. 3.	<b>I. (Civil works)</b>			
1. 2. 3.	<b>II. Internal sanitary and water supply.</b>			
1. 2. 3.	<b>III. Electrification.</b>			
1. 2. 3.	<b>IV. External Development works.</b>			
1. 2. 3.	<b>V. Miscellaneous Items</b>			
<b>Total (to be carried to Summary of Bid Price)</b> <i>Add/ Deduct the percentage quoted above/below on the prices of items based on Composite Schedule of Rates.</i>				

**SCHEDULE - B TO BID**

**\*SPECIFIC WORKS DATA**

*(To be prepared and incorporated by the Procuring Agency)*

NOT APPLICABLE

*\*(Note: The Procuring Agency shall spell out the information & data required to be filled out by the bidder and to furnish complementary information).*



## SCHEDULE – C TO BID

### WORKS TO BE PERFORMED BY SUBCONTRACTORS\*

The bidder will do the work with his own forces except the work listed below which he intends to sub-contract.

Items of Works to be Sub-Contracted	Name and address of Sub-Contractors	Statement of similar works previously executed. (attach evidence)
--	--	--

NOT APPLICABLE

#### Note:

- \* *The Procuring Agency should decide whether to allow subcontracting or not. In case Procuring Agency decides to allow subcontracting then following conditions shall be complied with:*
  1. No change of Sub-Contractors shall be made by the bidder without prior approval of the Procuring Agency.
  2. The truthfulness and accuracy of the statement as to the experience of Sub-Contractors is guaranteed by the bidder. The Procuring Agency's judgment shall be final as to the evaluation of the experience of Sub-Contractors submitted by the bidder.
  3. Statement of similar works shall include description, location & value of works, year completed and name & address of the clients.

## **SCHEDULE – D TO BID**

### **PROPOSED PROGRAMME OF WORKS**

Bidder shall provide a programme in a bar-chart or Program Evaluation and Review Technique (PERT) or Critical Path Method (CPM) showing the sequence of work items by which he proposes to complete the works of the entire Contract. The programme should indicate the sequence of work items and the period of time during which he proposes to complete the works including the activities like designing, schedule of submittal of drawings, ordering and procurement of materials, manufacturing, delivering, construction of civil works, erection, testing and commissioning of works to be supplied under the Contract.



**METHOD OF PERFORMING WORKS**

The bidder is required to submit a narrative outlining the method of performing the Works. The narrative should indicate in detail and include but not be limited to:

- The sequence and methods in which he proposes to carry out the Works, including the number of shifts per day and hours per shift, he expects to work.
- A list of all major items of construction and plant erection, tools and vehicles proposed to be used in delivering/carrying out the works at site.
- The procedure for installation of equipment and transportation of equipment and materials to the site.
- Organisation chart indicating head office & field office personnel involved in management, supervision and engineering of the Works to be done under the Contract.

**SCHEDULE – F TO BID**

**(INTEGRITY PACT)**

**DECLARATION OF FEES, COMMISSION AND BROKERAGE ETC  
PAYABLE BY CONTRACTORS  
(FOR CONTRACTS WORTH RS. 10.00 MILLION OR MORE)**

Contract No. \_\_\_\_\_ Dated \_\_\_\_\_

Contract Value: \_\_\_\_\_

Contract Title: \_\_\_\_\_

..... [name of Contractor] hereby declares that it has not obtained or induced the procurement of any contract, right, interest, privilege or other obligation or benefit from Government of Sindh (GoS) or any administrative subdivision or agency thereof or any other entity owned or controlled by it (GoS) through any corrupt business practice.

Without limiting the generality of the foregoing, [name of Contractor] represents and warrants that it has fully declared the brokerage, commission, fees etc. paid or payable to anyone and not given or agreed to give and shall not give or agree to give to anyone within or outside Pakistan either directly or indirectly through any natural or juridical person, including its affiliate, agent, associate, broker, consultant, director, promoter, shareholder, sponsor or subsidiary, any commission, gratification, bribe, finder's fee or kickback, whether described as consultation fee or otherwise, with the object of obtaining or inducing the procurement of a contract, right, interest, privilege or other obligation or benefit in whatsoever form from, from Procuring Agency (PA) except that which has been expressly declared pursuant hereto.

[name of Contractor] accepts full responsibility and strict liability that it has made and will make full disclosure of all agreements and arrangements with all persons in respect of or related to the transaction with PA and has not taken any action or will not take any action to circumvent the above declaration, representation or warranty.

[name of Contractor] accepts full responsibility and strict liability for making any false declaration, not making full disclosure, misrepresenting facts or taking any action likely to defeat the purpose of this declaration, representation and warranty. It agrees that any contract, right, interest, privilege or other obligation or benefit obtained or procured as aforesaid shall, without prejudice to any other rights and remedies available to PA under any law, contract or other instrument, be voidable at the option of PA.

Notwithstanding any rights and remedies exercised by PA in this regard, [name of Supplier/Contractor/Consultant] agrees to indemnify PA for any loss or damage incurred by it on account of its corrupt business practices and further pay compensation to PA in an amount equivalent to ten times the sum of any commission, gratification, bribe, finder's fee or kickback given by [name of Contractor] as aforesaid for the purpose of obtaining or inducing the procurement of any contract, right, interest, privilege or other obligation or benefit in whatsoever form from PA.

.....  
[Procuring Agency]

[Contractor]



## **CONDITIONS OF CONTRACT**

## TABLE OF CONTENTS

### CONDITIONS OF CONTRACT

<i>Clause No</i>	<i>Description</i>	<i>Page No</i>
1.	General Provisions.....	35
2.	The Procuring Agency.....	37
3.	Engineer's/Procuring Agency's Representatives.....	37
4.	The Contractor.....	38
5.	Design by Contractor.....	38
6.	Procuring Agency's Risks.....	39
7.	Time for Completion.....	40
8.	Taking Over.....	41
9.	Remedying Defects.....	41
10.	Variations and Claims.....	41
11.	Contract Price And Payment.....	43
12.	Default.....	44
13.	Risks and Responsibilities.....	46
14.	Insurance.....	46
15.	Resolution of Disputes.....	47
16.	Integrity Pact.....	48



## CONDITIONS OF CONTRACT

### 1. GENERAL PROVISIONS

#### 1.1 Definitions

In the Contract as defined below, the words and expressions defined shall have the following meanings assigned to them, except where the context requires otherwise:

##### **The Contract**

1.1.1 “Contract” means the Contract Agreement and the other documents listed in the Contract Data.

1.1.2 “Specifications” means the document as listed in the Contract Data, including Procuring Agency’s requirements in respect of design to be carried out by the Contractor (if any), and any Variation to such document.

1.1.3 “Drawings” means the Procuring Agency’s drawings of the Works as listed in the Contract Data, and any Variation to such drawings.

##### **Persons**

1.1.4 “Procuring Agency” means the person named in the Contract Data and the legal successors in title to this person, but not (except with the consent of the Contractor) any assignee.

1.1.5 “Contractor” means the person named in the Contract Data and the legal successors in title to this person, but not (except with the consent of the Procuring Agency) any assignee.

1.1.6 “Party” means either the Procuring Agency or the Contractor.

##### **Dates, Times and Periods**

1.1.7 “Commencement Date” means the date fourteen (14) days after the date the Contract comes into effect or any other date named in the Contract Data.

1.1.8 “Day” means a calendar day

1.1.9 “Time for Completion” means the time for completing the Works as stated in the Contract Data (or as extended under Sub-Clause 7.3), calculated from the Commencement Date.

##### **Money and Payments**

1.1.10 “Cost” means all expenditure properly incurred (or to be incurred) by the Contractor, whether on or off the Site, including overheads and similar charges but

does not include any allowance for profit.

#### **Other Definitions**

- 1.1.11 “Contractor’s Equipment” means all machinery, apparatus and other things required for the execution of the Works but does not include Materials or Plant intended to form part of the Works.
- 1.1.12 “Country” means the Islamic Republic of Pakistan.
- 1.1.13 “Procuring Agency’s Risks” means those matters listed in Sub-Clause 6.1.
- 1.1.14 “Force Majeure” means an event or circumstance which makes performance of a Party’s obligations illegal or impracticable and which is beyond that Party’s reasonable control.
- 1.1.15 “Materials” means things of all kinds (other than Plant) to be supplied and incorporated in the Works by the Contractor.
- 1.1.16 “Plant” means the machinery and apparatus intended to form or forming part of the Works.
- 1.1.17 “Site” means the places provided by the Procuring Agency where the Works are to be executed, and any other places specified in the Contract as forming part of the Site.
- 1.1.18 “Variation” means a change which is instructed by the Engineer/Procuring Agency under Sub-Clause 10.1.
- 1.1.19 “Works” means any or all the works whether Supply, Installation, Construction etc. and design (if any) to be performed by the Contractor including temporary works and any variation thereof.
- 1.1.20 “Engineer” means the person notified by the Procuring Agency to act as Engineer for the purpose of the Contract and named as such in Contract Data.

#### **1.2 Interpretation**

Words importing persons or parties shall include firms and organisations. Words importing singular or one gender shall include plural or the other gender where the context requires.

#### **1.3 Priority of Documents**

The documents forming the Contract are to be taken as mutually explanatory of one another. If an ambiguity or discrepancy is found in the documents, the priority of the documents shall be in accordance with the order as listed in the Contract Data.



1.4 **Law**

The law of the Contract is the relevant Law of Islamic Republic of Pakistan.

1.5 **Communications**

All Communications related to the Contract shall be in English language.

1.6 **Statutory Obligations**

The Contractor shall comply with the Laws of Islamic Republic of Pakistan and shall give all notices and pay all fees and other charges in respect of the Works.

2. **THE PROCURING AGENCY**

2.1 **Provision of Site**

The Procuring Agency shall provide the Site and right of access thereto at the times stated in the Contract Data.

**Site Investigation Reports** are those that were included in the bidding documents and are factual and interpretative reports about the surface and subsurface conditions at the Site.

2.2 **Permits etc.**

The Procuring Agency shall, if requested by the Contractor, assist him in applying for permits, licences or approvals which are required for the Works.

2.3 **Engineer's/Procuring Agency's Instructions**

The Contractor shall comply with all instructions given by the Procuring Agency or the Engineer, if notified by the Procuring Agency, in respect of the Works including the suspension of all or part of the works.

2.4 **Approvals**

No approval or consent or absence of comment by the Engineer/Procuring Agency shall affect the Contractor's obligations.

3. **ENGINEER'S/PROCURING AGENCY'S REPRESENTATIVES**

3.1 **Authorised Person**

The Procuring Agency shall appoint a duly authorized person to act for him and on his behalf for the purposes of this Contract. Such authorized person shall be duly identified in the Contract Data or otherwise notified in writing to the Contractor as soon as he is so appointed. In either case the Procuring Agency shall notify the Contractor, in writing, the precise scope of the authority of such authorized person at the time of his appointment.



### **3.2 Engineer's/Procuring Agency's Representative**

The name and address of Engineer's/Procuring Agency's Representative is given in Contract Data. However the Contractor shall be notified by the Engineer/Procuring Agency, the delegated duties and authority before the Commencement of works.

## **4. THE CONTRACTOR**

### **4.1 General Obligations**

The Contractor shall carry out the works properly and in accordance with the Contract. The Contractor shall provide all supervision, labour, Materials, Plant and Contractor's Equipment which may be required

### **4.2 Contractor's Representative**

The Contractor shall appoint a representative at site on full time basis to supervise the execution of work and to receive instructions on behalf of the Contractor but only after obtaining the consent of the Procuring Agency for such appointment which consent shall not be withheld without plausible reason(s) by the Procuring Agency. Such authorized representative may be substituted/ replaced by the Contractor at any time during the Contract Period but only after obtaining the consent of the Procuring Agency as aforesaid.

### **4.3 Subcontracting**

The Contractor shall not subcontract the whole of the works. The Contractor shall not subcontract any part of the works without the consent of the Procuring Agency.

### **4.4 Performance Security**

The Contractor shall furnish to the Procuring Agency within fourteen (14) days after receipt of Letter of Acceptance a Performance Security at the option of the bidder, in the form of Payee's order /Bank Draft or Bank Guarantee from scheduled bank for the amount and validity specified in Contract Data.

## **5. DESIGN BY CONTRACTOR**

### **5.1 Contractor's Design**

The Contractor shall carry out design to the extent specified, as referred to in the Contract Data. The Contractor shall promptly submit to the Engineer/Procuring Agency all designs prepared by him, within fourteen (14) days of receipt the Engineer/Procuring Agency shall notify any comments or, if the design submitted is not in accordance with the Contract, shall reject it stating the reasons. The

Contractor shall not construct any element of the works designed by him within fourteen (14) days after the design has been submitted to the Engineer/Procuring Agency or which has been rejected. Design that has been rejected shall be promptly amended and resubmitted. The Contractor shall resubmit all designs commented on taking these comments into account as necessary.

## **5.2 Responsibility for Design**

The Contractor shall remain responsible for his bided design and the design under this Clause, both of which shall be fit for the intended purposes defined in the Contract and he shall also remain responsible for any infringement of any patent or copyright in respect of the same. The Engineer/Procuring Agency shall be responsible for the Specifications and Drawings.

## **6. PROCURING AGENCY'S RISKS**

### **6.1 The Procuring Agency's Risks**

The Procuring Agency's Risks are:-

- a) war, hostilities (whether war be declared or not), invasion, act of foreign enemies, within the Country;
- b) rebellion, terrorism, revolution, insurrection, military or usurped power, or civil war, within the Country;
- c) riot, commotion or disorder by persons other than the Contractor's personnel and other employees including the personnel and employees of Sub-Contractors, affecting the Site and/or the Works;
- d) ionising radiations, or contamination by radio-activity from any nuclear fuel, or from any nuclear waste from the combustion of nuclear fuel, radio-active toxic explosive, or other hazardous properties of any explosive nuclear assembly or nuclear component of such an assembly, except to the extent to which the Contractor/Sub-Contractors may be responsible for the use of any radio-active material;
- e) Pressure waves caused by aircraft or other aerial devices travelling at sonic or supersonic speeds;
- f) use or occupation by the Procuring Agency of any part of the Works, except as may be specified in the Contract;
- g) late handing over of sites, anomalies in drawings, late delivery of designs and drawings of any part of the Works by the Procuring Agency's personnel or by others for whom the Procuring Agency is responsible;
- h) a suspension under Sub-Clause 2.3 unless it is attributable to the Contractor's failure; and



- i) physical obstructions or physical conditions other than climatic conditions, encountered on the Site during the performance of the Works, for which the Contractor immediately notified to the Procuring Agency and accepted by the Procuring Agency.

## **7. TIME FOR COMPLETION**

### **7.1 Execution of the Works**

The Contractor shall commence the Works on the Commencement Date and shall proceed expeditiously and without delay and shall complete the Works, subject to Sub-Clause 7.3 below, within the Time for Completion.

### **7.2 Programme**

Within the time stated in the Contract Data, the Contractor shall submit to the Engineer/Procuring Agency a programme for the Works in the form stated in the Contract Data.

### **7.3 Extension of Time**

The Contractor shall, within such time as may be reasonable under the circumstances, notify the Procuring Agency/Engineer of any event(s) falling within the scope of Sub-Clause 6.1 or 10.3 of these Conditions of Contract and request the Procuring Agency/Engineer for a reasonable extension in the time for the completion of works. Subject to the aforesaid, the Procuring Agency/Engineer shall determine such reasonable extension in the time for the completion of works as may be justified in the light of the details/particulars supplied by the Contractor in connection with the such determination by the Procuring Agency/Engineer within such period as may be prescribed by the Procuring Agency/Engineer for the same; and the Procuring Agency may extend the time for completion as determined.

### **7.4 Late Completion**

If the Contractor fails to complete the Works within the Time for Completion, the Contractor's only liability to the Procuring Agency for such failure shall be to pay the amount as **liquidity damages** stated in the Contract Data for each day for which he fails to complete the Works.

## **8. TAKING-OVER**

### **8.1 Completion**

The Contractor may notify the Engineer/Procuring Agency when he considers that the Works are complete.



## **8.2 Taking-Over Notice**

Within fourteen (14) days of the receipt of the said notice of completion from the Contractor the Procuring Agency/Engineer shall either takeover the completed works and issue a Certificate of Completion to that effect or shall notify the Contractor his reasons for not taking-over the works. While issuing the Certificate of Completion as aforesaid, the Procuring Agency/Engineer may identify any outstanding items of work which the Contractor shall undertake during the Maintenance Period.

## **9. REMEDYING DEFECTS**

### **9.1 Remedying Defects**

The Contractor shall for a period stated in the Contract Data from the date of issue of the Certificate of Completion carry out, at no cost to the Procuring Agency, repair and rectification work which is necessitated by the earlier execution of poor quality of work or use of below specifications material in the execution of Works and which is so identified by the Procuring Agency/Engineer in writing within the said period. Upon expiry of the said period, and subject to the Contractor's faithfully performing his aforesaid obligations, the Procuring Agency/Engineer shall issue a Maintenance Certificate whereupon all obligations of the Contractor under this Contract shall come to an end.

Failure to remedy any such defects or complete outstanding work within a reasonable time shall entitle the Procuring Agency to carry out all necessary works at the Contractor's cost. However, the cost of remedying defects not attributable to the Contractor shall be valued as a Variation.

### **9.2 Uncovering and Testing**

The Engineer/Procuring Agency may give instruction as to the uncovering and/or testing of any work. Unless as a result of an uncovering and/or testing it is established that the Contractor's design, materials, plant or workmanship are not in accordance with the Contract, the Contractor shall be paid for such uncovering and/or testing as a Variation in accordance with Sub-Clause 10.2.

## **10. VARIATIONS AND CLAIMS**

### **10.1 Right to Vary**

The Procuring Agency/Engineer may issue Variation Order(s) in writing. Where for any reason it has not been possible for the Procuring Agency/Engineer to issue such Variations Order(s), the Contractor may confirm any verbal orders given by the Procuring Agency/Engineer in writing and if the same are not refuted/denied by the Procuring Agency/Engineer within ten (10) days of the receipt of such confirmation the same shall be deemed to be a Variation Orders for the purposes of this Sub-Clause.

## 10.2 Valuation of Variations

Variations shall be valued as follows:

- a) at a lump sum price agreed between the Parties, or
- b) where appropriate, at rates in the Contract, or
- c) in the absence of appropriate rates, the rates in the Contract shall be used as the basis for valuation, or failing which
- d) at appropriate new rates, as may be agreed or which the Engineer/Procuring Agency considers appropriate, or
- e) if the Engineer/Procuring Agency so instructs, at day work rates set out in the Contract Data for which the Contractor shall keep records of hours of labour and Contractor's Equipment, and of Materials, used.

## 10.3 Changes in the Quantities.

- a) If the final quantity of the work done differs from the quantity in the Bill of Quantities for the particular item by more than 25 percent, provided the change exceeds 1 percent of the Initial Contract Price, the Procuring Agency/Engineer shall adjust the rate to allow for the change and will be valued as per sub clause 10.2.
- b) The Engineer shall not adjust rates from changes in quantities if thereby the Initial Contract Price is exceeded by more than 15 percent, except with the prior approval of the Procuring Agency.
- c) If requested by the Engineer, the contractor shall provide the Engineer with a detailed cost breakdown of any rate in the Bill of Quantities.

## 10.4 Early Warning

The Contractor shall notify the Engineer/Procuring Agency in writing as soon as he is aware of any circumstance which may delay or disrupt the Works, or which may give rise to a claim for additional payment.

To the extent of the Contractor's failure to notify, which results to the Engineer/Procuring Agency being unable to keep all relevant records or not taking steps to minimise any delay, disruption, or Cost, or the value of any Variation, the Contractor's entitlement to extension of the Time for Completion or additional payment shall be reduced/rejected.

## 10.5 Valuation of Claims

If the Contractor incurs Cost as a result of any of the Procuring Agency's Risks, the Contractor shall be entitled to the amount of such Cost. If as a result of any



Procuring Agency's Risk, it is necessary to change the Works, this shall be dealt with as a Variation subject to Contractor's notification for intention of claim to the Engineer/Procuring Agency within fourteen (14) days of the occurrence of cause.

**10.6 Variation and Claim Procedure**

The Contractor shall submit to the Engineer/Procuring Agency an itemised detailed breakdown of the value of variations and claims within twenty eight (28) days of the instruction or of the event giving rise to the claim. The Engineer/Procuring Agency shall check and if possible agree the value. In the absence of agreement, the Procuring Agency shall determine the value.

**11. CONTRACT PRICE AND PAYMENT**

**11.1 (a) Terms of Payments**

The amount due to the Contractor under any Interim Payment Certificate issued by the Engineer pursuant to this Clause, or to any other terms of the Contract, shall, subject to Clause 11.3, be paid by the Procuring Agency to the Contractor within 30 days after such Interim Payment Certificate has been jointly verified by Procuring Agency and Contractor, or, in the case of the Final Certificate referred to in Sub Clause 11.5, within 60 days after such Final Payment Certificate has been jointly verified by Procuring Agency and Contractor;

Provided that the Interim Payment shall be caused in thirty (30) days and Final Payment in 60 days in case of foreign funded project. In the event of the failure of the Procuring Agency to make payment within 90 days then Procuring Agency shall pay to the Contractor compensation at the 28 days rate of KIBOR+2% per annum in local currency and LIBOR+1% for foreign currency, upon all sums unpaid from the date by which the same should have been paid.

**(b) Valuation of the Works**

The Works shall be valued as provided for in the Contract Data, subject to Clause 10.

**11.2 Monthly Statements**

The Contractor shall be entitled to be paid at monthly intervals:

- a) the value of the Works executed less to the cumulative amount paid previously; and
- b) value of secured advance on the materials and valuation of variations (if any).

The Contractor shall submit each month to the Engineer/Procuring Agency a statement showing the amounts to which he considers himself entitled.



### **11.3 Interim Payments**

Within a period not exceeding seven (07) days from the date of submission of a statement for interim payment by the Contractor, the Engineer shall verify the same and within a period not exceeding thirty (30/60) days from the said date of submission by the Contractor, the Procuring Agency shall pay to the Contractor the sum subject to adjustment for deduction of the advance payments and retention money.

### **11.4 Retention**

Retention money shall be paid by the Procuring Agency to the Contractor within fourteen (14) days after either the expiry of the period stated in the Contract Data, or the remedying of notified defects, or the completion of outstanding work, all as referred to in Sub-Clause 9.1, whichever is the later.

### **11.5 Final Payment**

Within twenty one (21) days from the date of issuance of the Maintenance Certificate the Contractor shall submit a final account to the Engineer to verify and the Engineer shall verify the same within fourteen (14) days from the date of submission and forward the same to the Procuring Agency together with any documentation reasonably required to enable the Procuring Agency to ascertain the final contract value.

Within sixty (60) days from the date of receipt of the verified final account from the Engineer, the Procuring Agency shall pay to the Contractor any amount due to the Contractor. While making such payment the Procuring Agency may, for reasons to be given to the Contractor in writing, withhold any part or parts of the verified amount.

### **11.6 Currency**

Payment shall be in the currency stated in the Contract Data.

## **12. DEFAULT**

### **12.1 Defaults by Contractor**

If the Contractor abandons the Works, refuses or fails to comply with a valid instruction of the Engineer/Procuring Agency or fails to proceed expeditiously and without delay, or is, despite a written complaint, in breach of the Contract, the Procuring Agency may give notice referring to this Sub-Clause and stating the default.

If the Contractor has not taken all practicable steps to remedy the default within fourteen (14) days after receipt of the Procuring Agency's notice, the Procuring Agency may by a second notice given within a further twenty one (21) days, terminate the Contract. The Contractor shall then demobilize from the Site leaving behind any Contractor's Equipment which the Procuring Agency instructs, in the second notice, to be used for the completion of the Works at the risk and cost of the Contractor.

## **12.2 Defaults by Procuring Agency**

If the Procuring Agency fails to pay in accordance with the Contract, or is, despite a written complaint, in breach of the Contract, the Contractor may give notice referring to this Sub-Clause and stating the default. If the default is not remedied within fourteen (14) days after the Procuring Agency's receipt of this notice, the Contractor may suspend the execution of all or parts of the Works.

If the default is not remedied within twenty eight (28) days after the Procuring Agency's receipt of the Contractor's notice, the Contractor may by a second notice given within a further twenty one (21) days, terminate the Contract. The Contractor shall then demobilise from the Site.

## **12.3 Insolvency**

If a Party is declared insolvent under any applicable law, the other Party may by notice terminate the Contract immediately. The Contractor shall then demobilise from the site leaving behind, in the case of the Contractor's insolvency, any Contractor's Equipment which the Procuring Agency instructs in the notice is to be used for the completion of the Works.

## **12.4 Payment upon Termination**

After termination, the Contractor shall be entitled to payment of the unpaid balance of the value of the works executed and of the Materials and Plant reasonably delivered to the site, adjusted by the following:

- a) any sums to which the Contractor is entitled under Sub-Clause 10.4,
- b) any sums to which the Procuring Agency is entitled,
- c) if the Procuring Agency has terminated under Sub-Clause 12.1 or 12.3, the Procuring Agency shall be entitled to a sum equivalent to twenty percent (20%) of the value of parts of the Works not executed at the date of the termination, and
- d) if the Contractor has terminated under Sub-Clause 12.2 or 12.3, the Contractor shall be entitled to the cost of his demobilisation together with a sum equivalent to ten percent (10%) of the value of parts of the works not executed at the date of termination.

The net balance due shall be paid or repaid within twenty eight (28) days of the notice of termination.

## **13. RISKS AND RESPONSIBILITIES**

### **13.1 Contractor's Care of the Works**

Subject to Sub-Clause 9.1, the Contractor shall take full responsibility for the care



of the Works from the Commencement Date until the date of the Procuring Agency's/Engineer's issuance of Certificate of Completion under Sub-Clause 8.2. Responsibility shall then pass to the Procuring Agency. If any loss or damage happens to the Works during the above period, the Contractor shall rectify such loss or damage so that the Works conform with the Contract.

Unless the loss or damage happens as a result of any of the Procuring Agency's Risks, the Contractor shall indemnify the Procuring Agency, or his agents against all claims loss, damage and expense arising out of the Works.

## **13.2 Force Majeure**

If Force Majeure occurs, the Contractor shall notify the Engineer/Procuring Agency immediately. If necessary, the Contractor may suspend the execution of the Works and, to the extent agreed with the Procuring Agency demobilize the Contractor's Equipment.

If the event continues for a period of eighty four (84) days, either Party may then give notice of termination which shall take effect twenty eight (28) days after the giving of the notice.

After termination, the Contractor shall be entitled to payment of the unpaid balance of the value of the Works executed and of the Materials and Plant reasonably delivered to the Site, adjusted by the following:

- a) any sums to which the Contractor is entitled under Sub-Clause 10.4,
- b) the cost of his demobilization, and
- c) less any sums to which the Procuring Agency is entitled.

The net balance due shall be paid or repaid within thirty five (35) days of the notice of termination.

## **14. INSURANCE**

### **14.1 Arrangements**

The Contractor shall, prior to commencing the Works, effect insurances of the types, in the amounts and naming as insured the persons stipulated in the Contract Data except for items (a) to (e) and (i) of the Procuring Agency's Risks under Sub-Clause 6.1. The policies shall be issued by insurers and in terms approved by the Procuring Agency. The Contractor shall provide the Engineer/Procuring Agency with evidence that any required policy is in force and that the premiums have been paid.

### **14.2 Default**

If the Contractor fails to effect or keep in force any of the insurances referred to in the previous Sub-Clause, or fails to provide satisfactory evidence, policies or receipts, the Procuring Agency may, without prejudice to any other right or



remedy, effect insurance for the cover relevant to such as a default and pay the premiums due and recover the same plus a sum in percentage given in Contractor Data from any other amounts due to the Contractor.

## **15. RESOLUTION OF DISPUTES**

### **15.1 Engineer's Decision**

If a dispute of any kind whatsoever arises between the Procuring Agency and the Contractor in connection with the works, the matter in dispute shall, in the first place, be referred in writing to the Engineer, with a copy to the other party. Such reference shall state that it is made pursuant to this Clause. No later than the twenty eight (28) days after the day on which he received such reference, the Engineer shall give notice of his decision to the Procuring Agency (Superintending Engineer) and the Contractor.

Unless the Contract has already been repudiated or terminated, the Contractor shall, in every case, continue to proceed with the work with all due diligence, and the Contractor and the Procuring Agency (Superintending Engineer) shall give effect forthwith to every such decision of the Engineer unless and until the same shall be revised, as hereinafter provided in an arbitral award.

### **15.2 Notice of Dissatisfaction**

If a Party is dissatisfied with the decision of the Engineer of consultant or if no decision is given within the time set out in Sub-Clause 15.1 here above, the Party may give notice of dissatisfaction referring to this Sub-Clause within fourteen (14) days of receipt of the decision or the expiry of the time for the decision. If no notice of dissatisfaction is given within the specified time, the decision shall be final and binding on the Parties. If notice of dissatisfaction is given within the specified time, the decision shall be binding on the Parties who shall give effect to it without delay unless and until the decision of the Engineer is revised by an arbitrator.

If a contractor is dissatisfied with the decision of the Engineer of the department or decision is not given in time then he can approach Superintending Engineer within 14 days, in case of dissatisfaction with decision of Superintending Engineer or not decided within 28 days, then arbitration process would be adopted as per clause 15.3.

### **15.3 Arbitration**

A dispute which has been the subject of a notice of dissatisfaction shall be finally settled as per provisions of Arbitration Act 1940 (Act No. X of 1940) and Rules made there under and any statutory modifications thereto. Any hearing shall be held at the place specified in the Contract Data and in the language referred to in Sub-Clause 1.5.



## 16 INTEGRITY PACT

16.1 If the Contractor or any of his Sub-Contractors, agents or servants is found to have violated or involved in violation of the Integrity Pact signed by the Contractor as Schedule-F to his Bid, then the Procuring Agency shall be entitled to:

- (a) recover from the Contractor an amount equivalent to ten times the sum of any commission, gratification, bribe, finder's fee or kickback given by the Contractor or any of his Sub-Contractors, agents or servants;
- (b) terminate the Contract; and
- (c) recover from the Contractor any loss or damage to the Procuring Agency as a result of such termination or of any other corrupt business practices of the Contractor or any of his Sub-Contractors, agents or servants.

On termination of the Contract under Sub-Para (b) of this Sub-Clause, the Contractor shall demobilize from the site leaving behind Contractor's Equipment which the Procuring Agency instructs, in the termination notice, to be used for the completion of the works at the risk and cost of the Contractor. Payment upon such termination shall be made under Sub-Clause 12.4, in accordance with Sub-Para (c) thereof, after having deducted the amounts due to the Procuring Agency under Sub-Para (a) and (c) of this Sub-Clause.

## CONTRACT DATA

### Sub-Clauses of Conditions of Contract

#### 1.1.3 Procuring Agency's Drawings: Attached Separately

1.1.4 **The Procuring Agency** means— the person or entity named in the Contract Data and the legal successors in title to this person, but not (except with the consent of the Contractor) any assignee. Here P/A is Mehran University of Engineering & Technology Jamshoro

1.1.5 **The Contractor** means a firm which is employed by the P/A. A contractor is responsible for providing all of the material, labor, equipment and services necessary for the construction of the project.

1.1.7 **Commencement Date** means the date of issue of Engineer's Notice/Work Order to Commence which shall be issued within fourteen (14) days of the signing of the Contract Agreement.

#### 1.1.9 Time of Completion 12 Months

#### 1.1.20 Engineer

##### **KAD Consultants** **Electrical Engineers**

F-1, Zaib Residency, 70/72/1 Hussain Housing Scheme,  
Near Summit Bank WadhuWah, Qasimabad Hyderabad  
Ph# +92-22-2652274  
Fax# +92-22-2652275  
E-Mail: [kad.consultants@hotmail.com](mailto:kad.consultants@hotmail.com)

#### 1.3 Documents forming the Contract listed in the order of priority:

- (a) The Contract Agreement
- (b) Letter of Acceptance
- (c) The completed Form of Bid
- (d) Contract Data
- (e) Conditions of Contract
- (f) Bill of Quantities (BOQ)
- (g) The Drawings
- (h) The Specifications
- (i) Special Conditions of Contract



**2.1 Provision of Site:** On the Commencement Date

**3.1 Authorized person:** Executive Engineer (Works), MUET, Jamshoro

**3.2 Name and address of Engineer's/Procuring Agency's representative:**

Office of the Executive Engineer, Mehran University of Engineering & Technology, Jamshoro.

**4.4 Performance Security:**

Contractor to submit performance insurance guarantee equal to 10% of contract amount from any of following insurance companies in the specified form. No mobilization shall be paid until contractor has signed the agreement and submitted performance guarantee.

- a) *EFU General Insurance Limited.*
- b) *Adamjee Insurance Company Limited.*
- c) *National Insurance Corporation Limited.*
- d) *Pakistan General Insurance Company limited.*

**5.1 Requirements for Contractor's design (if any):** Contractor to confirm design of all cables/equipments.

**7.2 Programme:**

**Time for submission:** Within fourteen (14) days of the Commencement Date.

**Form of programme:** *Bar Chart / CPM/PERT*

**7.4** Amount payable due to failure to complete shall be 0.05% per day up to a maximum of (10%) of sum stated in the Letter of Acceptance

**7.5 Early Completion (Not Applicable)**

In case of earlier completion of the Work, the Contractor is entitled to be paid bonus up to limit and at a rate equivalent to 50% of the relevant limit and rate of liquidated damages stated in the contract data.

**9.1 Period for remedying defects (Defects Liability Period):** \_\_\_\_\_

**10.2 (e) Variation procedures: (Not Applicable)**

Day work rates \_\_\_\_\_  
\_\_\_\_\_ (details)

**11.1 Terms of Payments**

**a) Mobilization Advance**

- (1) Mobilization Advance up to 10% of the Contract Price stated in the Letter of Acceptance shall be paid by the Procuring Agency to the Contractor on the works costing Rs.2.5 million or above on following conditions:

(i) On submission by the Contractor of a Mobilization Advance Guarantee for the full amount of the Advance in the specified form from a Scheduled Bank in Pakistan to the Procuring Agency;

(ii) Contractor will pay interest on the mobilization advance at the rate of 10% per annum on the advance; and

(iii) This Advance including the interest shall be recovered in 5 equal installments from the five (05) R.A bills and in case the number of bills is less than five (05) then 1/5th of the advance **inclusive of the interest** thereon shall be recovered from each bill and the balance together with interest be recovered from the final bill. It may be insured that there is sufficient amount in the final bill to enable recovery of the Mobilization Advance.

## **2) Secured Advance on Materials**

(a) The Contractor shall be entitled to receive from the Procuring Agency Secured Advance against an INDENTURE BOND in P W Account Form No. 31(Fin.R. Form No. 2 acceptable to the Procuring Agency of such sum as the Engineer may consider proper in respect of non-perishable materials brought at the Site but not yet incorporated in the Permanent Works provided that:

(i) The materials are in accordance with the Specifications for the Permanent Works;

(i) Such materials have been delivered to the Site and are properly stored and protected against loss or damage or deterioration to the satisfaction and verification of the Engineer but at the risk and cost of the Contractor;

(ii) The Contractor's records of the requirements, orders, receipts and use of materials are kept in a form approved by the Engineer, and such records shall be available for inspection by the Engineer;

(iii) The Contractor shall submit with his monthly statement the estimated value of the materials on Site together with such documents as may be required by the Engineer for the purpose of valuation of materials and providing evidence of ownership and payment therefore;

(iv) Ownership of such materials shall be deemed to vest in the Procuring Agency and these materials shall not be removed from the Site or otherwise disposed of without written permission of the Procuring Agency;

(v) The sum payable for such materials on Site shall not exceed 75 % of the:

- a. landed cost of imported materials, or
- b. ex-factory / ex-warehouse price of locally manufactured or produced materials, or
- c. market price of stands other materials.



- (vii) Secured Advance should not be allowed unless & until the previous advance, if any, fully recovered
- (viii) Detailed account of advances must be kept in part II of running account bill and
- (ix) Secured Advance may be permitted only against materials/quantities anticipated to be consumed / utilized on the work within a period of 3 months from the date of issue of secured advance and definitely not for full quantities of materials for the entire work/contract

(b) Recovery of Secured Advance:

- (i) Secured Advance paid to the Contractor under the above provisions shall be effected from the monthly payments on actual consumption basis, but not later than period specified in the rules not more than three months (even if unutilized); other conditions.
- (ii) As recoveries are made the outstanding accounts of the items concerned in Part II should be reduced by making deduction entries in the column; —deduct quantity utilized in work measured since previous bill, equivalent to the quantities of materials used by the contractor on items of work shown as executed in part I of the bill.

(c) Interim payments: The Contractor shall submit to the Engineer monthly statements of the estimated value of the work completed less the cumulative amount certified previously.

- (i) The value of work completed comprises the value of the quantities of the items in the Bill of Quantities completed.
- (ii) Value of secured advance on the materials and valuation of variations (if any).
- (iii) Engineer may exclude any item certified in a previous certificate or reduce the proportion of any item previously certified in any certificate in the light of later information.
- (v) Retention money and other advances are to be recovered from the bill submitted by contractor.

**11.2 \*(a) Valuation of the Works:**

Measurement of executed quantities at quoted rates.

**11.3 Percentage of retention:** Ten percent (10%), which also includes two percent (2%) bid security.

**11.6 Currency of payment:** Pak Rupees

**14.1 Insurances: (Not Applicable)**

**Type of cover**

The works

**Amount of cover**

The sum stated in the letter of acceptance plus fifteen percent

**Type of cover**

Contractor's equipment

**Amount of cover**

Full replacement cost

**Type of cover**

Third party injury to persons and damage of property

**Workers:**

**Other cover:**

**14.2 Amount to be recovered (not applicable)**

Premium plus \_\_\_\_\_ percent (%)

**15.3 Arbitration**

Place of Arbitration MUET, Jamshoro.



## STANDARD FORMS

*(Note: Standard Forms provided in this document for securities are to be issued by a bank. In case the bidder chooses to issue a bond for accompanying his bid or performance of contract or receipt of advance, the relevant format shall be tailored accordingly without changing the spirit of the Forms of securities).*

**FORM OF BID SECURITY**  
(Bank Guarantee)

Guarantee No. \_\_\_\_\_  
Executed on \_\_\_\_\_

(Letter by the Guarantor to the Procuring Agency)

Name of Guarantor (Scheduled Bank in Pakistan) with  
address: \_\_\_\_\_

Name of Principal (Bidder) with  
address: \_\_\_\_\_

Sum of Security (express in words and  
figures): \_\_\_\_\_

Bid Reference No. \_\_\_\_\_ Date of Bid \_\_\_\_\_

KNOW ALL MEN BY THESE PRESENTS, that in pursuance of the terms of the Bid and at the request of the said Principal, we the Guarantor above-named are held and firmly bound unto the \_\_\_\_\_, (hereinafter called The "Procuring Agency") in the sum stated above, for the payment of which sum well and truly to be made, we bind ourselves, our heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION IS SUCH, that whereas the Principal has submitted the accompanying Bid numbered and dated as above for \_\_\_\_\_ (Particulars of Bid) to the said Procuring Agency; and

WHEREAS, the Procuring Agency has required as a condition for considering the said Bid that the Principal furnishes a Bid Security in the above said sum to the Procuring Agency, conditioned as under:

- (1) that the Bid Security shall remain valid for a period of twenty eight (28) days beyond the period of validity of the bid;
- (2) that in the event of;
  - (a) the Principal withdraws his Bid during the period of validity of Bid, or
  - (b) the Principal does not accept the correction of his Bid Price, pursuant to Sub-Clause 16.4 (b) of Instructions to Bidders, or
  - (c) failure of the successful bidder to
    - (i) furnish the required Performance Security, in accordance with Sub-Clause IB-21.1 of Instructions to Bidders, or
    - (ii) sign the proposed Contract Agreement, in accordance with Sub-Clauses IB-20.2 & 20.3 of Instructions to Bidders,



the entire sum be paid immediately to the said Procuring Agency for delayed completion and not as penalty for the successful bidder's failure to perform.

NOW THEREFORE, if the successful bidder shall, within the period specified therefore, on the prescribed form presented to him for signature enter into a formal Contract Agreement with the said Procuring Agency in accordance with his Bid as accepted and furnish within fourteen (14) days of receipt of Letter of Acceptance, a Performance Security with good and sufficient surety, as may be required, upon the form prescribed by the said Procuring Agency for the faithful performance and proper fulfilment of the said Contract or in the event of non-withdrawal of the said Bid within the time specified then this obligation shall be void and of no effect, but otherwise to remain in full force and effect.

PROVIDED THAT the Guarantor shall forthwith pay to the Procuring Agency the said sum stated above upon first written demand of the Procuring Agency without cavil or argument and without requiring the Procuring Agency to prove or to show grounds or reasons for such demand, notice of which shall be sent by the Procuring Agency by registered post duly addressed to the Guarantor at its address given above.

PROVIDED ALSO THAT the Procuring Agency shall be the sole and final judge for deciding whether the Principal has duly performed his obligations to sign the Contract Agreement and to furnish the requisite Performance Security within the time stated above, or has defaulted in fulfilling said requirements and the Guarantor shall pay without objection the sum stated above upon first written demand from the Procuring Agency forthwith and without any reference to the Principal or any other person.

IN WITNESS WHEREOF, the above bounded Guarantor has executed the instrument under its seal on the date indicated above, the name and seal of the Guarantor being hereto affixed and these presents duly signed by its undersigned representative pursuant to authority of its governing body.

\_\_\_\_\_  
Guarantor (Bank)

Witness:

1. Signature \_\_\_\_\_

1. \_\_\_\_\_

2. Name \_\_\_\_\_

\_\_\_\_\_  
Corporate Secretary (Seal)

3. Title \_\_\_\_\_

2. \_\_\_\_\_

\_\_\_\_\_  
(Name, Title & Address)

\_\_\_\_\_  
Corporate Guarantor (Seal)

**FORM OF PERFORMANCE SECURITY  
(Bank Guarantee)**

Guarantee No. \_\_\_\_\_  
Executed on \_\_\_\_\_  
Expiry Date \_\_\_\_\_

(Letter by the Guarantor to the Procuring Agency)

Name of Guarantor (Scheduled Bank in Pakistan) with

address: \_\_\_\_\_

Name of Principal (Contractor) with

address: \_\_\_\_\_

Penal Sum of Security (express in words and  
figures) \_\_\_\_\_

Letter of Acceptance No. \_\_\_\_\_ Dated \_\_\_\_\_

KNOW ALL MEN BY THESE PRESENTS, that in pursuance of the terms of the Bidding Documents and above said Letter of Acceptance (hereinafter called the Documents) and at the request of the said Principal we, the Guarantor above named, are held and firmly bound unto the \_\_\_\_\_ (hereinafter called the Procuring Agency) in the penal sum of the amount stated above, for the payment of which sum well and truly to be made to the said Procuring Agency, we bind ourselves, our heirs, executors, administrators and successors, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION IS SUCH, that whereas the Principal has accepted the Procuring Agency's above said Letter of Acceptance for \_\_\_\_\_ (Name of Contract) for the \_\_\_\_\_ (Name of Project).

NOW THEREFORE, if the Principal (Contractor) shall well and truly perform and fulfill all the undertakings, covenants, terms and conditions of the said Documents during the original terms of the said Documents and any extensions thereof that may be granted by the Procuring Agency, with or without notice to the Guarantor, which notice is, hereby, waived and shall also well and truly perform and fulfill all the undertakings, covenants terms and conditions of the Contract and of any and all modifications of the said Documents that may hereafter be made, notice of which modifications to the Guarantor being hereby waived, then, this obligation to be void; otherwise to remain in full force and virtue till all requirements of Clause 9, Remedying Defects, of Conditions of Contract are fulfilled.

Our total liability under this Guarantee is limited to the sum stated above and it is a condition of any liability attaching to us under this Guarantee that the claim for payment in writing shall



be received by us within the validity period of this Guarantee, failing which we shall be discharged of our liability, if any, under this Guarantee.

We, \_\_\_\_\_ (the Guarantor), waiving all objections and defenses under the Contract, do hereby irrevocably and independently guarantee to pay to the Procuring Agency without delay upon the Procuring Agency's first written demand without cavil or arguments and without requiring the Procuring Agency to prove or to show grounds or reasons for such demand any sum or sums up to the amount stated above, against the Procuring Agency's written declaration that the Principal has refused or failed to perform the obligations under the Contract, for which payment will be effected by the Guarantor to Procuring Agency's designated Bank & Account Number.

PROVIDED ALSO THAT the Procuring Agency shall be the sole and final judge for deciding whether the Principal (Contractor) has duly performed his obligations under the Contract or has defaulted in fulfilling said obligations and the Guarantor shall pay without objection any sum or sums up to the amount stated above upon first written demand from the Procuring Agency forthwith and without any reference to the Principal or any other person.

IN WITNESS WHEREOF, the above bounded Guarantor has executed this Instrument under its seal on the date indicated above, the name and corporate seal of the Guarantor being hereto affixed and these presents duly signed by its undersigned representative, pursuant to authority of its governing body.

Witness:

1. \_\_\_\_\_

\_\_\_\_\_  
Corporate Secretary (Seal)

2. \_\_\_\_\_

\_\_\_\_\_  
(Name, Title & Address)

\_\_\_\_\_  
Guarantor (Bank)

1. Signature \_\_\_\_\_

2. Name \_\_\_\_\_

3. Title \_\_\_\_\_

\_\_\_\_\_  
Corporate Guarantor (Seal)

## FORM OF CONTRACT AGREEMENT

THIS CONTRACT AGREEMENT (hereinafter called the "Agreement") made on the \_\_\_\_\_ day of \_\_\_\_\_ 200 \_\_\_\_\_ between \_\_\_\_\_ (hereinafter called the "Procuring Agency") of the one part and \_\_\_\_\_ (hereinafter called the "Contractor") of the other part.

WHEREAS the Procuring Agency is desirous that certain Works, viz \_\_\_\_\_ should be executed by the Contractor and has accepted a Bid by the Contractor for the execution and completion of such Works and the remedying of any defects therein.

NOW this Agreement witnesseth as follows:

1. In this Agreement words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract hereinafter referred to.
2. The following documents after incorporating addenda, if any except those parts relating to Instructions to Bidders, shall be deemed to form and be read and construed as part of this Agreement, viz:
  - (a) The Letter of Acceptance;
  - (b) The completed Form of Bid along with Schedules to Bid;
  - (c) Conditions of Contract & Contract Data;
  - (d) The priced Schedule of Prices/Bill of quantities (BoQ);
  - (e) The Specifications; and
  - (f) The Drawings
3. In consideration of the payments to be made by the Procuring Agency to the Contractor as hereinafter mentioned, the Contractor hereby covenants with the Procuring Agency to execute and complete the Works and remedy defects therein in conformity and in all respects within the provisions of the Contract.
4. The Procuring Agency hereby covenants to pay the Contractor, in consideration of the execution and completion of the Works as per provisions of the Contract, the Contract Price or such other sum as may become payable under the provisions of the Contract at the times and in the manner prescribed by the Contract.



IN WITNESS WHEREOF the parties hereto have caused this Contract Agreement to be executed on the day, month and year first before written in accordance with their respective laws.

Signature of the Contactor

\_\_\_\_\_  
(Seal)

Signature of the Procuring Agency

\_\_\_\_\_  
(Seal)

Signed, Sealed and Delivered in the presence of:

Witness:

\_\_\_\_\_

(Name, Title and Address)

Witness:

\_\_\_\_\_

(Name, Title and Address)

## MOBILIZATION ADVANCE GUARANTEE

Guarantee No. \_\_\_\_\_

Executed on \_\_\_\_\_

(Letter by the Guarantor to the Procuring Agency)

WHEREAS the \_\_\_\_\_ (hereinafter called the Procuring Agency) has entered into a Contract for

\_\_\_\_\_

\_\_\_\_\_ (Particulars of Contract), with

\_\_\_\_\_

\_\_\_\_\_ (hereinafter called the Contractor).

AND WHEREAS the Procuring Agency has agreed to advance to the Contractor, at the Contractor's request, an amount of Rs. \_\_\_\_\_ Rupees \_\_\_\_\_) which amount shall be advanced to the Contractor as per provisions of the Contract.

AND WHEREAS the Procuring Agency has asked the Contractor to furnish Guarantee to secure the advance payment for the performance of his obligations under the said Contract.

AND WHEREAS \_\_\_\_\_ (Scheduled Bank) (hereinafter called the Guarantor) at the request of the Contractor and in consideration of the Procuring Agency agreeing to make the above advance to the Contractor, has agreed to furnish the said Guarantee.

NOW THEREFORE the Guarantor hereby guarantees that the Contractor shall use the advance for the purpose of above mentioned Contract and if he fails, and commits default in fulfillment of any of his obligations for which the advance payment is made, the Guarantor shall be liable to the Procuring Agency for payment not exceeding the aforementioned amount.

Notice in writing of any default, of which the Procuring Agency shall be the sole and final judge, as aforesaid, on the part of the Contractor, shall be given by the Procuring Agency to the Guarantor, and on such first written demand payment shall be made by the Guarantor of all sums then due under this Guarantee without any reference to the Contractor and without any objection.



This Guarantee shall come into force as soon as the advance payment has been credited to the account of the Contractor.

This Guarantee shall expire not later than \_\_\_\_\_  
by which date we must have received any claims by registered letter, telegram, telex or telefax.

It is understood that you will return this Guarantee to us on expiry or after settlement of the total amount to be claimed hereunder.

\_\_\_\_\_  
Guarantor (Scheduled Bank)

Witness:

1. \_\_\_\_\_

\_\_\_\_\_  
Corporate Secretary (Seal)

2. \_\_\_\_\_

\_\_\_\_\_  
(Name, Title & Address)

1. Signature \_\_\_\_\_

2. Name \_\_\_\_\_

3. Title \_\_\_\_\_

\_\_\_\_\_  
Corporate Guarantor (Seal)

## INDENTURE FOR SECURED ADVANCES.

(For use in cases in which is contract is for finished work and the contractor has entered into an agreement for the execution of a certain specified quantity of work in a given time ).

This INDENTURE made the ..... day of .....  
-----197--" BETWEEN (hereinafter called "the Contractor" which expression shall where the context so admits or implied be deemed to include his heirs, executors, administrators and assigns) of the one part and THE GOVERNOR OF SINDH (hereinafter called "the Government" of the other part).

WHEREAS by an agreement, dated ..... (hereinafter called the said agreement, the contractor has agreed to perform the under-mentioned works (hereinafter referred to as the said work):-

(Here enter (the description of the works).<sup>1</sup>

AND WHEREAS the contractor has applied to the .....  
—..... for an advance to him of Rupees .....  
(Rs. ....) on the security of materials absolutely belonging to him and brought by him to the site of the said works the subject of the said agreement for use in the construction of such of the said works as he has undertaken to execute at rates fixed for the finished work (inclusive of the cost of materials and labour and other charge) AND WHEREAS the Government has agreed to advance to the Contractor the sum of Rupees, (Rs. ....) on the security of materials the quantities and other particulars of which are detailed in Part II of Running Account Bill (E). the said works signed by the contractor  
Fin R.Form.17.A  
on----- and on such covenants and conditions as are hereinafter contained and the Government has reserved to itself the option of marking any further advance or advances on the security of other materials brought by the Contractor to the site of the said works.

NOW THIS INDENTURE WTTNESSETH that in pursuance of the said agreement and in consideration of the sum of Rupees.....  
(Rs. ....) on or before the execution of these presents paid to the Contractor by the Government (the receipt whereof the Contractor doth hereby acknowledge) and of such further advances (if any) as may be made to him as aforesaid (all of which advances are hereinafter collectively referred to as the said amount) the Contractor doth hereby assign unto the Government the said materials by way of security for the said amount

And doth hereby covenant and agree with the Government and declare ay follow :-

(1) That the said sum of Rupees .....  
(Rs. ....) so advanced by the Government to the Contractor as aforesaid and all or any further sum or sums which may be advanced aforesaid shall be employed by the contractor in or towards expending the execution of the said works and for no other purpose whatsoever.



- (2) That the materials detailed in the said Running Account Bill (B) which have been

Fin R Form No. 17-A

Offered to and accepted by (he Government as security for the said amount are absolutely by the Contractors own property free from encumbrances of any kind and the Contractor will not make any application for or receive a further advance on the security of materials which are not absolutely his own property and free from encumbrances of any kind and the contractor hereby agrees, at all times, to indemnify and save harmless the Government against all claims whatsoever to any materials in respect of which an advance has been made to him as aforesaid.

- (3) That the said materials detailed in the said Running Account Bill (B) and all other

Fin. R. Form No. 17-A

Materials on the security of which any further advance or advances may hereafter be made as aforesaid (hereinafter called the said materials) shall be used by the Contractor solely in the execution of the said works in accordance with the directions of the Divisional Officer----- (hereinafter called the Divisional Officer) and in the terms of the said agreement.

(4) That the Contractor shall make at his own cost all necessary and adequate arrangement for the proper watch, safe custody and protection against all risks of the said material and that until used in construction as aforesaid the said materials shall remain at the site of the said works in the Contractor's custody and at his own risk and on his own responsibility and shall at all times be open to inspection by (he Divisional Officer or any officer authorized by him. In the event of the said materials of any part (hereof being stolen, destroyed or damaged or becoming deteriorated in a grater degree than is due to reasonable use and wear thereof Contractor will forthwith replace the same with other materials of like qualify or repair and make good the same as required by the Divisional Officer and the materials so brought to replace the said materials so repaired and made good shall also be considered as security for the said amount.

(5) 'Hurt the said materials shall not on any account be removed from the site of the said works except with the written permission of the Divisional Officer or an officer authorized by him in that behalf

(6) That the said amount shall be payable in full when or before the Contractor receives payment, from the Government of the price payable to him for the said works under the terms and provisions of the said agreement PROVIDED THAT if any intermediate payments are made to the contractor on account of work done then on the occasion of each such payment the Government will be at liberty to make a recovery from the Contractors Bill for such payment by deducting there from in the value of the said materials (hen actually used in the construction and in respect of which recovery has not been made previously the value for this purpose being determined in respect of each description of material at (he rates at which the amount of the advances made under these presents were calculated.

(7) That if the Contractor shall at any time make any default in the performance or observation in any respect of any of the terms and provisions of the said agreement or of these presents the total amount of the advance or advances that may still be owing to the Government shall immediately on the happening of such default be repayable by the Contractor to the Government together with interest thereon at twelve



percent per annum from the date or respective dates of such advance or advances to the date or repayment and with all costs, charges, damages and expenses incurred by the Government in or for the recovery thereof or the enforcement of this security or otherwise by reason of (he default of the Contractor and any moneys so becoming due and payable shall constitute a debt due from the Contractor to the Government and the Contractor hereby covenants and agrees with the Government to repay and the same respectively to it accordingly.

(8) That the Contractor hereby charges all the said materials with the repayment to the Government of the said sum of Rupees ..... - ..... (Rs..... ) and any further sum or sums which may be advanced as aforesaid and all costs charges damages and expenses payable under these present PROVIDED ALWAYS and it is hereby agreed and declared that notwithstanding anything in the said agreement and without prejudice to the powers contained therein if and whether the covenant for payment and repayment hereinbefore contained shall become enforceable and the money owing shall not be paid to accordingly.

Once therewith the Government may at any time thereafter adopt all or any of following courses as it may deem best :-

- (a) Seize and utilize the said materials or any part thereof in the completion of the said works on behalf of the Contractor in accordance with the provisions in that behalf contained in the said agreement debiting the Contractor with the actual cost of effecting such completion the amount due in respect of advances under these presents and crediting the Contractor with the value of work done as he had carried it out in accordance with the said agreement and at the rates thereby provided. If the balance is against the Contractor he is to pay the same to the Government on demand.
- (b) Remove and sell by public auction the seized materials or any part thereof and out of the moneys arising from the sale retain all the sums aforesaid repayable to the Government under these presents and pay over the surplus (if any) to the Contractor.
- (c) Deduct all or any part of the moneys owing out of the security deposit or any sum due to the Contractor under the said agreement.

(9) That except as is expressly provided by the presents interest on the aid advance shall not be payable.

(10) That in the event of any conflict between the provisions of these presents and the said agreement the provisions of these presents shall prevail and in the event of any dispute or difference arising over the construction or effect of these presents the settlement of which has not been hereinbefore expressly provided for the same shall be referred to the Superintending Engineer..... Circle whose..... decision shall be final and the provisions of the Indian Arbitration Act for the time being in force so far as they are applicable shall apply to any such reference.



In witnesses whereof the\* ----- on behalf of the  
Governor of Sindh and the said ----- have hereunto set  
their respective hands and seals the day and first above written.

Signed, sealed and delivered by\* In  
the presence of

Seal

1st witness 2<sup>nd</sup> witness

Signed, sealed and delivered by\* In  
the presence of

Seal

1st Witness 2<sup>nd</sup> witness

## **SPECIFICATIONS FOR ELECTRICAL WORKS**

- **A-General Requirement**
- **B-Specification**
- **C-Specification of Installation**



# **SPECIFICATIONS FOR ELECTRICAL WORKS**

INDEX  
OF  
SPECIFICATIONS FOR ELECTRICAL WORKS  
A- GENERAL REQUIREMENT

Articles Description

- |    |   |
|----|---|
| 1  | Scope of contract   |
| 2  | General Requirements  |
| 3  | Electrical Equipment & Materials                                  |
| 4  | Program of Work   |
| 5  | Satisfaction of the Electrical Installations & Insurance Company. |
| 6  | Protection  |
| 7  | Building work   |
| 8  | Codes & Standards etc.  |
| 9  | Operations and Maintenance Manuals                                |
| 10 | Electrical services Connections                                   |
| 11 | Modification to comply with local standard                        |
| 12 | Record Drawings   |
| 13 | Location of Wiring Outlets  |



<u>ARTICLE</u>	<u>DESCRIPTION</u>	<u>PAGE</u>
	<b>B – SPECIFICATIONS</b>	
14.	Switches	78
15.	Socket Outlets	78
16.	Outlets Boxes	78
17.	Outlets Covers	79
18.	Lighting Fixtures	79
19.	Ceiling Fans	81
20.	Conduit and Wiring Accessories	81
21.	Low Tension Cables	82
22.	L.T. Cable Glands, Clips & Lugs.	83
23.	Distributions Panel.	83
24.	Earthing	84
25.	Voice System	86
26.	Data networking System	88

## **SPECIFICATIONS FOR ELECTRICAL WORKS**

### **A – GENERAL REQUIRMENTS**

#### **1 Scope of Contract:-**

- 1.1 The item rates of the contract shall include supply equipment and material except the equipment and material to be specifically provided by the owner, erection including all load and lift, installation, completion and testing of the individual components and finally the whole installation in accordance with the specifications and enclosed drawings. The work shall be carried out to the complete satisfaction of the Inspector.
- 1.2 For the materials listed as free issue "materials in this tender, it will be responsibility of the Contractor to take delivery of such material from the stores of the Employee supply of the necessary electrical installation including testing and commissioning.

#### **2. General Requirements:-**

- 2.1 The Contractor shall carry out all the work in accordance with this specification and in conformity with the Indian Electricity Act and Rules as adopted in Pakistan and the latest edition of the wiring Rules of the Institute of Electrical Engineers London (hereinafter referred to as the (I.E.E.) Wiring Rules) but where these specifications differ from these rules, these specifications shall be followed.
- 2.2 Any special requirements of the Electric Inspection shall be to the entire satisfaction of the Employer or The electric works shall be carried out only by Licensed Workmen authorized by the Government to Undertake such class of works under the provision of the India Electricity Act and Rules as adopted in Pakistan under the direct supervision of whole time electrical supervision and particulars of commencement of works. The works shall further be under direct supervision of whole time qualified Engineer, a Bio-data of whom shall be submitted for staff. Any conflict b/w documents shall be brought to the attention of the employer and resolved in writing before work is performed.
- 2.3 If during preparation of the Tender, the Contractor finds any points that need clarification he shall raise these with the Employer accepts no responsibility for



the failure of the Contractor to obtain clarification on any areas of uncertainty. Any installation not complying with the specification shall be corrected by the contractor with no cost to the Employer.

- 2.4 It is the Contractor's responsibility to protect equipment and materials from damage from the time of taking over Certificate is issued by the Employer after the plant has been commissioned.
- 2.5 Any deviations from these Specifications or any of the requirements of the Contract shall be clearly defined at the tender stage under Exceptions to the Contractors Specifications. Unless such exceptions are so made, the Employer will assume there are no exceptions other than those specifically included in the Employer's Construction drawings. No other exceptions will be considered after the Contract has been executed. The contractor shall produce comprehensive documents of individual testing, calibration and installation together with an overall record of the state of completion of the installation Contract which is to be submitted to the Employer at regular intervals as required.
- 2.6 If the contractor requires clarification of any point, this must be obtained from the Employer accepts no responsibility for the Contractor's failures to obtain clarification on any areas of uncertainty.
- 2.7 The Contractor requires should state his ability and willingness to comply with the enclosed Construction Program. All necessary civil and builders works shall be under taker by others except minor civil works by the Contractor.

### **3. Electrical Equipment and Materials:-**

- 3.1 Except for the items mentioned in the enclosed Free Issue list the contractor shall supply all materials, tools, plant, scoff folding, hardware, supports and fixings as necessary to provide a complete and satisfactory installation. Where any materials is the Contractor's Supply are specified on the drawings or in Bill of Quantities, the Employer. When the 'Free Issue' materials have been received by the contractor he at his own expense any missing or damage items.
- 3.2 In the event of any Free Issue items becoming surplus to requirements the Contractor shall notify the Employer who shall Issue Instructions for its disposal.
- 3.3 The Contractors will be required to collect free issue materials from the Employer's site stores.



- 3.4 Any material supplied by the Contractor shall be new and good quality, type and standard as detailed in this specification. Where equipment, materials or articles are referred to in the specifications as "equal to " any particular standard the choice and approval.

**4. Program of Works:-**

- 4.1 The Contractor shall within fifteen days after the acceptance of his tender submit in writing for approval of the Employer. Consultant a program showing the order or precedence and method in which he proposes to carry out the works.
- 4.2 The program which the contractor is required to furnish shall be such as to allow the completion of the data mentioned in the tender as required by Employer.
- 4.3 The program which the cover the full period of works from the data of the acceptance of the completion of the installation, testing and handing over of the plants and installations in working orders.
- 4.4 The program shall submitted by the contractor shall be amended if any part of it is not the satisfaction of the Employer and it shall not be carried into effect until it has been approved (in an amended form if necessary by the Employer).
- 4.5 The Contractor may at any time during the period of the contractor submit to the Employer for his approval, proposals for amending the program of the works such amendments shall not be carried out into effect unless these have been approved by the Employer.
- 4.6 If the employer requires the Contractor to amend his program of work, the contractor shall not thereby be entitled to any adjustment in contract price or to any extension of time.
- 4.7 The contractor shall furnish in writing such further information concerning his arrangements for the carrying out of the works and of the constructional plant or temporally works he intends to supply, use of construct and of his arrangements for the direction and administration of his performance of the contract as the Employer may from time to time required.
- 4.8 The submission to or approval by the Employer of such program or the furnishing of such particulars or information shall not relieve the contractor of any of his duties or responsibilities under the contract.



**5. Satisfaction of the Electrical Inspector & Insurance Company:-**

The work shall be carried out in accordance with IEE Rules

Rules and regulations as adopted in Pakistan, to satisfy the requirements of the Govt. Electrical Inspector, as Well as those of fire office insuring the building furniture etc., and the work is to pass the survey of their respective inspectors.

**6. Protections:-**

The constructors shall be effectively protect his on work from damage during and as may be necessary, after installation, and he shall likewise protect adjoining work of other trades from damage resulting from installation of Electrical work.

**7. Building Work:-**

**7.1** The information of channels foundations brick work, basis, recessed for board etc. will be carried out free of charge for contractor by the civil contractor if specifically indicated during the constructions work only.

**7.2** All necessary working drawings which may be necessary for the civil contractor to carry out the above referred work shall be supplied to him by the contractor well in time. The contractor shall however be responsible for the proper marking out of such work at side and for ensuring that all brackets and sleeves etc. are correctly build in.

**7.3** provision and fixing off brackets, clips, supports and stay etc. , to the fixed to wood Iron masonry or other such materials shall be the responsibility of the contractor.

**8. Codes and Standards etc:-**

**8.1** The latest published rules of the national Electrical code, so far as applicable to this works, B.S.S. and I.E.E. Rules and regulations off local city authorities shall be considered included as parts of these specifications and all requirements under then shall be fully met all wiring shall be carried out in looping system.

**8.2** The entire Installations shall be free from improper grounds, open and short circuit faults. Tests shall be made in accordance with section "E" of I.E.E. Regulation for the Electrical Equipment of building "1966" Edition in presence of a representative for the Employer / Consultant. Each panel shall be tested with mains connected to the riser, branches connected lamps removed or omitted,



sockets and wall switches closed. Each individual power line shall be tested with the power equipment connected for proper and intended operations. In no case shall the Installation resistance be less than that allowed by the regulations for Electrical Equipment of Building failure shall be corrected in a manner satisfactory to the Employer/ Consultant.

- 8.3 It shall be the responsibility of the Contractor to test all system of the entire Electrical Installations as well as those Installations where sequence Operations is required. The Electrical Contractor shall test for Proper sequence and he shall leave the Entire Electrical Installations in satisfactory working Conditions.
- 8.4 The contractor shall guaranteed that the Electrical system including all component and accessories used there in are free of all grounds, short and open circuit faults and defective workmanship and materials, any Electrical as well as mechanical defects known compliance of specification in any respect and will remain so, for the period of maintenance after the that of acceptance of the work, any defects, appearing with in the aforesaid period, shall be remedied by the contractor at his own Expense.
- 8.5 All electrical Installations in "Explosion hazardous zones" should comply to the institute of petroleum code of safety practices part-I Electrical.

## **9. Operation and Maintenance Manuals:-**

During the Time of Contact and before final approval of Electrical Installations, The Contractor shall submit to principal 2 (Two) copies descriptive literature maintenance and operation that and part list of each Item of Equipment installed under this contract

## **10 Electrical service Connection:-**

- 10.1 It shall be the Contractor's responsibility to give all notices to the power supply authority for provision of any load required as a result of this work and to seek Quotation for the Installation, furnishing and connection of the required electrical load complete in all respect.
- 10.2 When the Installation is complete, the contractor shall intimate the power supply Authority and make such tests as required by them to demonstrate conformance With their regulations prior to their connection to the Installation. The Extant of work herein specified represents the minimum requirement and the Extent of work shall be extended as required to include at no increase in



coast all that is required by the local power supply authority for an installation of this type.

- 10.3 If inspection by the Government constituted body is to be carried out, the contractor shall be responsible for carrying out the same. If any fee is paid for such inspection the same shall be reimbursed to the contractor to arrange all temporary power requirements during the construction work at his own risk and cost.

**11. Modification to comply with local standard etc:-**

- 11.1 The Electrical works in general has been designed complying to National Electrical Code, B.S.S. and I.E.E. (London) Standards. The contractors Shall carefully check the Drawing and applicable portions of the specifications and he shall modify with local standard and have them incorporated in the "SHOP DRAWING". In the event contract drawings are modified, it shall be the responsibility of the contractor to supply these modifications to all circuit work, panel boards, feeders, conduit switch points, sockets outlets, and in.
- 11.2 Any changes from the contract drawings and specifications due to manufacture requirement which may add to the cost of the Electrical works shall be taken into Consideration by the contractor and such additional costs, if any, shall be included in the tender at the time of submitting the tender.

**12. Record Drawings:-**

- 12.1 The contractor shall during the progress of the work, keep a careful installation differs from that shown on the CONTRACT or SHOP DRAWINGS. Upon completion of work the contractor shall prepare completion drawings on tracing cloth in a neat and accurate manner, from the signed record of all changes and revisions of the original design, to represent true installation in the completed work. These completion drawings shall be scrutinized and finalized by the OWNER/CONSULTANTS and two sets of prints handed over to the contractor. The Original tracings shall be retained by the OWNER. Final payment shall be withheld until receipt of these completion drawings in tracing cloth and subject to general terms and other clauses of the contract.

**13. Location of Wiring Outlets:-**

- 13.1 The contractor shall coordinate his work with all trades involved so that Exhalative locations may be obtained for all Outlets, apparatus, appliances and

wiring. The circuit numbers for lighting and power circuits are indicated on the drawing against the location of the outlet controls.

- 13.2 The Contractor shall provide for all power from main distribution switches board to all power boards and thereafter to all socket and socket outlets.
- 13.3 The power leads to all motors shall be in Conduit. Where motors have conduit terminal boxes, the feeder conduit shall be connected directly to boxes, the feeder conduit shall be connected directly into the same, except of fans and pumps which shall have at least 18 inches of armored flexible conduit from end of rigid conduit to motor terminal box. Under no circumstances shall rigid conduit terminals be used or be fastened to motor foundation. Armored Flexible conduit shall be Installed motors having sliding base. Provision shall also be made for the movement of Motors bolted to equipment.
- 13.4 The Location of outlets shown on diagrammatic wiring plans shall be considered as approximate and it shall be incumbent upon the contractor, before installation outlets Boxes, to study all pertinent drawings and obtain precise information from the architectural schedules, scale drawings, large scale and full details of finished rooms approved shop drawings of the trades etc. from the consultant.
- 13.5 In centering outlets due allowance shall be made for overhead piping, ducts, windows and door trim, variations in thickness of furring, plastering, etc. as erected, regardless of conditions which may be otherwise shown on drawings. Outlets incorrectly located shall be properly located at the contractor's expense. Local switches which are shown near door shall be at the strike side of the door as finally hung regardless swing shown on the drawings.



## **B – SPECIFICATIONS**

### **14. SWITCHES:-**

- 14.1 Switches controlling light and fan points shall be 5 Amperes or above, 250 Volts single or double pole, one way or two way, flush type as stated in Bill of Quantities The Switches shall be mounted on wall flushed steel back boxes, where the drawing indicates two or more switches or switches and sockets side by side, they shall be mounted in a multiple gang box. If molded case switches are specified, the combination of standard gang switches shall be used with back boxes for each gang.
- 14.2 samples shall be provided to the consultants for his prior approval before purchase.

### **15. Socket Outlets:-**

- 15.1 Socket outlets and plugging assembly shall 5 Amps, 2 round pins, line-neutral, 5 Amps, 3 round pin, line-neutral-ground or 13/15 Amps, 3 pin, line-neutral-ground These Shall be made of Bakelite and shall be suitable mounting flush with wall or column or surface mounting as called for in Bill of Quantities.
- 15.2 Each socket outlet shall have its control switch by the side of it one a common board if it is not of combined type switch-socket unit.
- 15.3 Where the socket and switch units or switch-socket outlets are to be installed in a or wet or damp area, they shall be of weather proof type.
- 15.4 Samples shall be provided to the consultant for his prior approval before purchase.

### **16. Outlets Boxes:-**

- 16.1 Each outlet in the wire form conduit system shall be provided with an outlet box to suit the condition encountered. Where outlets boxes are exposed to the weather or in normally wet location including flush and surface or exterior masonry walls and in explosive location shall be of the best metal type having threaded hubs. Boxes in all other location shall be either of PVC conduit or of black enameled arsenic-coated sheet steel type. Each box shall have sufficient volume to accommodate the number requirements. Ceiling and bracket Outlets boxes shall be not less than 3" square except the smaller boxes may be used

where by consultant. Recessed fixture shall be provided with separate junction boxes. Boxes to be Installed in concealed locations all with the proper type extension rings or plaster covers where required.

**16.2** Boxes for use with conduit system shall not be less 1-1/2" except where shallow boxes are required by structural conditions and as provided by consultant. Switched and socket outlets boxes shall be not less than 3" x 3". All boxes shall be concrete tight whether installed in concrete or in fluid material.

**16.3** Pull boxes shall not less than the minimum size required by the codes and shall be constructed of galvanized cast iron or teak wood. Boxes shall be furnished with screw-fastened covers. For multiple cables passing through a common pull box, feeders shall be tagged to indicate clearly the electrical characteristics circuit number and panel designation.

## **17. Outlet Covers:-**

Where not integral with the devices, the outlet plates shall be on-piece type. These shall be provided for outlets to suit the devices installed. Bakelite, plastic or Formica sheets as specified elsewhere in the tender documents. Screws for fastening of the plates/covers shall be of non-ferrous metal with counter sunk heads. The covers sheet shall be installed with all four edges in continuous contact with finished wall surface without use of mats or similar devices. The use of sectional type outlet covers shall not be permitted.

## **18. LIGHTING FIXTURES:-**

### **18.1 General**

**18.1.1** The lighting fixtures type are given on the drawing and each type is specified in detail in the items of specified in detail in the items of bill of quantities. Where a definite manufacture's type and catalogue number is specified, it shall also serve as an illustration of type and if the particular type and if the particular of fixture specified is not available approved equivalent fixture may be accepted.

**18.1.2** The determination of quality will be based on certificate photometric data covering the coefficient of utilization average brightness data, as well as equivalent of construction, the Engineer's approval is necessary. The contractor shall submit samples of each and every lighting fixture



specified and obtain approval of the Engineer before commencing installation.

## **18.2 Fluorescent Light Fixtures**

18.2.1 The industrial type fluorescent light fixtures shall have lamps and ballast of proper type and wattage as specified in the items of Bill of Quantities. The fluorescent lamps shall be 4 ft. 40 watts. The fluorescent color shall be white, cool day-light or day-light in that order of performance- the lamps shall be hyson or Philips make or equivalent.

18.2.2 The lamp holders shall be rotary, lock-in type. The starter shall be Philips make or approved equivalent.

18.2.3 The internal wiring of the fluorescent light fixtures with heat resistance wires shall be done at the manufacture's factory. Two or more than two lamps fixtures shall be provided with power factor improvement capacitor to give a power factor of 0.9. In addition to power factor improvement capacitor, capacitor for anti-ratio Interference shall be provided in each fluorescent fixture. The fluorescent light fixture shall be have with stove enameled sheet steel reflector white stove enameled inside and gray outside. The sheet steel shall not be thinner than 20 gauge. Appropriate size bushed wire entry holes, fixing holes, etc. shall be provided.

## **18.3 Incandescent Light Fittings**

18.3.1 The glass shade or globe incandescent light fitting shall be of first quality glass free from any air double or voids. The Glass shall be opal white color unless otherwise specified.

18.3.2 The surface mounting incandescent light fitting shall have white stove enameled sheet body. The fixing shall match the outlet box. The wall brackets incandescent light fittings shall have back plate with holes matching those of the conduit outlet box.

18.2.3 The incandescent fittings shall have bi-pin lamp holders of brass. The lamps shall be Hyson's or Philips make.

## **19. Ceiling Fans:-**

- 19.1 Ceiling Fans shall be capacitor type, five speeds, suitable for 250 volts, single phase, 50 c/s a.c. The displacement shall be 10,000e.f.m. for 48" (1219 mm) sweep and 12,000 e.f.m. for 56" (1423 mm) sweep at maximum speed. The fan motor shall be capacitor type and bearings shall be groove type to give noiseless operation. The fan regulator shall have laminated high grade sheet steel and regulators shall be recessed mounting type. The fan and regulator shall be of Millat or National Lahore, make or approved equivalent.
- 19.2 The fan shall be made of 15.8 mm (5/8") dia mild steel rod to shape of approved design. It should be in the form of loop about 87.5 mm (3-1/2") Long and about 50 mm (2") wide. The rod should be bent to have at least 200 mm extension on both sides for type to the reinforcement steel of the slab.
- 19.3 The fan hook shall be installed in the R.C.C. Ceiling at the time of pouring of concrete. The fan hook extending rods shall be tied to the reinforcement steel firmly so as not to be distributed during pouring of concrete.
- 19.4 The installation of fan shall include fixing of blades down rod, clamp and fan regulator and wiring of down rod from the ceiling rose to the fan terminals, testing and commissioning the down rod shall have long threads and shall be provided both of the fan clamps for safety. Any cartouches on the body of the fan or quality paints as provided by the manufacturer.

## **20. Conduit and Wiring Accessories:-**

- 20.1 Section B of the regulation for the electrical equipment of the Building, issued by the Institute of Electrical Engineers London 14<sup>th</sup> Edition (Referred Hereinafter as wiring regulation) shall be complied with as far as applicable to this installation.
- 20.2 The conduit wherever concealed in masonry shall be of rigid PVC b-Class 6kg/cm<sup>2</sup> pressure manufactured by Pakistan PVC D-Class 12 kg/cm<sup>2</sup> pressure. Where not permitted because of dampness or fire, steel conduit of 16 SWG shall be installed. The Conduit systems shall be installed in accordance with regulation B-87-100 of the wiring regulation. The conduit system shall be concealed in masonry wall, floor with required minimum concrete over it where not possible due to structural reasons; the conduit shall be exposed clipped to wall or roof.
- 20.3 Separate conduit shall be laid for different system, the mains, power such circuit and control wiring b/w control and the outlet.



- 20.4 The drawings indicate the suggestive runs for the various routes of the wiring as well as position of outlet. Minor change to suit actual construction shall be acceptable for which special and specific details be indicated in the shop drawing for the approval of the principal/Consultant. The contractor shall keep true record of all conduit layouts and submit as installed drawings before finally handing over the installation.
- 20.5 For the jointing of PVC conduit, PVC adhesive solution of approved make shall be applied to all joint and junction boxes to ensure proper sealing. Exposed conduit wherever utilized shall be securely fastened in place by means of approved conduit supports and fasteners. Where Conduit/pipe are to be fastened to masonry walls, floor or portion use of wooden block will not be permitted. Metal saddles of approved type not more than 4' apart shall be used for fixing exposed conduit.
- 20.6 The conduit shall be fastened to the box coupling and lock nut and insulating bushing approved make and type.

## **21. Low Tension Cable:-**

- 21.1 All the low tension cables shall be of size specified on the drawing or stated in the schedule of Quantities, single core, 3 core, or 3-1/2 core as required, polyvinyl chlorides (PVC) insulated and PVC sheathed. The cables shall be used either in floor in floor trenches or in conduit and thereof should be suitable for above conditions.
- 21.2 The copper used in manufacture of cables should conform to B.S.S. 10 or equivalent standard, having an electrical conductivity of not less than BSS 2004 & 2746 and should have heat stability and volume resistivity in accordance with the standard laid down by cable manufacturers association (U.K.)
- 21.3 All the cables should comply the test requirements of B.S.S. 200:1961.
- 21.4 The low tension cables shall be four cores with reduced neutral or 3 core as described having copper conductors of standard, annealed, electrolytic, high conductivity copper wires PVC insulated and PVC compound sheathed armored and non-armored and non-armored. The voltage grade shall be 1000/600 volts. The cables shall conform to B.S.6346:1969 and I.E.C. standard 502-1:1978.
- 21.5 The copper conductor will meet the requirements M.S. 6360:1969 and EC grade specifications of ASTM.

- 21.6 Core identification shall be by colors. Red, Yellow, and blue will indicate the three phase and black, the neutral.
- 21.7 The cables shall comprise of shaped stranded copper conductor, PVC insulated, tapped bedding galvanized steel wire armor and PVC over sheath.
- 21.8 The cables shall be capable of operating at a maximum continues temperature of 70 °C and short circuit temperature of 150 °C. The cables shall be suitable for operation on 415 Volts 4 wire 50 Hz AC system with the neutral point solidly earthed at transformer.
- 21.9 Technical particular of L.T. PVC/PVC cable shall be furnished for each size of the cable offered and mentioned in B.O.Q.

## **22. L.T. CABLE GLANDS, CLIPS & LUGS:-**

- 22.1 Cable glands shall comprise of gland body, compression ring. Armor ring (Where required) gland and conduit thread.
- 22.2 Cable glands shall be suitable for size of cable used and shall conform to BS 6121:1973.
- 22.3 All termination of PVC insulated cable shall be in compression connectors and termination. The lugs shall be manufactured from high conductivity copper, electro plated to resist corrosion and give good electrical continuity. Lugs shall be fitted by Compression tools made for the purpose.
- 22.4 Correct type of cable clamps and clips shall be used where needed. These shall be selected according to cable manufactures recommendations.

## **23. Distribution Panels:-**

- 23.1 The Distribution panels shall be totally enclosed metal clad, safety dead front type with hinged door and built – in concealed locks. The panels shall be suitable for working Voltage for which the equipment incorporated there in is designed for and tested in accordance with B.S. 116/1952.
- 23.2 The panels shall be constructed from 14 SWG sheet steel and shall accommodate circuit breakers, fuse switches distribution board, metering equipment, bus bars supports, cable glands and other relevant equipment.



- 23.3 The panels shall be finished inside and outside the hammer light gray air drying enamel and two finishing coats shall be applied after basic coat of anticorrosive primer. & Oven baked.
- 23.4 The mountings on the panel shall be earthed by means of earthing the entire pane through the two earthing terminals specifically provided for this purpose.
- 23.5 The panel shall be equipped with a terminal block of suitable rating and all outgoing connections shall be brought to that terminal block. The terminal block shall have a minimum 20% spare capacity for future use.
- 23.6 All panel enclosures shall have protection class I.P.54 as per DIN 4050 and I.E.C regulation.

23.7 **Panel Boards**

The protective devices in the boards shall be miniature circuit breakers (MCBs) of the Quantities and ratings specified in the Bill of Quantities/Drawings. The Circuits Shall be connected to the respective/MCBs. The MCBs shall be suitable for minimum 5 KA rupturing Capacity and designed for 2000 switching operation.

24. **Earthing:-**

- 24.1 All exposed non-current carrying metallic part of the of the electrical equipment, flexible conduit switch gear shall be efficiently earthed.
- 24.2 The earthing shall be done to comply with the following rules.
- 24.2.1 Indian Electricity Rules as adopted in Pakistan.
- 24.2.2 Section 'D' of part of the regulations for the electrical equipment of Buildings published by the Institution of Electrical Engineers London, 14<sup>th</sup> Edition.
- 24.2.3 British standard Code of Practice No. CP. 1013:1956.
- 24.3 The specifications are given here as under:
- 24.3.1 The earthing of the individual distribution points etc., shall be done as specified exclusively and Independently of the sub-station earthing.

- 24.3.2 For earthing of L.T. equipment earths shall be provided with copper plate earthing electrode. The earthing connections to the Neutral point shall bear distinct indicates, 'NOT TO DISCOUNT'. Excavation of the pit in the soil does the site refilling the pit with earth, lime and Charcoal, watering consolidation and ramming the layers to full compactness.
- 24.3.3 The earth shall consist of  $2 \times 2' \frac{1}{8}$ " copper plate as specified hereafter and buried in the ground at a depth of 15 feet or more according to the moisture in the strata Two earthing leads of the required size (circular) pipe of the size specified straight from the earth plate upto the point in the installation to the earth. A tee shall be provided at the vertical and extended in a manhole of  $12" \times 12"$  size of inject water casually.
- 24.3.4 The earth lead shall be of soft annealed electrolytic copper strip. Size  $1 \frac{1}{2}" \times 1/4'$  two such leads shall be brought out from each earth plate conforming to B.S.S. No.899 and shall be run in a 4" diameter hums pipe, as far as in the ground till it trench of the sub-station, where it shall be properly fixed on saddle and support.
- 24.3.5 The upper end of hums pipe, shall be terminated in a manhole so as to inject the water for improving the earth resistance, as and when necessary.
- 24.3.6 The earthing leads shall be terminated on the earthing block.
- 24.3.7 The connection between earth lead, earth plate or earth LR lead/earth bar shall be with  $3/16"$  diameter bolts conforming to B.S.S. NO. CP. 326.101 of 1948. The contact surface shall be silver coated before fixing and silver soldered after fixing. The connection with earth plate shall be at two distinct suitably spaced points.
- 24.3.8 There shall be no joint in the earthing leads between the earthing plate and earth block.
- 24.3.9 The earthing bar for the sub-station earth shall be cast and machined in electrolytic copper, conforming to B.S.S.I., 400. The size of earthing block shall be least  $4" \times 12" \times 5/8"$ . The earthing block shall be suitable for interconnections of two sets of earth leas  $1-1/2 \times 1/8"$  suitable number of brass bolt terminals shall be provided for terminating the earth leads from various load points as well as sheathing of all the outgoing cables.



- 24.3.10 The earth leads of soft annealed, electrolytic copper strip, size 1"x1/8" conforming to B.S.S. 899 shall be used to earth all the control panels installed in the sub-station and a separate lead of 1 1/2" x 1/4" for earthing neutral point. All the other equipment shall be earthed by circular copper conductors or as specified otherwise.
- 24.3.11 All the joints made in the strips shall be riveted in accordance with clause No.802 of G.P. 326 101. The surface, before riveting shall be silver plated, and soldered after riveting.
- 24.3.12 The ends of the circular earth conductors shall be tinned after twisting, so as to ensure the minimum contact resistance throughout its useful life.
- 24.3.13 The earth plates, for different earth shall be buried at least 30 feet apart so that their resistance shall not overlap.
- 24.3.14 The shortest route to the earth the electrode shall be adopted but sharp bends and joints shall in all cases be avoided. The earthing leads shall be connected to the earthing electrodes by means of sweating sockets, bars nuts, bolts and double washers so fixed to make a permanent and positive connection with the earthing electrode.
- 24.3.15 The maximum continuity resistance from any point in the installation including earthing leads to the earth plate shall not be exceed 1 ohm. The contractor therefore, must ensure that the earth leads are efficiently bonded to all metal works other than the current carrying parts so that the above resistance limit is not exceeded. Contractor shall arrange testing in the presence of the Engineer as required under I.E.E. 'WIRING REGULATIONS' and submit certified copies to the Engineer.

## 25. Voice System:-

### 25.1 General

The telephone system shall comprise of a Main Telephone Distribution Board, Sub-Telephone Distribution Boards floor mounting type telephone socket Outlets. The contractor shall be responsible for furnishing and installing all the above equipment. Cables conduits back boxes etc., according the specifications described herein. The contractor shall carry out the work in accordance with the Electrical code of practice CP 32.101, CP 327.102 of England, to the local applicable codes and to the entire satisfaction of telephone Department. The



Contractor shall make all necessary arrangement with telephone and telegraph Depart for the incoming cable (s). The contractor shall perform all the work to the satisfaction of T&T Department. The contractor shall guarantee the proper functioning and defect free working of the system for period of one year for the date the system shall be commissioned.

## **25.2 Installation Work:-**

The installation of non-equipment work shall include delivery, unloading, uncrossing setting in place, fastening to walls, floor, ceiling and other structures etc., and the completed conducting according to the specifications given in conduit installation including fixing of junction/pull boxes, pulling and connecting of cables installation of Telephone Distribution Board. The telephone layout drawings shows the floor plan of the respective floors and the conduits shall be laid above the RCC floor slab concealed in floor finish, unless otherwise specifically shown on the drawings.

## **25.3 Telephone Distribution Boards**

The telephone distribution boards shall be made of superior quality teak wood 10mm thick and enclosed in tight fitting in black enameled steel outer box of 16 SWG, the two being fastened together by means of nuts and bolts. A sheet steel door 16 SWG antitrust treated and painted, with locking arrangement shall be fixed on the box. The TDB,s will be either flush or surface mounting type as specified in Bill of Quantities In case of flush mounting type TDB's, The steel door will flush with the surface of the wall.

The door shall match the wall color. The TDBs shall be of appropriates size to accommodate terminal strips. The terminal strips fixed in the TDBS shall be made to copper. These shall be made of Telephone Industries of Pakistan.

## **25.4 Conduit and conduit Accessories**

The contractor shall furnish and Install complete conduit system with associated outlet boxes and terminal boxes, so as to be complete in all respects for installation of wire and cable. Conduits shall be 1"Dia PVC. The specification for conduit accessories remains same as given before of these specifications. At each telephone outlet location as shown on the drawings, the contractor shall furnish heavy gauge Sheet box black enameled inside and out install flush with the surface of wall suitable for mounting the telephone rosette.



## 26. Data Networking System

In the Data System, the following equipments will have the electrical/mechanical characteristics/features as detailed below;

- (i) Rack Mount Fiber Patch Panel
- (ii) Category 6 Patch Panels
- (iii) Data Communication Racks
- (iv) Category 6 Cable

### 26.1 Rack Mount Fiber Patch Panel

This Panel shall have the following mechanical/electrical characteristics features.

#### 26.1.1 Mechanical Characteristics

- |       |                        |   |
|-------|------------------------|---|
| (i)   | Material               | Box-powder coated aluminum alloy                  |
| (ii)  | Spool sheet            | Flame Retardant Grade (FR grade ) of ABS Material |
| (iii) | Cable Grommets         | FR grade nylon                                    |
| (iv)  | Splice Tray            | Aluminum + ABS                                    |
| (v)   | Splice Tray Dimensions | 140 x 125 x 10mm                                  |
| (vi)  | Dimensions             | 370 x 350 x80 (HxWxD)                             |

#### 26.1.2 Product Features

- (i) Aluminum housing with durable epoxy powder coating
- (ii) Suitable for 19" rack mountable cabinet.
- (iii) Allow minimum two cable entries
- (iv) Flame retardant plastic high impact resistance cable spool
- (v) Qualifies as per ISO/IEC 11801
- (vi) EN 20173

### 26.2 Category 6 Patch Panels

This Panel shall have the following mechanical/electrical characteristics features.

#### 26.2.1 Electrical Characteristics

- |       |                       |                                 |
|-------|-----------------------|---------------------------------|
| (i)   | Dielectric Strength   | 1000V RMS at 60 Hz for 1 minute |
| (ii)  | Current Rating        | 1.5 Amp maximum                 |
| (iii) | Insulation Resistance | 200 M $\Omega$ minimum          |
| (iv)  | Contact Resistance    | 1 m $\Omega$ per contact        |

- |      |                          |  |
|------|--------------------------|--|
| (v)  | Temperature Range        | - 40 °C to +70 °C                                    |
| (vi) | Transmission performance | Exceeds ISO/IEC 11801 Class E AS/NZS 3080:2003 Class |

### 26.2.2 Mechanical Characteristics

#### **Modular Connector**

- |       |                      |   |
|-------|----------------------|---|
| (i)   | RJ45 8-Pin Connector | FC part 68, Subpart F and IEC-60603-7 compliant                                   |
| (ii)  | Durability           | 1000 mating cycles  |
| (iii) | Material             | Phosphor bronze with 50 micro-inches of Gold over 100 micro inches nickel plating |

#### **IDC Connector**

- |       |                            |  |
|-------|----------------------------|--|
| (i)   | IDC connector              | Insulation slicing of 22 to 24 AWG (0.64 mm to 0.41 mm). |
| (ii)  | Insulation Diameter (wire) | 0.70 mm – 1.40 mm  |
| (iii) | Connector material         | phosphor bronze with nickel plating                      |

### 26.2.3 Product Features

- |       |   |
|-------|---|
| (i)   | Removable rear cable management tray  |
| (ii)  | Compatible with standard 19" equipment frames   |
| (iii) | IDC termination using a Actassi or other compatible tools   |
| (iv)  | Fully compliant to AS/NZS 3080:2003, ISO/IEC 11801 Edition 2 2002 And ANSI/TIA/EIA-568-B series connecting hardware standards |

## 26.3 **Data Communication Racks**

- |                   |  |                  |        |                   |        |           |        |
|-------------------|--|------------------|--------|-------------------|--------|-----------|--------|
| (i)               | Frames shall be manufactured from SPCC cold rolled steel and thickness of steel sheet as below.  |                  |        |                   |        |           |        |
|                   | <table border="0"> <tr> <td>a. Mounting rail</td> <td>2.0 mm</td> </tr> <tr> <td>b. Mounting angle</td> <td>1.5 mm</td> </tr> <tr> <td>c. Others</td> <td>1.2 mm</td> </tr> </table> | a. Mounting rail | 2.0 mm | b. Mounting angle | 1.5 mm | c. Others | 1.2 mm |
| a. Mounting rail  | 2.0 mm   |                  |        |                   |        |           |        |
| b. Mounting angle | 1.5 mm   |                  |        |                   |        |           |        |
| c. Others         | 1.2 mm   |                  |        |                   |        |           |        |
| (ii)              | 19" standard installation with adjustable dimension.   |                  |        |                   |        |           |        |
| (iii)             | Side doors with locks for protection.  |                  |        |                   |        |           |        |
| (iv)              | Static loading capacity of 1000 kg or above.   |                  |        |                   |        |           |        |
| (v)               | Must have IP 20 degree of protection.  |                  |        |                   |        |           |        |



## 26.4 Category 6 UTP Cables

This Cable shall have the following technical information and product features.

### 26.4.1 TECHNICAL INFORMATION

Physical Specifications	75°C
Rated Temperature	CMR, CM, LSZH
Flammability Test	Horizontal Wiring in LAN
Application	UL Subject 444, EIA/TIA 568-B.2 &
Reference Standard	ISO/IEC 11801, IEC61156-5

### 26.4.2 CONSTRUCTION

Conductor	Solid Bare Copper
AWG	23
Conductor Dia. Nom. (mm)	0.57
Insulation	PE
Average Thickness (mm)	0.22
Min. Point Thickness (mm)	0.18
Insulation Diameter ( $\pm 0.10$ mm)	0.95
Twisting Lay Length (mm)	30 underneath
Cabling Lay Length (mm)	200 underneath
Filler	PE
Jacket	PVC
Average Thickness ( $\pm 0.05$ mm)	0.50
Min. Point Thickness (mm)	0.43
Outer Diameter ( $\pm 0.2$ mm)	6.00
Rip Cord	Yes
1.0-100.0MHz Input Impedance (Ohms)	100 $\pm$ 6
100-250MHz Input Impedance (Ohms)	100 $\pm$ 6
1.0-250.0MHz Delay Skew (ns/100m)	$\leq 45$
Pair-to-Ground Capacitance Unbalance (pF/100m)	$\leq 330$
Max. Conductor DC Resistance 20°C (Ohms/km)	73.2
Resistance Unbalance (%)	$\leq 5$

### 26.4.3 Product Features

- I. complies with category 6 ANSI/TIA/EIA-568 & ISO/IEC 11801 standard.
- II. 23 AWG conductors and the transmission is certified to 250 MHz.
- III. UL listed CM fire rated.
- IV. Exceeds category 6 ANSI/TIA/EIA-568 & ISO/IEC 11801 standards.
- V. Supports transmission of digital and analogue voice, data and video signal.
- VI. Supports gigabit Ethernet (1000 Base-T)

# **SPECIFICATIONS OF INSTALLATION**



INDEX  
OF  
SPECIFICATION FOR INSTALLATION

<u>Articles</u>	<u>Description</u>	<u>PAGE</u>
2.1	General Instruction for installation.	93
2.2	Earthing Installation.	93
2.3	Wire and Cable Installation.	95

## **2. SPECIFICATION FOR INSTALLATION**

### **2.1. GENERAL INSTRUCTION FOR INSTALLATION**

- 2.1 The Contractor shall furnish all labor and materials, tools and equipment required to install, connect, test and commission all electrical equipment specified here, whether or not such equipment is furnished by him or others. The equipment and materials to be supplied by the Employer and to be installed by the contractor shall be issued to the contractor to check the equipment at the time of delivery from the site store, and to transport, load and lift it and his rates shall cover all expenses for labor and equipment required.
- 2.2 For all equipment to be installed by the contractor the contractor shall supply and install all installation materials such as foundation bolts, leveling steel, shims clamps, cable sockets, lugs, solder, wall plugs, washers, nuts and bolts etc., as required and without any additional cost.
- 2.3 The contractor shall himself set out the works as per specifications and drawings and shall properly position the equipment on given foundation/locations. In general the manufacturer's instructions for installation shall be followed. Any defect of faulty operation of equipment due to the contractor not following the manufacturer's instruction shall be corrected and repaired by the contractor at his own cost. For any departures from the working drawings that are deemed necessary by the contractor due to site conditions he shall submit the details and obtain the Engineer's approval before starting such work.

### **2.2 Earthing Installation**

#### **2.2.1 General**

- 2.2.1.1 A complete Earthing system as shown on drawing shall be installed by the contractor. The system shall give earth resistance, including the resistance of soil, earth leads and E.C.C. equal to or less than 1 ohm.
- 2.2.1.2 The contractor shall supply and install all installation materials such as sockets, thimbles, clamps, saddles, pins, nuts, bolts, Washers, copper brazing etc., without and addition cost. At all connections of earth continuity conductor to body of transformer, switch boards, cable



end boxes or any other metallic body, proper size copper or brass sockets, thimbles or lug shall be used to which the copper wire shall be welded by copper brazing. Soldering of copper wire at joints or termination shall be not allowed. At main earth loop copper conductor all tee-off connections shall be by copper brazing. After brazing the joint surface shall be protected by oxide inhibiting compound of low electrical resistance. For connections to metallic body the surface shall be thoroughly cleaned to the bright metal surface before bolting the lug or socket. Transformer body, switchboard body, bus-duct cover etc. shall be connected at least two points by two independent earth wires tapped from the earth loop or from the earth connecting point.

- 2.2.1.3 The copper earth wire shall be general run exposed on the surface of wall, cable trench or cable trays. For under floor runs these shall be installed in steel conduit of appropriate sizes except where laid along underground cables.

#### 2.2.2 Earth Electrode:-

- 2.2.2.1 For Installation of earth electrode, a pit of 1500 mm. Diameter and up to the depth of 4.5 meters or as decided at site shall be first executed in the bare ground.
- 2.2.2.2 The earth electrode shall be installed upright in the pit and shall be surrounded of choral and slot in 3:1 ratio in 1500 diameter around the pipe & electrode up to 3000 mm depth of the pit and packed hard.
- 2.2.2.3 The remaining pit shall be back filled with excavated earth rammed and tamped in layers. At the ground level an inspection chamber of 1:2:4 cement concrete as shown on the drawing shall be constructed. The inspection chamber shall be covered with heavy duty R.C.C. cover to finish flush with the general ground level.

#### 2.2.3 Earth Continuity Conductor

The earth continuity conductor of sizes shown on the drawing shall be installed all along the cable trenches, cable runs on over head trays and in steel conduits. This shall be connected to switch board's body at ends. The E.C.C. When installed in under floor R.C.C. cable trench shall be fixed within the power cable clamps.

## 2.3

### Wire and Cable Installation:-

- 2.3.1 Every type of wiring system shall in general comply with the relevant requirements of Regulation B 1-78 of I.E.E. wiring Regulation.
- 2.3.2 The contractor shall furnish all material and Labor to install wires and cables as listed in the schedule of Quantities and as shown on drawings. A part from the material specified under heading Material Specification, the contractor shall provide, without any extra cost, material for terminating the wires and cables such as filing compound. Identification tag, Earthing cables such as straps shall likewise be furnished for a complete wiring Installation in accordance with best Latest practice.
- 2.3.3 All wires and cable shall be arranged to provide bends of reasonably large radius, whether they are run in conduit, radius not less than specified in Table B-1 of I.E.E. Wiring Regulation. Wiring shall be continuous between termination and use of connectors or joints will not be allowed. Looping in system shall be followed throughout.
- 2.3.4 Cores of the cable beyond the metallic enclosure for the purpose of termination in an Outlet etc., Shall be enclosed suitably as defined in Regulation B-69 of I.E.E. Wiring Regulations. No portion of the cable shall thus remain exposed.
- 2.3.5 Where joints in cable conductors and bare conductors are required, they shall be mechanically and electrically sound and, except in cables buried underground they shall be accessible for inspection. Joints in non-flexible cables shall be made either by soldering or by means of mechanical clamps or compression type socket which shall securely retain all the wires of the conductors.
- 2.3.6 Every joints in cable shall be provided with insulation not less effective than that of the cable cores and damage. Soldering fluxes which remain acidic or corrosive at the completion of the soldering operation shall not used.
- 2.3.7 Any joint in a flexible cable or flexible cord shall be effected by means of a cable coupler.
- 2.3.8 Cable couplers and connectors shall be mechanically and electrically sound and shrouded either in metal which can be earthed in accordance



with section D of I.E.E. Wiring Regulations or incombustible Insulating material. Where the apparatus to be connected requires earthing, every cable coupler and connector shall have adequate provision for maintaining earth continuity.

- 2.3.9 Cables of A.C circuits Installed in steel conduit shall always be so bunched that the cable of all phases and the neutral conductor (if any) are contained in the same conduit.

# **SPECIFICATIONS FOR TESTING**



INDEX  
FOR  
SPECIFICATION FOR TESTING

<u>Articles</u>	<u>Description</u>	<u>PAGE</u>
1	General	99
2	Insulation Resistance Tests	99
3	Earthing Resistance Tests	100
4	Transformer	100
5	Switchgears	100
6	Protective Relays	101
7	Completed Tests	101

## **SPECIFICATON FOR TESTING**

### **1. General**

- 1.1 Upon completion of the installation, the contractor shall perform field tests on all equipment, materials and system. All tests shall be conducted in the presence of the Engineer for the purpose of demonstrating equipment or system compliance with specifications.
- 1.2 The contractor shall furnish, install and maintain all tools instruments, tests equipment, materials etc., and furnish all personnel including supervision and "stand by" labor required for the testing, setting and adjustment of all electrical facilities and their components parts, including putting the same in operation.
- 1.3 All tests shall be made with proper regard for the protection of the equipment and the contractor shall be responsible for adequate protection to all personnel during such tests.
- 1.4 The contractor shall record all test values of the tests made by him on all equipment, giving both "as found" and "as left" conditions. Three (3) copies of all tests data shall be given to the Engineer for records purpose. The witnessing of any tests by the Engineer does not relive the contractor of his guarantees for materials, equipment and workmanship as specified in the condition of contract.

### **2. Insulation Resistance Tests:**

- 2.1 Insulation resistance tests shall be made on all electrical equipment by a meager of 1000 volts.
- 2.2 The insulation resistance values of cables, transformers an switchgear, etc., shall be as per B.S.S. and Pakistan Electricity Rules.
- 2.3 Before making connections at the ends of each cable run, the insulation resistance measurement tests of each cable shall be made. Each conductor of a multi core cable shall be tasted individually with each other conductor of the group and also the earth. If insulation resistance test reading are found to be less than the specified minimum in any conductor, the entire cable shall be replaced and the new cable tests.
- 2.4 All (Transformers and switchgears) shall be given an insulation resistance measurement tests to ground after insulation but before any wiring is connected. Insulation test shall be made between open contracts of circuit breakers, switches and between each phase and earth. If the insulation resistance of the circuit under test is less than that specified above, The cause of the low regarding shall be determined and remove. Corrective measures shall include dry-out procedure by



means of heaters if measures become necessary and the Installation Resistance readings become necessary and the Insulation resistance readings taken after the correction has been made, satisfy the requirements specified herein, repeated insulation resistance measurements shall be made twice and at least 12 hours apart. The maximum range for each reading in the three successive tests shall exceed 20% of the average value. After all tests have been the equipment shall be reconnected.

### **3. Earthing Resistance Tests:-**

- 3.1 Earth resistance tests shall be made by the contractor on the earthing system, separating and reconnecting each earth connecting as may be required by the Engineer.
- 3.2 If it is indicated at solid treatment or other corrective measure are required to lower the ground resistance values, the Engineer will determine the extent of such corrective measures.
- 3.3 The electrical resistance of the E.C.C. together with the resistance of the earthing load measured from the connection with earth electrode to any other position in the completed installation shall not exceed one ohm.
- 3.4 Earth resistance tests shall be performed as per electric Inspector's requirements, where more earthing sets than one are installed, the earth resistance tests between two sets shall be measured by means of Resistance Bridge Instrument. The earth resistance between two sets shall not exceed one ohm.

### **4. Transformers**

- 4.1 In addition to the Insulation resistance tests on the transformer, Polarity and phase rotation test shall also be performed, Insulation resistance of the transformer oil shall be tested in accordance with B.S.S. 148 immediately before use. Auxiliary device, breather bushels relay etc, shall be tested for satisfactory operation.

### **5. Switchgears:-**

- 5.1 Each circuit breaker shall be electrically and mechanically, ascertaining that handle mechanism are operating. All inter lock control circuit shall be checked for proper connections in accordance with the wiring diagrams given by the manufactures.

- 5.2 The contractor shall identify the phase of all switchgear and power cables by stenciling the switchgear and tagging the cables so that the phases can be identified for connection to give proper phase sequence.

**6. Protective Relays:-**

- 6.1 Protective relays shall be set and calibrated and tests points recorded. Trip circuit shall be tested for proper operation. C.T. secondary circuit shall be energized and operation of the relays observed.

**7. Completed Tests:-**

- 7.1 After any equipment has been tested, checked for operation etc., and is accepted by the Engineer, the Contractor shall be responsible for the proper protection of the equipment so that subsequent testing of other equipment of system does not disturb the completed work.



## **SPECIAL NOTES**

## SPECIAL NOTES

1. All the quantities related with cables given in Bill of Quantities are approximate. It is the responsibility of the Contractor to determine the actual quantities. Payment shall be made against the quantities actually executed at site according to measurement.
2. The contractor will place the order for all the material to be used at site and in his scope of works well in time so that delivery of these materials should not affect the schedule of completion of works. No excuse for the late delivery of the materials by other manufacturers shall be accepted in this regard.
3. Connections on both sides of the cables shall be performed.
4. The contractor shall include in his rates the cost of the cable accessories such as copper busbars copper lugs, glands, cable end box etc, wherever required. Increase in rate(s), will not be possible after approval of the rate(s) and during execution of works.
5. For extra works carried out according to instructions of the Client and/or Consultants, or their representatives, the rates claimed for these works will be approved by the Client/Consultants after mutual discussion with contractor.
6. Quoted Tender documents, Tender Drawings and Addendum (if any) etc, shall be submitted on the date Tender opening.
7. Contractors/Bidders are advised to visit and understand the quantum of works unvalued in existing areas before filling the BOQ.
8. Contractors/Bidders may contact Consultants for clarification of each and every query before filling the BOQ. No alteration in the rates will be entertained after submission / approval of the Tender documents.
9. Contactor is required to submit list of materials required from owner, such as Power Plug etc and get the same from the owner. If the total quantity is not available with client then acquire partial quantities from client and partial from market as per site condition



## LIST OF APPROVED ELECTRICAL MANUFACTURERS

LIST OF APPROVED ELECTRICAL MATERIALS / MANUFACTURERS  
ELECTRICAL WORKS  
FOR  
GIRLS' HOSTEL NO. 3  
MEHRAN UNIVERSITY OF ENGINEERING & TECHNOLOGY, JAMSHORO

S. No.	Name of Component/System	Manufacturer	Local Agent/Contact Person	Contact Number
1.	L.T Distribution Board	Power Protection Services (PPS) Karachi	Muhammad Faisal	0301-2297443
		Best Electric Panels, Hyderabad	Muhammad Owais Shaikh	022-3863232 022-3813535
2.	MCCB	Terasaki, Japan	Jubilee Corporation Salik Mehmood (Project Sales Engineer)	021-32602211
		Hager, France		
		Schneider Electric	Mr. Farrukh Khan (Asstt. Manager-Sales)	111-777-888
3.	MCB	Terasaki, Japan	Jubilee Corporation Salik Mehmood (Project Sales Engineer)	021-32602211
		Hager, France		
4.	Current Transformer	Terasaki, Japan Revalco (Italy)	Jubilee Corporation Salik Mehmood (Project Sales Engineer)	021-32602211
5.	Voltmeter/Ammeter (Digital)	Revalco (Italy) Autonics (SWE Taiwan)	Jubilee Corporation Salik Mehmood (Project Sales Engineer)	021-32602211
6.	Voltmeter/Ammeter Selector Switch	K&N (Kraus & Naimer), New Zealand	Jubilee Corporation/Salik Mehmood (Project Sales Engineer)	021-32602211
7.	CT Operated Electronic Energy Meter & Electrical Analyzer (Digital)	Iovato Italy	Jubilee Corporation/Salik Mehmood (Project Sales Engineer)	021-32602211
8.	Indication / Pilot Lamp	Lovato Italy	Jubilee Corporation	021-32602211
		Maruyasu, Japan	Salik Mehmood (Project Sales Engineer)	
9.	Cables, Wires, & ECC. (Bare Copper Conductors)	Pakistan Cables Ltd.	Wasim Ahmed (Senior Sales Executive)	021-32561170-75
		Newage Cables Ltd.	Syed Farhan	021-35837577
10.	Light Fixtures	Philips Electrical Industries of Pakistan Ltd.	Taimoor Waseem (Senior Lighting Application Specialist)	021-35644263
			Haris Masood (Accounts Manager)	021-35644262
11.	Ceiling, Wall Bracket & Exhaust Fans	Pak Fans - Wahid Industries Ltd.	M.A. Majeed (Manager Sales)	053-3525211-14
		Millat Fans	Madina Electronics/M. Kashif Shafi	021-35657611
12.	Lighting Switches, Sockets, Call Bell, Bell Press & Multi-Outlet Boxes	Clipsal	Mukhtar Ahmed (Sales Executive)	021-111-081-081
		Opal		
13.	Switches, Sockets Back Box, Pull Box	Clipsal	Mukhtar Ahmed (Sales Executive)	021-111-081-081
		Opal		
14.	PVC Consumer Unit (Plastic DB)	Clipsal	Mukhtar Ahmed (Sales Executive)	021-111-081-081
15.	PVC Conduit	Dadex	Amir Hussain (Area Manager - Retail & Distribution - South)	021-35397002-9 (Ext. 106)
		Pak Arab		



16	Voice Cable	Pakistan Cables Ltd.	Wasim Ahmed (Senior Sales Executive)	021-32586325
		Schneider Electric	Clipsal / Syed Adeel Shah (Executive Engineer - Network Connectivity)	021-35067278
		3M, Pakistan	Britlite Engineering Company Karachi Abdul Razzaq (Project Engineer)	021-35341732-6
17.	Computer Data Cables	Schneider Electric	Clipsal / Syed Adeel Shah (Executive Engineer - Network Connectivity)	021-35067278
		3M, Pakistan	Britlite Engineering Company Karachi Abdul Razzaq (Project Engineer)	021-35341732-6
18.	Computer Data Equipments & Accessories	Schneider Electric	Clipsal / Syed Adeel Shah (Executive Engineer - Network Connectivity)	021-35067278
		3M, Pakistan	Britlite Engineering Company Karachi Abdul Razzaq (Project Engineer)	021-35341732-6
19.	Air Conditioners	Mitsubishi	Orient Electronics (Pvt.) Ltd. / Shahid Mehmood (Manager Commercial Air Conditioning)	042-111-111-660

## BILL OF QUANTITIES



**Internal & External Electrification, Air-Conditioning, Computer Data, & Voice System Works of  
Girls' Hostel at Mehran University of Engineering & Technology, Jamshoro.**

**MAIN SUMMARY**

S. No.	Description	Amount (Rs.)
1	Section-1: Internal Electrification (Scheduled Items) <i>This amount carried from page no:109</i>	Rs.
2	Section-2: Internal Electrification (Non-Scheduled Items) <i>This amount carried from page no:110</i>	Rs.
3	Section-3: Light Fittings & Fixture (Scheduled items) <i>This amount carried from page no:110</i>	Rs.
4	Section-4: Light Fittings & Fixture (Non-Scheduled items) <i>This amount carried from page no:111</i>	Rs.
5	Section-5: Power Distribution Board (Scheduled items) <i>This amount carried from page no:112</i>	Rs.
6	Section-6: Power Distribution Boards (Non-Scheduled items) <i>This amount carried from page no:112</i>	Rs.
7	Section-7: Main Feeders & Cables ( Non-Scheduled items) <i>This amount carried from page no:113</i>	Rs.
8	Section-8: Distribution Boards & Feeders (Scheduled items) <i>This amount carried from page no:117</i>	Rs.
9	Section-9: Distribution Boards & Feeders (Non-Scheduled items) <i>This amount carried from page no:120</i>	Rs.
10	Section-10: Earthing (Non-Scheduled items) <i>This amount carried from page no:121</i>	Rs.
11	Section-11: Voice System (Non-Scheduled Items) <i>This amount carried from page no:121</i>	Rs.
12	Section-12: External Electrification For Motor (Scheduled Items) <i>This amount carried from page no:122</i>	Rs.
13	Section-13: External Electrification For Motor (Non-Scheduled Items) <i>This amount carried from page no:122</i>	Rs.
14	Section-14: External Electrification For Lighting Fixtures (Scheduled Items) <i>This amount carried from page no:122</i>	Rs.
15	Section-15: External Electrification For Lighting Fixtures ( Non-Scheduled Items) <i>This amount carried from page no:123</i>	Rs.
16	Section-16: Light Fittings & Fixtures (Non-Scheduled Items) <i>This amount carried from page no:123</i>	Rs.
17	Section-17: Computer Data System (Scheduled Items) <i>This amount carried from page no:124</i>	Rs.
18	Section-18: Computer Data System (Non-Scheduled Items) <i>This amount carried from page no:124</i>	Rs.
19	Section-19: Distribution Boards (Scheduled Items) <i>This amount carried from page no:125</i>	Rs.
20	Section-20: Distribution Boards (Non-Scheduled Items) <i>This amount carried from page no:126</i>	Rs.
21	Section-21: Supply & Installation of A/C Units (Non-Scheduled Items) <i>This amount carried from page no:127</i>	Rs.
22	Section-22: Wiring of A/C Units (Scheduled Items) <i>This amount carried from page no:127</i>	Rs.
23	Section-23: Wiring of A/C Units (Non-Scheduled Items) <i>This amount carried from page no:127</i>	Rs.
24	Section-24: Distribution Boards (Scheduled Items) <i>This amount carried from page no:128</i>	Rs.
25	Section-25: Distribution Boards (Non-Scheduled Items) <i>This amount carried from page no:129</i>	Rs.
<b>TOTAL AMOUNT</b>		<b>Rs.</b>

Amount in Words \_\_\_\_\_

SIGNATURE OF BIDDER

SEAL OF BIDDER

## Section No. 1 INTERNAL ELECTRIFICATION (Scheduled Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing and Laying for light or fan point with 3/0.029 PVC insulated copper wire in 20mm (3/4") PVC conduit recessed in wall or column as required. (ESI # 124, P # 15)	790	P. Point	1,130.00	892,700.00
2.	Providing and Laying for plug point with 2-3/0.029 PVC insulated copper wire in 20mm (3/4") PVC conduit recessed in the wall or column as required. (ESI # 126, P # 15).	134	P. Point	985.00	131,990.00
3.	Providing and Laying for call bell point with 2-3/0.029 PVC insulated copper wire in 20mm (3/4") PVC conduit recessed in the wall or column as required. (ESI # 128, P # 15).	4	P. Point	1,764.00	7,056.00
4.	Providing and Laying (for main or sub-main) with 2-7/0.029 S/C, PVC insulated copper wire in 20mm (3/4") PVC conduit recessed in the wall or as required. (Lighting Circuit to DB) (ESI # 10, P # 2) (Approx length.)	1,830	Mtr.	222.00	406,260.00
5.	Providing and Laying (for main or sub-main) with 2-7/0.036 S/C, PVC insulated copper wire in 20mm (3/4") dia PVC conduit recessed in the wall or as required. (Power Circuit) (ESI # 11, P # 2) (Approx length.)	600	Mtr.	252.00	151,200.00
6.	Providing and Laying (for main or sub-main) with 2-7/0.044 S/C, PVC insulated copper wire in 20mm (3/4") dia PVC conduit recessed in the wall or as required. (Power Circuit) (ESI # 12, P # 2) (Approx length.)	1,980	Mtr.	341.00	675,180.00
7.	Providing & fixing of one way, S.P., 5A, flush type, switches (ESI # 219, P # 33)	790	No.	54.00	42,660.00
8.	Providing & fixing two pin 5 amp plug & socket. (ESI # 222, P # 33)	130	No.	80.00	10,400.00
9.	Providing & fixing of two way, S.P., 5A, flush type switches. (ESI # 220, P # 33)	4	No.	55.00	220.00
10.	Providing and fixing of 2/3 pin (plate type), 5 Amps, S.P., plug & socket. (ESI # 223, P # 33)	151	No.	91.00	13,741.00
11.	Providing, fixing and connecting 3 pin (round), 15A, S.P., plug & socket, flush type. (ESI # 227, P # 33)	88	No.	162.00	14,256.00
Total Cost of Schedule Items (A)					2,345,663.00

I the Contractor M/s \_\_\_\_\_

Hereby quote \_\_\_\_\_ premium above/below on the schedule items.

(B)= \_\_\_\_\_

Total Amount of SECTION-1 Schedule Items (A+B) in Rs. \_\_\_\_\_

Amount Carried over to summary at serial no - 1, Page-no: 108

## Section No. 2 INTERNAL ELECTRIFICATION (Non-Scheduled)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing & fixing of Call Bell, installed at the marked places in the drawings. (Call Bell of M/s Opal/Clipsal or equivalent quality, approved by EI)	4	No.		



2.	Providing & fixing of Bell Press on a given prepared board (Bell Press of M/s Opal/Clipsal or equivalent quality approved by EI).	4	No.		
3.	Providing and fixing of Plastic Back Box, recessed in the wall or columns and covered with socket sheet to house plug-socket switch or regulator etc. a) Size: 145mm x 80mm x 56mm (LxWxD) b) Size: 78mm x 83mm x 56mm (LxWxD)	204 37	No. No.		
4.	Providing and fixing of Plastic Back Box, to accommodate mains or sub mains switches, plug socket units etc., recessed in the wall, as required. a) Size: 78mm x 83mm x 56mm (LxWxD)	369	No.		
5.	Providing and fixing of Plastic Back Box, to accommodate Bell Press, recessed in the wall, as required. a) Size: 78mm x 83mm x 56mm (LxWxD)	4	No.		
<b>Total Amount of SECTION-2 Non-Schedule Items in Rs.</b>					

Amount carried over to summary at serial no - 2, Page- no:108

### Section No. 3 LIGHT FITTINGS & FIXTURES (Scheduled items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1	Providing, installing and connecting of following fans:				
1.1	Millat/Asia/Pak make or equivalent 56" sweep ceiling fan complete with fan dimmer, canopy, down rod, etc. including fixing of fan dimmers in the given and making holes on both sides of down rod and Providing and Laying it with 1.5mm <sup>2</sup> twin core, 450/750V grade PVC/PVC and also providing of 16mm dia mild steel fan hook on R. C. C. roof or beam as required. Complete in all respect with all accessories. (ESI # 235, P # 34)	162	No.	3,185.00	515,970.00
1.2	Providing & fixing Brass Bracket Fan 18" (good quality). (ESI # 236, P # 34)	11	No.	2,968.00	32,648.00
1.3	Providing & fixing Bakelite Ceiling Rose with two terminals. (ESI # 228, P # 33)	248	No.	72.00	17,856.00
1.4	Providing & fixing bracket Lamp Holder suitable for 15 mm (5/8") dia Bracket. (ESI # 231, P # 33)	214	No.	72.00	15,408.00
<b>Total of Schedule Items (A)</b>					<b>581,882.00</b>

I the Contractor M/s \_\_\_\_\_

Hereby quote \_\_\_\_\_ premium above/ below on the schedule items. (B)= \_\_\_\_\_

**Total Amount of SECTION-3 Schedule Items (A+B) in Rs.** \_\_\_\_\_

Amount carried over to summary at serial no - 3, Page- no:108

## Section No. 4 LIGHT FITTINGS &amp; FIXTURES (Non-Scheduled items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, installing, fixing and connecting of following light fixtures with lamps, chokes, starters, capacitors etc., complete with all internal connections and all fixing and mounting accessories. Jobs includes rod and Providing and Laying as given in drawing.				
1.1	Philips make recessed light fitting TBS-299/288 2x28W T5 Baes Solution, Post Painted Sheet Steel, High Putrity Pre-Anodized Aluminium.	84	No.		
1.2	Philips make TMS-140 or equivalent flourescent light fixture with 1x36W TL'D' Lamp.	203	No.		
1.3	Philips make TMS-120 or equivalent flourescent light fixture with 1x18W TL'D' Lamp. (Mirror light)	30	No.		
1.4	Philips make FCS-120 (Lunar Surface Mounted) or equivalent Downlighter with 24W-E27 220-240V CFL lamp. Complete in all respect with all accessories.	73	No.		
1.5	Philips make CFL Tornado 24W CDL E27 220-240V 1PF.	214	No.		
2.	Providing, installing and connecting of following fans:				
2.1	Millat/Asia/Pak make or equivalent 12" sweep exhaust fan, complete with capacitors including making of hole in wall to accommodate the fan & repairing good the damages. Complete in all respect with all accessories.	4	No.		
3.	Providing & Installing of plastic Fan Box for supply of wiring for fan with Steel Hook for supporting the fan and plastic cover to cover the fan box, complete in all respect.	162	No.		
<b>Total Amount of SECTION-4 Non-Schedule Items in Rs.</b>					

Amount carried over to summary at serial no - 4, Page- no:108

## Section No. 5 POWER DISTRIBUTION BOARDS (Scheduled items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, installing, connecting & commissioning of the following Distribution Boards (DBs) fabricated of 14 SWG steel clad, cubical design with hinged door cover, wall (recessed) mounted, factory assembled, suitable for 3 phase, 4 wire, 500 volts, 50 Hz A.C. Power Supply complete with pure copper busbars, copper cable lugs, glands, neutral link, earth block, terminal block etc., & having following configurations. (All equipment rated to 25 kA short circuit rating untill specified other and 50°C ambient temperature at 415V). Panel enclosure to comply with IP-50.				
1.1	<b>Main Distribution Board</b> <b>Incoming</b> 01- 400A, T.P., M.C.C.B (250-400 Amp Adjustable) (XS-400CJ) (ESI # 210, P # 31)	1	No.	39,401.00	39,401.00



03- Providing & Fixing Current Transformer rating 400/5amp (round) RLC-50 as required & as per instruction of EI. (ESI # 274, P # 39)	3	No.	1,851.00	5,553.00
01- Providing & fixing voltmeter size 96/96mm 500volt as required & as per instruction of EI. (ESI # 285, P # 41)	1	No.	999.00	999.00
<b>Outgoing</b>				
02- 30 A, T.P., M.C.C.B (XS-80NS[NB]) (ESI # 205, P # 31)	2	No.	5,301.00	10,602.00
02- 20 A, T.P., M.C.C.B (XS-80NS[NB]) (ESI # 205, P # 31)	2	No.	5,301.00	10,602.00
01 - 20 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
01 - 30 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
05 - 40 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	5	No.	9,261.00	46,305.00
02 - 60 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	2	No.	9,261.00	18,522.00
01 - 75 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
<b>Total of Schedule Items (A)</b>				<b>159,767.00</b>

I the Contractor M/s \_\_\_\_\_

Here by quote \_\_\_\_\_ premium above/ below on the schedule items. (B)= \_\_\_\_\_

**Total Amount of SECTION-5 Schedule Items (A+B) in Rs.** \_\_\_\_\_  
*Amount carried over to summary at serial no - 5, Page- no:108*

#### Section No. 6 POWER DISTRIBUTION BOARDS (Non-Scheduled items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, installing, connecting & commissioning of the following Distribution Boards (DBs) fabricated of 14 SWG steel clad, cubical design with hinged door cover, wall (recessed) mounted, factory assembled, suitable for 3 phase, 4 wire, 500 volts, 50 Hz A.C. Power Supply complete with pure copper busbars, copper cable lugs, glands, neutral link, earth block, terminal block etc., & having following configurations. (All equipment rated to 25 kA short circuit rating untill specified other and 50°C ambient temperature at 415V). Panel enclosure to comply with IP-50.				
1.1	<b>Main Distribution Board</b>	1	No.		
	<b>Incoming</b>				
	02 - ON/OFF Indication Lights (Green, Red), 220V, Model 8LP2T ILM, Make Lovato Italy or equivalent, approved by EI.	2	No.		
	01 - Three Phase Digital Multimeter & Electrical Analyzer (C.T operated), Make Lovato - Italy (or equivalent, approved by EI)	1	No.		
	03 - Phase (R.Y.B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent, approved by EI.	3	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent, approved by EI.	3	No.		
<b>Total Amount of SECTION-6 Non-Schedule Items in Rs.</b>					

*Amount carried over to summary at serial no - 6, Page- no:108*

## Section No. 7 MAIN FEEDERS &amp; CABLES (Non-Scheduled items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, laying & connecting of 1x 300 mm <sup>2</sup> , 4 Core, PVC/XLPE/PVC from Substation to Main Distribution Board laid in ground in 3" PVC pipe including digging of earth and making of C.C Manholes with covers at required distance for pulling of cables job also involves refilling of Earth and providing cable markers for route of L.T cable as per specifications.	85	Mtr.		
<b>Total Amount of SECTION-7 Non-Schedule Items in Rs.</b>					

Amount carried over to summary at serial no - 7, Page- no.108

## Section No. 8 DISTRIBUTION BOARDS &amp; FEEDERS (Scheduled items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, installing, connecting & commissioning of the following Distribution Boards (DBs) fabricated of 14 SWG steel clad, cubical design with hinged door cover, wall (recessed) mounted, factory assembled, suitable for 3 phase, 4 wire, 500 volts, 50 Hz A.C. Power Supply complete with pure copper busbars, copper cable lugs, glands, neutral link, earth block, terminal block etc., & having following configurations. (All equipment rated to 25 kA short circuit rating until specified other and 50°C ambient temperature at 415V). Panel enclosure to comply with IP-22.				
1.1	<b><u>DB - G1 (GROUND FLOOR)</u></b>				
	<b>Incoming</b>				
	01 - 30 A. T.P., M.C.C.B (ESI # 205, P # 31)	1	No.	5,301.00	5,301.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00
	<b>Outgoing</b>				
	18 - 10 A. S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	18	No.	916.00	16,488.00
1.2	<b><u>DB - G2 (GROUND FLOOR)</u></b>				
	<b>Incoming</b>				
	01 - 30 A. T.P., M.C.C.B (ESI # 205, P # 31)	1	No.	5,301.00	5,301.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00
	<b>Outgoing</b>				
	16 - 10 A. S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	16	No.	916.00	14,656.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00



	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00
1.3	<b>DB - F1 (FIRST FLOOR)</b>				
	<b>Incoming</b>				
	01 - 20 A, T.P., M.C.C.B (ESI # 205, P # 31)	1	No.	5,301.00	5,301.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00
	<b>Outgoing</b>				
	12 - 10 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	12	No.	916.00	10,992.00
1.4	<b>DB - F2 (FIRST FLOOR)</b>				
	<b>Incoming</b>				
	01 - 20 A, T.P., M.C.C.B (ESI # 205, P # 31)	1	No.	5,301.00	5,301.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00
	01 -Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00
	<b>Outgoing</b>				
	02 - 15 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	2	No.	916.00	1,832.00
	09 - 10 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	9	No.	916.00	8,244.00
1.5	<b>PDB - G1 (GROUND FLOOR)</b>				
	<b>Incoming</b>				
	01 - 40 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00
	<b>Outgoing</b>				
	18 - 20 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	18	No.	916.00	16,488.00
1.6	<b>PDB - G2 (GROUND FLOOR)</b>				
	<b>Incoming</b>				
	01 - 40 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00

	<b>Outgoing</b>				
	03 - 15 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	3	No.	916.00	2,748.00
	15 - 20 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	15	No.	916.00	13,740.00
1.7	<b><u>PDB - G3 (GROUND FLOOR)</u></b>				
	<b>Incoming</b>				
	01 - 30 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00
	<b>Outgoing</b>				
	11 - 15 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	11	No.	916.00	10,076.00
	03 - 20 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	3	No.	916.00	2,748.00
1.8	<b><u>PDB - F1 (FIRST FLOOR)</u></b>				
	<b>Incoming</b>				
	01 - 40 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00
	<b>Outgoing</b>				
	16 - 20 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	16	No.	916.00	14,656.00
1.9	<b><u>PDB - F2 (FIRST FLOOR)</u></b>				
	<b>Incoming</b>				
	01 - 40 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00
	<b>Outgoing</b>				
	03 - 15 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	3	No.	916.00	2,748.00
	12 - 20 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	12	No.	916.00	10,992.00
1.10	<b><u>PDB - F3 (FIRST FLOOR)</u></b>				
	<b>Incoming</b>				
	01 - 20 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P # 41)	1	No.	1,054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P # 41)	1	No.	999.00	999.00



	<b>Outgoing</b>				
	03 - 15 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	3	No.	916.00	2,748.00
	02 - 20 A, S.P., M.C.B.s (TB-5S) (ESI # 203, P # 31)	2	No.	916.00	1,832.00
2.	Providing, laying & connecting of PVC/PVC 600/1000V grade copper conductor cable from Main Distribution Board (MDB) to the respective Distribution Boards (DBs), recessed in the RCC or on surface / concealed in wall or column as required, complete in all respect with all fixing and termination accessories and entire satisfaction of Consultant / Owner.				
2.1	<b><u>DB - G1</u></b> Providing & laying PVC insulated with size 4-7/0.044 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (approx. length) (ESI # 40, P # 6)	9	Mtr.	613.00	5,517.00
2.2	<b><u>DB - G2</u></b> Providing & laying PVC insulated with size 4-7/0.044 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (approx. length) (ESI # 40, P # 6)	23	Mtr.	613.00	14,099.00
2.3	<b><u>DB- F1</u></b> Providing & laying PVC insulated with size 4-7/0.044 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (approx. length) (ESI # 40, P # 6)	8	Mtr.	613.00	4,904.00
2.4	<b><u>DB- F2</u></b> Providing & laying PVC insulated with size 4-7/0.044 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (approx. length) (ESI # 40, P # 6)	23	Mtr.	613.00	14,099.00
2.5	<b><u>PDB- G1</u></b> Providing & laying PVC insulated with size 4-7/0.052 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (approx. length) (ESI # 41, P # 6)	8	Mtr.	858.00	6,864.00
2.6	<b><u>PDB- G2</u></b> Providing & laying PVC insulated with size 4-7/0.052 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (approximate length) (ESI # 41, P # 6)	23	Mtr.	858.00	19,734.00
2.7	<b><u>PDB- G3</u></b> Providing & laying PVC insulated with size 4-7/0.044 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (approximate length) (ESI # 40, P # 6)	23	Mtr.	613.00	14,099.00
2.8	<b><u>PDB- F1</u></b> Providing & laying PVC insulated with size 4-7/0.052 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (approximate length) (ESI # 41, P # 6)	8	Mtr.	858.00	6,864.00
2.9	<b><u>PDB- F2</u></b> Providing & laying PVC insulated with size 4-7/0.052 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (approximate length) (ESI # 41, P # 6)	22	Mtr.	858.00	18,876.00

2.10	<b>PDB- F3</b> Providing & laying PVC insulated with size 4-7/0.044 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (approximate length) (ESI # 40, P # 6)	22	Mtr.	613.00	13,486.00
<b>Total of Schedule Items (A)</b>					<b>348,883.00</b>

I the Contractor M/s \_\_\_\_\_

Here by quote \_\_\_\_\_ premium above/ below on the schedule items. (B)= \_\_\_\_\_

**Total Amount of SECTION-8 Schedule Items (A+B) in Rs.** \_\_\_\_\_

*Amount carried over to summary at serial no - 8, Page- no:108*

**Section No. 9 DISTRIBUTION BOARDS & FEEDERS (Non-Scheduled items)**

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, installing, connecting & commissioning of the following Distribution Boards (DBs) fabricated of 14 SWG steel clad, cubical design with hinged door cover, wall (recessed) mounted, factory assembled, suitable for 3 phase, 4 wire, 500 volts, 50 Hz A.C. Power Supply complete with pure copper busbars, copper cable lugs, glands, neutral link, earth block, terminal block etc., & having following configurations. (All equipment rated to 25 kA short circuit rating untill specified other and 50°C ambient temperature at 415V). Panel enclosure to comply with IP-22.				
1.1	<b>DB - G1 (GROUND FLOOR)</b> <b>Incoming</b> 03 - Phase (R,Y,B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent as per instruction of EI.	1	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent as per instruction of EI.	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	3	No.		
	01 - Ampere Selector switch 4 step	1	No.		
1.2	<b>DB - G2 (GROUND FLOOR)</b> <b>Incoming</b> 03 - Phase (R,Y,B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent	1	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	1	No.		
	01 - Ampere Selector switch 4 step	1	No.		
1.3	<b>DB - F1 (GROUND FLOOR)</b> <b>Incoming</b> 03 - Phase (R,Y,B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent	1	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent	3	No.		
		3	No.		



	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	1	No.		
	01 - Ampere Selector switch 4 step	1	No.		
1.4	<b>DB - F2 (FIRST FLOOR)</b> <b>Incoming</b>	1	No.		
	03 - Phase (R.Y.B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent (approved by EI).	3	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent (approved by EI).	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand) or equivalent (approved by EI).	1	No.		
	01 - Ampere Selector switch 4 step	1	No.		
1.5	<b>PDB - G1 (GROUND FLOOR)</b> <b>Incoming</b>	1	No.		
	03 - Phase (R.Y.B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent (approved by EI).	3	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	1	No.		
	01 - Ampere Selector switch 4 step	1	No.		
1.6	<b>PDB - G2 (GROUND FLOOR)</b> <b>Incoming</b>	1	No.		
	03 - Phase (R.Y.B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent	3	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	1	No.		
	01 - Ampere Selector switch 4 step	1	No.		
1.7	<b>PDB - G3 (GROUND FLOOR)</b> <b>Incoming</b>	1	No.		
	03 - Phase (R.Y.B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent	3	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	1	No.		
	01 - Ampere Selector switch 4 step	1	No.		
1.8	<b>PDB - F1 (FIRST FLOOR)</b> <b>Incoming</b>	1	No.		
	03 - Phase (R.Y.B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent	3	No.		

	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	1	No.		
	01 - Ampere Selector switch 4 step	1	No.		
1.9	<b>PDB - F2 (FIRST FLOOR)</b> Incoming	1	No.		
	03 - Phase (R.Y.B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent	3	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	1	No.		
	01 - Ampere Selector switch 4 step	1	No.		
1.10	<b>PDB - F3 (FIRST FLOOR)</b> Incoming	1	No.		
	03 - Phase (R.Y.B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent	3	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	1	No.		
	01 - Ampere Selector switch 4 step	1	No.		
2.	Providing, laying & connecting of hard drawn copper wire from Main Distribution Boards (MDB) to the Distribution Board (DBs) in PVC conduit of detail below recessed in the RCC or on surface / concealed in wall or column as required, complete in all respect and entire satisfaction of Consultant / Owner.				
2.1	<b>DB - G1</b> Providing & Laying of hard drawn copper wire 4mm <sup>2</sup> as ECC with wiring of DB-G1 in 1½" dia rigid PVC conduit recessed in wall or column as required from MDB.	9	Mtr.		
2.2	<b>DB - G2</b> Providing & Laying of hard drawn copper wire 4mm <sup>2</sup> as ECC with wiring of DB-G2 in 1½" dia rigid PVC conduit recessed in wall or column as required from MDB.	23	Mtr.		
2.3	<b>DB- F1</b> Providing & Laying of hard drawn copper wire 4mm <sup>2</sup> as ECC with wiring of DB-F1 in 1½" dia rigid PVC conduit recessed in wall or column as required from MDB.	8	Mtr.		
2.4	<b>DB- F2</b> Providing & Laying of hard drawn copper wire 4mm <sup>2</sup> as ECC with wiring of DB-F2 in 1½" dia rigid PVC conduit recessed in wall or column as required from MDB.	23	Mtr.		



2.5	<b>PDB- G1</b> Providing & Laying of hard drawn copper wire 6mm <sup>2</sup> as ECC with wiring of PDB-G1 in 1½" dia rigid PVC conduit recessed in wall or column as required from MDB.	8	Mtr.		
2.6	<b>PDB- G2</b> Providing & Laying of hard drawn copper wire 6mm <sup>2</sup> as ECC with wiring of PDB-G2 in 1½" dia rigid PVC conduit recessed in wall or column as required from MDB.	23	Mtr.		
2.7	<b>PDB- G3</b> Providing & Laying of hard drawn copper wire 4mm <sup>2</sup> as ECC with wiring of PDB-G3 in 1½" dia rigid PVC conduit recessed in wall or column as required from MDB.	23	Mtr.		
2.8	<b>PDB- F1</b> Providing & Laying of hard drawn copper wire 6mm <sup>2</sup> as ECC with wiring of PDB-F1 in 1½" dia rigid PVC conduit recessed in wall or column as required from MDB.	8	Mtr.		
2.9	<b>PDB- F2</b> Providing & Laying of hard drawn copper wire 6mm <sup>2</sup> as ECC with wiring of PDB-F2 in 1½" dia rigid PVC conduit recessed in wall or column as required from MDB.	22	Mtr.		
2.10	<b>PDB- F3</b> Providing & Laying of hard drawn copper wire 4mm <sup>2</sup> as ECC with wiring of PDB-F3 in 1½" dia rigid PVC conduit recessed in wall or column as required from MDB.	22	Mtr.		
<b>Total Amount of SECTION-9 Non-Schedule Items in Rs.</b>					

Amount carried over to summary at serial no - 9, Page- no:108

#### Section No. 10 EARTHING (Non-Scheduled items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, making and testing of earth points with 2' x 2' x 1/8" thick copper plate buried 5 meter deep or to the depth of permanent water level whichever is less covered with charcoal and lime in specified ratio confirming to specification and drawing.	1	Job		
2.	Providing, drawing, connecting & testing of 1 - 70 mm <sup>2</sup> bare copper conductor as earthing leads in 32mm dia G.I. pipe buried in ground or connected in R.C.C. or masonry as required from Panel Board to the earth plate including making of 18" x 18" cement concrete chamber duly plastered and cover with R.C.C. Slab, including, providing & fixing of plug for watering, complete with all accessories and fasteners and as per drawing & specifications.	1	Job		
3.	Providing, fixing and connecting of 200 x 200 x 5 mm thick copper earth terminal blocks.	1	Job		
4.	Providing and Laying of PVC copper wire 1.5 mm <sup>2</sup> as Earth Continuity Conductor (ECC) with every 7/0.029 cable for general wiring, including metallic electrical accessories. (Approx. Length)	248	Mtr.		
5.	Providing and Laying of PVC copper wire 2.5 mm <sup>2</sup> as Earth Continuity Conductor (ECC) with every 7/0.036 cable for general Power. (Approx. Length)	214	Mtr.		

6.	Providing and Laying of PVC copper wire 4 mm <sup>2</sup> as Earth Continuity Conductor (ECC) with every 7/0.044 cable for general wiring, including metallic electrical accessories. (Approx. Length)	1.980	Mtr.		
<b>Total Amount of SECTION-10 Non-Schedule Items in Rs.</b>					

Amount carried over to summary at serial no - 10, Page- no:108

**Section No. 11 VOICE SYSTEM (Non-Scheduled items)**

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing installing and connection of Voice Face Plate with back box recessed on wall complete with all accessories. (Amount of Voice Face Plate has been covered with Multi-Outlet Boxes in the Computer Networking Section "A(b)", S # 9)	-	-	-	-
2.	Providing & Installation of Schneider Actassi 4-Pair CAT-6 UTP cable in 25 mm dia, rigid PVC conduit concealed in R.C.C or masonry as required from Switch Panel to the Multi-Outlet Boxes, including termination of CAT-6 cable, complete in all respects.	195	Mtr.		
3.	Providing Schneider Actassi Katt-RJ45 Voice Patch Cord (3 Meter each).	8	No.		
4.	Providing & Installing Telephone Junction Box 50 Pair with Krone Strips with Tag Blocks.	1	No.		
<b>Total Amount of SECTION-11 Non-Schedule Items in Rs.</b>					

Amount carried over to summary at serial no - 11, Page- no:108



## Section No 12 EXTERNAL ELECTRIFICATION (Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, installing and connecting of 30 Amps, .S.P. 240 volts, MCB as ON/OFF switch for Water Pump Motors on 18 SWG sheet steel surface mounted box. (ESI # 203, P # 31)	2	No.	916.00	1,832.00
2.	Providing & laying (MAIN or SUB MAIN) PVC insulated with size 2-7/0.044" copper conductor in 1/2" dia PVC conduit recessed in wall or column as required for 2 HP Water Pump Motor (ESI # 12, P # 2).	99	Mtr.	341.00	33,759.00
Total of Schedule Items (A)					35,591.00

I the Contractor M/s \_\_\_\_\_

Here by quote \_\_\_\_\_ premium above/ below on the schedule items. (B)= \_\_\_\_\_

Total Amount of SECTION-12 Schedule Items (A+B) in Rs. \_\_\_\_\_

Amount carried over to summary at serial no - 12, Page- no: 108

## Section No. 13 EXTERNAL ELECTRIFICATION (Non-Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs.)
1.	Providing and Fixing 2 HP, Single Phase, Mono Block Centrifugal Pump Motor 220V, 50 Hz or equivalent approved by EI.	2	No.		
2.	Providing and installing 18 SWG sheet steel surface mounted box, anti-rust treated and painted, complete with ON/OFF indication lamps and all other accessories required.	2	No.		
3.	Providing & laying of 4 mm <sup>2</sup> Copper Conductor as ECC with wiring of Motors in 1/2" dia PVC conduit recessed in wall or column as required, Complete in all respects.	99	Mtr.		
Total Amount of SECTION-13 Non-Schedule Items in Rs.					

Amount carried over to summary at serial no - 13, Page- no: 108

## Section No. 14 EXTERNAL ELECTRIFICATION (Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing and Laying for light or fan point with 2-3/0.029 PVC insulated copper wire in 20mm (3/4") PVC conduit recessed in wall or column as required. (ESI # 124, Page # 15)	78	P. Point	1,130.00	88,140.00
2.	Providing and Laying for plug point with 2-3/0.029 PVC insulated copper wire in 20mm (3/4") PVC conduit recessed in the wall or column as required. (ESI # 126, P # 15).	8	P. Point	985.00	7,880.00
3.	Providing and Laying (for main or sub-main) with 2-2.5mm <sup>2</sup> (7/0.029) S/C, PVC insulated copper wire in 20mm (3/4") PVC conduit recessed in the wall or as required. (Lighting Circuit to DB) (ESI # 10, P # 2) ( Approx. length)	95	Mtr.	222.00	21,090.00
4.	Providing & fixing of one way, S.P., 5A, flush type switch (ESI # 219, P # 33)	84	No.	54.00	4,536.00
5.	Providing & fixing two pin 5 amp plug & socket. (ESI # 222, P # 33)	8	No.	80.00	640.00
Total of Schedule Items (A)					122,286.00

I the Contractor M/s \_\_\_\_\_

Here by quote \_\_\_\_\_ premium above/ below on the schedule items. (B)= \_\_\_\_\_

Total Amount of SECTION-14 Schedule Items (A+B) in Rs. \_\_\_\_\_

Amount carried over to summary at serial no - 14, Page- no:108

**Section No. 15 EXTERNAL ELECTRIFICATION (Non-Schedule Items)**

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing and fixing of Plastic board, recessed in the wall or columns and covered with socket sheet to house plug-socket switch or regulator etc. a) Size 145x80x56 mm (LxWxD)	10	No.		
<b>Total Amount of SECTION-15 Non-Schedule Items in Rs.</b>					

Amount carried over to summary at serial no - 15, Page- no:108

**Section No. 16 LIGHT FITTINGS & FIXTURES (Non- Schedule Items)**

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, installing, fixing and connecting of following light fixtures with lamps, chokes, starters, capacitors etc., complete with all internal connections and all fixing and mounting accessories. Jobs includes concrete foundation for Landscape Lighting and Providing and Laying as given in drawing.				
1.1	Phillips make or equivalent Wall- Bracket FCW-098 Mini Vandalite with 24W CFL lamp (warm white). Complete in all respects with accessories	52	No.		
1.2	Philips LED Bollard II Type: BCP151 (0.8m version) Land scape lighting Fixture with 8W LED Lamps (Neutral white 4000K). Complete in all respects. Aluminium body as per international specs.	22	No.		
1.3	Philips make or equivalent Flood Light Tango3 with BSN.	4	No.		
<b>Total Amount of SECTION-16 Non-Schedule Items in Rs.</b>					

Amount carried over to summary at serial no - 16, Page- no:108



## Section No. 17 COMPUTER DATA SYSTEM (Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing & Laying wiring for mains with 2-7/0.029", S/C, PVC insulated wire in 20 mm (3/4") PVC conduit recessed in the wall or as required. (ESI # 10, P # 2) (Approx. length)	1,517	Mtr.	222.00	336,774.00
Total of Schedule Items (A)					336,774.00

I the Contractor M/s \_\_\_\_\_

Here by quote \_\_\_\_\_ premium above/ below on the schedule items. (B)= \_\_\_\_\_

Total Amount of SECTION-17 Schedule Items (A+B) in Rs. \_\_\_\_\_  
 Amount carried over to summary at serial no - 17, Page- no: 108

## Section No. 18 COMPUTER DATA SYSTEM (Non-Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing & laying copper 1.5 mm <sup>2</sup> Copper Conductor as ECC with wiring of Multi-Outlet Boxes as required. Complete in all respects.	1,517	Mtr.		
2.	Supply & Installing of 1U, 24-Port, Rack Mount, fiber patch panel, model no DFXOX24RXXXX to Connect the Patch Panels to the main Fibre Cable.	1	Mtr.		
3.	Supply and Installation of Schneider Actassi 24 - Port CAT-6 UTP Patch Panel, model no ACTPP6U24NSS Built-in Rear Cable Management, Complete in all respect.	11	No.		
4.	Supply and Installation of Arkite 15U Communication Rack 600x800 mm with PDU, Complete in all respect.	5	No.		
5.	Supply & installation of Schneider front cable organizer, model no RJ5ECMPCC.	11	No.		
6.	Supply and installation of CAT-6 (AT&T / IBM Campatable) cable, model no ACT4P6UCM3RBBU in already laid PVC conduit from Switch / Patch Panel to the respective Outlet Boxes, including termination of CAT-6 cable, complete in all respect.	7,649	Mtr.		
7.	Schneider Actassi 4-Pair CAT-6 UTP Patch Cord, model no ACTPC6UBCM30BU (3 Meter Each)	216	No.		
8.	Providing and laying of the following 25 mm dia PVC conduits concealed in wall / ceiling as required from the switch or patch panel to computer outlets. Complete in all respect with all required accessories.	2,550	Mtr.		
9.	Providing and installing of following Multi-outlet boxes on Floor/Wall/Column of appropriate size for Power for Telephone & Computer Data outlets. a) Multi-Outlet Box "Type-A" b) Multi-Outlet Box "Type-B"	208 8	No. No.		
10.	Providing and fixing of Plastic board to accommodate Multi-Outlet Boxes for power, Voice and Data outlets, recessed in the wall, as required. a) Size 145mm x 83mm x 56mm (LxWxD) b) Size 78mm x 83mm x 56mm (LxWxD)	216 216	No. No.		
Total Amount of SECTION-18 Non-Schedule Items in Rs.					

Amount carried over to summary at serial no - 18, Page- no: 108

## Section No. 19 DISTRIBUTION BOARDS (Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, installing, connecting & commissioning of the following Distribution Boards (DBs) fabricated of 14 SWG steel clad, cubical design with hinged door cover, wall (recessed) mounted, factory assembled, suitable for 3 phase, 4 wire, 500 volts, 50 Hz A.C. Power Supply complete with pure copper busbars, copper cable lugs, glands, neutral link, earth block, terminal block etc., & having following configurations: (All equipment rated to 7.5 kA short circuit rating and 50°C ambient temperature at 415V). Panel enclosure to comply with IP-22.				
1.1	<b>PDB - C1 (COMPUTER)</b>				
	<b>Incoming</b>				
	01 - 40 A, T.P., M.C.C.B (XS-100NS) (Sr-207 P-31)	1	No.	9,261.00	9,261.00
	<b>Outgoing</b>				
	15 - 10 A, S.P., M.C.B.s (Sr-203 P-31)	15	No.	916.00	13,740.00
	01- Providing & fixing ammeter size 96/96mm Direct 40A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P# 41)	1	No.	1054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P# 41)	1	No.	999.00	999.00
1.1	<b>PDB - C2 (COMPUTER)</b>				
	<b>Incoming</b>				
	01 - 60 A, T.P., M.C.C.B (XS-100NS) (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
	<b>Outgoing</b>				
	22 - 10 A, S.P., M.C.B.s (ESI # 203, P # 31)	22	No.	916.00	20,152.00
	01- Providing & fixing ammeter size 96/96mm Direct 60A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P# 41)	1	No.	1054.00	1,054.00
	01- Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P# 41)	1	No.	999.00	999.00
2.	Providing, laying & connecting of PVC/PVC 600/1000V grade copper conductor cable from Main Distribution Board (MDB) to the respective Distribution Boards (DBs), recessed in the RCC or on surface / concealed in wall or column as required, complete in all respect with all fixing and termination accessories and entire satisfaction of Consultant / Owner.				
2.1	<b>PDB-C1 (COMPUTER)</b>				
	Providing & laying PVC insulated with size 4-7/0.052 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (Approx. Length) (ESI # 41, P # 6)	10	Mtr.	858.00	8,580.00
2.3	<b>PDB-C2 (COMPUTER)</b>				
	Providing & laying PVC insulated with size 4-7/0.064 copper conductor in 1½" dia PVC conduit recessed in wall or column as required. (Approx. Length) (ESI # 42, P # 6)	10	Mtr.	1213.00	12,130.00
<b>Total of Schedule Items (A)</b>					<b>77,230.00</b>

I the Contractor M/s \_\_\_\_\_

Here by quote \_\_\_\_\_ premium above/ below on the schedule items.

(B)= \_\_\_\_\_

Total Amount of SECTION-19 Schedule Items (A+B) in Rs. \_\_\_\_\_

Amount carried over to summary at serial no - 19, Page- no: 108



## Section No. 20 DISTRIBUTION BOARDS (Non-Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs.)
1.	Providing, installing, connecting & commissioning of the following Distribution Boards (DBs) fabricated of 14 SWG steel clad, cubical design with hinged door cover, wall (recessed) mounted, factory assembled, suitable for 3 phase, 4 wire, 500 volts, 50 Hz A.C. Power Supply complete with pure copper busbars copper cable lugs, glands, neutral link, earth block, terminal block etc., & having following configurations. (All equipment rated to 7.5 kA short circuit rating and 50°C ambient temperature at 415V). Panel enclosure to comply with IP-22.				
1.1	<b>PDB - C1 (COMPUTER)</b> <b>Incoming</b> 03 - Phase (R.Y.B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent (approved by EI).	1	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent (approved by EI).	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand) or equivalent (approved by EI).	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand) or equivalent (approved by EI).	1	No.		
	01 - Ammeter Selector switch 4 step	1	No.		
1.1	<b>PDB - C2 (COMPUTER) (Cost of PDB-1)</b> <b>Incoming</b> 03 - Phase (R.Y.B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent (approved by EI).	1	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent (approved by EI).	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand) or equivalent (approved by EI).	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand) or equivalent (approved by EI).	1	No.		
	01 - Ammeter Selector switch 4 step	1	No.		
2.	Providing, laying & connecting of copper wire from Main Distribution Boards( MDB) to the Distribution Board (DBs) in PVC conduit of detail below recessed in the RCC or on surface / concealed in wall or column as required, complete in all respect and entire satisfaction of Consultant / Owner.				
2.1	<b>DB-C1 (Computer)</b> Providing & Laying of hard drawn bare copper wire 6 mm <sup>2</sup> as ECC with wiring in 1½" dia rigid PVC conduit in ground/floor /wall as required from MDB.	10	Mtr.		
2.2	<b>DB-C2 (Computer)</b> Providing & Laying of hard drawn bare copper wire 10 mm <sup>2</sup> as ECC with wiring in 1½" dia rigid PVC conduit in ground/floor/wall as required from MDB.	10	Mtr.		
3.	Providing & Laying of 75 mm (3") dia PVC Conduit in Ground Before Final Flooring for Computer Data & Voice System Cable Incoming From Main Communication System of MUET to the Fibre Patch Panel and TJB respectively.				
		234	Mtr.		
<b>Total Amount of SECTION-20 Non-Schedule Items in Rs.</b>					

Amount carried over to summary at serial no - 20, Page- no:108

## Section No 21 SUPPLY &amp; INSTALLATION OF A/C UNITS (Non-Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Supply and installation of Owner specified Air-cooled Split Type, Wall Mounted Air conditioning units, designed on High Ambient Temperature of 46° complete with controls and accessories and foundations for outdoor units. Complete with Refrigerant piping, valves, fittings, Refrigerant charge and oil charge.				
	a) Capacity 1.0 T.R	1	No.		
	b) Capacity 1.5 T.R	3	No.		
	c) Capacity 2.0 T.R	6	No.		
2.	UPVC piping class D for equipment drain system complete with fittings, Specialties & Accessories for units of item # 1.	11	No.		
3.	4 oz, weight coarse and 8 oz canvas cloth for pipe installation jacketing.	11	No.		
4.	Formatted plastic pipe insulation for refrigerant piping complete with accessories.	11	No.		
Total Amount of SECTION-21 Non-Schedule Items in Rs.					

Amount carried over to summary at serial no - 21, Page- no:108

## Section No 22 WIRING FOR A/C UNITS (Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Wiring for mains with 2-7/0.044, S/C, PVC insulated cable in 20mm (¾") dia PVC conduit recessed in the wall or as required. (ESI # 12, P # 2) (Approx. Length)	320	Mtr.	341.00	109,120.00
2.	Providing and fixing of S.P MCBs as ON/OFF switch for A/C of following ratings:				
	a) 20A, S.P, M.C.B. (ESI # 203, P # 31)	6	No.	916.00	5,496.00
	b) 15A, S.P, M.C.B. (ESI # 203, P # 31)	3	No.	916.00	2,748.00
	c) 10A, S.P, M.C.B. (ESI # 203, P # 31)	2	No.	916.00	1,832.00
Total of Schedule Items (A)					119,196.00

I the Contractor M/s \_\_\_\_\_

Here by quote \_\_\_\_\_ premium above/ below on the schedule items.

(B)= \_\_\_\_\_

Total Amount of SECTION-22 Schedule Items (A+B) in Rs. \_\_\_\_\_

Amount carried over to summary at serial no - 22, Page- no:108

## Section No 23 WIRING FOR A/C UNITS (Non-Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing & Laying of PVC insulated copper wire 4 mm <sup>2</sup> as ECC with wiring of A/C Units in 25 mm dia rigid PVC conduit in ground / floor as required from Main Distribution Board.	320	Mtr.		
2.	Providing and fixing of Plastic Board recessed in the wall or columns as required and covered with plastic sheet to house MCB's used for A/C as a switch of following size.				
	a) Size 78 mm x 83 mm x 56 mm (LxWxD)	53	No.		
Total Amount of SECTION-23 Non-Schedule Items in Rs.					

Amount carried over to summary at serial no - 23, Page- no:108



## Section No. 24 DISTRIBUTION BOARDS &amp; FEEDERS (Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, installing, connecting & commissioning of the following Distribution Boards (DBs) fabricated of 14 SWG steel clad, cubical design with hinged door cover, wall (recessed) mounted, factory assembled, suitable for 3 phase, 4 wire, 500 volts, 50 Hz A.C. Power Supply complete with pure copper busbars, copper cable lugs, glands, neutral link, earth block, terminal block etc., & having following configurations. (All equipment rated to 5 kA short circuit rating and 50°C ambient temperature at 415V). Panel enclosure to comply with IP-50.				
1.1	<b>DB-A/C-G1 (GROUND FLOOR)</b>				
	<b>Incoming</b>				
	01 - 40 A, T.P., M.C.C.B (Sr-207 P-31)	1	No.	9,261.00	9,261.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P# 41)	1	No.	1,054.00	1,054.00
	02 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P# 41)	1	No.	999.00	999.00
	<b>Outgoing</b>				
	04 - 15 A, S.P., M.C.B (ESI # 203, P # 31)	4	No.	916.00	3,664.00
	01 - 10 A, S.P., M.C.B (Sr # 203 P # 31)	1	No.	916.00	916.00
1.2	<b>DB-A/C-F1 (FIRST FLOOR)</b>				
	<b>Incoming</b>				
	01 - 60 A, T.P., M.C.C.B (ESI # 207, P # 31)	1	No.	9,261.00	9,261.00
	01 - Providing & fixing ammeter size 96/96mm Direct 30A as required & as per instruction of Engineer Incharge (EI) (ESI # 284, P# 41)	1	No.	1,054.00	1,054.00
	01 - Providing & fixing Voltmeter size 96/96mm 500 V as required & as per instruction of Engineer Incharge (EI) (ESI # 285, P# 41)	1	No.	999.00	999.00
	<b>Outgoing</b>				
	06 - 20 A, S.P., M.C.B.s (Sr-203 P-31)	6	No.	916.00	5,496.00
2.	Providing, laying & connecting of PVC/PVC 600/1000V grade copper conductor cable from Main Distribution Board (MDB) to the respective Distribution Boards (DBs), recessed in the RCC or on surface / concealed in wall or column as required, complete in all respect with all fixing and termination accessories and entire satisfaction of Consultant / Owner.				
2.1	<b>DB-A/C G1</b>				
	Providing & laying PVC insulated with size 4-7/0.052 copper conductor in 1½" dia PVC conduit recessed in wall or column as required (approximate length) (ESI # 41, P # 6)	19	Mtr.	858.00	16,302.00
2.2	<b>DB-A/C F1</b>				
	Providing & laying PVC insulated with size 4-7/0.064 copper conductor in 1½" dia PVC conduit recessed in wall or column as required (approximate length) (ESI # 42, P # 6)	17	Mtr.	1,213.00	20,621.00
<b>Total of Schedule Items (A)</b>					<b>69,627.00</b>

I the Contractor M/s \_\_\_\_\_

Here by quote \_\_\_\_\_ premium above/ below on the schedule items.

(B)= \_\_\_\_\_

Total Amount of SECTION-24 Schedule Items (A+B) in Rs. \_\_\_\_\_

Amount carried over to summary at serial no - 24, Page- no:108

## Section No. 25 DISTRIBUTION BOARDS &amp; FEEDERS (Non-Schedule Items)

S. #	Item Description	QTY	Unit	Unit Rate (Rs.)	Total Amount (Rs)
1.	Providing, installing, connecting & commissioning of the following Distribution Boards (DBs) fabricated of 14 SWG steel clad, cubical design with hinged door cover, wall (recessed) mounted, factory assembled, suitable for 3 phase, 4 wire, 500 volts, 50 Hz A.C. Power Supply complete with pure copper busbars, copper cable lugs, glands, neutral link, earth block, terminal block etc., & having following configurations: (All equipment rated to 5 kA short circuit rating and 50°C ambient temperature at 415V). Panel enclosure to comply with IP-50.				
1.1	<b>DB-A/C-G1 (GROUND FLOOR) (Cost of DB A/C-G1)</b> <b>Incoming</b>	1	No.		
	03 - Phase (R, Y, B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent.	3	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent	3	No.		
	01 - Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	1	No.		
	01 - Ampere Selector switch 4 step	1	No.		
1.2	<b>DB-A/C-F1 (FIRST FLOOR) (Cost of DB A/C-F1)</b> <b>Incoming</b>	1	No.		
	03 - Phase (R, Y, B) indication lamps 220V Model 8LP2T1LM, Make Lovato (Italy) or equivalent (approved by EI).	3	No.		
	03 - Control fuse with base 2/32A Model T-0+ PM-F Make DF (Spain) or equivalent (approved by EI).	3	No.		
	01- Voltmeter selector switch (7 Steps), PK9054E Make K&N (Newzealand).	1	No.		
	01- Ampere Selector switch 4 step	1	No.		
2.	Providing, laying & connecting of hard drawn copper wire from Main Distribution Boards( MDB) to the Distribution Board (DBs) in PVC conduit of detail below recessed in the RCC or on surface / concealed in wall or column as required, complete in all respect and entire satisfaction of Consultant / Owner.				
2.1	<b>DB-A/C G1</b> Providing & Laying of hard drawn copper wire 6 mm <sup>2</sup> as ECC with wiring in 1½" dia rigid PVC conduit in ground/floor/wall as required from MDB.	19	Mtr.		
2.2	<b>DB-A/C F1</b> Providing & Laying of hard drawn copper wire 10 mm <sup>2</sup> as ECC with wiring in 1½" dia rigid PVC conduit in ground/floor/wall as required from MDB.	17	Mtr.		
<b>Total Amount of SECTION-25 Non-Schedule Items in Rs.</b>					

Amount carried over to summary at serial no - 25, Page- no:108



**TENDER DRAWINGS**  
(NOT VALID FOR CONSTRUCTION)

**GIRLS HOSTEL NO.03**  
**MEHRAN UNIVERSITY OF ENGINEERING AND**  
**TECHNOLOGY JAMSHORO**  
**(ELECTRICAL TENDER DRAWINGS)**

**NS** **NAQVI AND SIDDIQUIE**  
**INC. ARCHITECTS & ENGINEERS**  
BLOCK NO: 18 FIRST FLOOR  
MARKAZ F-6  
ISLAMABAD  
TEL: 2876769-2270268



**KAD CONSULTANTS HYDERABAD**  
F-1, ZAIB RESIDENCY, HUSSAIN HOUSING  
SCHEME, NEAR SUMMIT BANK, WADHU WAH,  
QASIMABAD (PHASE-1), HYDERABAD, SINDH  
PAKISTAN.  
TEL: +92 22 2652274, FAX: +92 22 2652275,  
CELL: +92 334 9377556.  
E-MAIL: kad.consultants@hotmail.com



**GIRLS HOSTEL NO.03**  
**MEHRAN UNIVERSITY OF ENGINEERING**  
**AND TECHNOLOGY JAMSHORO**

**LIST OF DRAWINGS**

S.NO	DRWG.NO	DESCRIPTION	REMARKS
1,	E-01	LEGEND, GENERAL NOTES & EARTHING DETAIL	REV. 1
2,	E-02	LIGHTING LAYOUT FOR (GROUND FLOOR)	REV. 1
3,	E-03	LIGHTING LAYOUT FOR (FIRST FLOOR)	REV. 1
4,	E-04	GENERAL POWER LAYOUT FOR (GROUND FLOOR)	REV. 1
5,	E-05	GENERAL POWER LAYOUT FOR (FIRST FLOOR)	REV. 1
6,	E-06	COMPUTER POWER LAYOUT FOR (GROUND FLOOR)	REV. 1
7,	E-07	COMPUTER POWER LAYOUT FOR (FIRST FLOOR)	REV. 1
8,	E-08	COMPUTER DATA LAYOUT FOR (GROUND FLOOR)	REV. 1
9,	E-09	COMPUTER DATA LAYOUT FOR (FIRST FLOOR)	REV. 1
10,	E-10	TELEPHONE LAYOUT FOR (GROUND FLOOR)	REV. 1
11,	E-11	TELEPHONE LAYOUT FOR (FIRST FLOOR)	REV. 1
12,	E-12	AIR-CONDITIONING POWER LAYOUT FOR (GROUND FLOOR)	REV. 1
13,	E-13	AIR-CONDITIONING POWER LAYOUT FOR (FIRST FLOOR)	REV. 1
14,	E-14	EXTERNAL LIGHTING LAYOUT FOR (GROUND FLOOR PLAN)	REV. 1
15,	SC-E-01	SCHEMATIC DIAGRAM OF MAIN DISTRIBUTION BOARDS & CABLE SCHEDULE	REV. 1
16,	SC-E-02	SCHEMATIC DIAGRAM OF LIGHTING DISTRIBUTION BOARDS GROUND FLOOR	REV. 1
17,	SC-E-03	SCHEMATIC DIAGRAM OF LIGHTING DISTRIBUTION BOARDS FIRST FLOOR	REV. 1
18,	SC-E-04	SCHEMATIC DIAGRAM OF POWER DISTRIBUTION BOARDS (G - F)	REV. 1
19,	SC-E-05	SCHEMATIC DIAGRAM OF POWER DISTRIBUTION BOARDS (F - F)	REV. 1
20,	SC-E-06	SCHEMATIC DIAGRAM OF COMPUTER DISTRIBUTION BOARDS (G - F) & (F - F)	REV. 1
21,	SC-E-07	SCHEMATIC DIAGRAM OF A/C DISTRIBUTION BOARDS (G - F) & (F - F)	REV. 1





GENERAL NOTES.

1) THE TABLE SHOWS THE MAXIMUM PERMISSIBLE NUMBER OF 600/1000V GRADE CABLES THAT CAN BE DRAWN INTO RIGID CONDUITS.


**NOTE**

1. THE COLUMNS HEADED "S" APPLY TO RUNS OF CONDUIT WHICH HAVE DISTANCE NOT EXCEEDING 4.25m BETWEEN DRAWING-BOXES AND WHICH DO NOT DEFLECT FROM THE STRAIGHT BY AN ANGLE OF MORE THAN 15°. THE COLUMNS HEADED "B" APPLY TO RUNS FOR CONDUIT WHICH DEFLECT FROM THE STRAIGHT BY AN ANGLE OF MORE THAN 15°.
2. ALL THE CONSUMER UNIT SHALL BE PLACED ABOVE OR BLOW THE POWER PLUG POINT (GENERAL POWER-2 PIN, 23 PIN, 3 PIN) AS SHOWN IN THE SCHEMATIC DRAWINGS.
- 3) MAIN CIRCUIT FOR EACH DB SHALL RUN IN SEPARATE CONDUIT.
- 4) ALL WIRING CABLES SHALL BE OF 600/1000 VOLTS GRADE MINIMUM.
- 5) BARE COPPER CONDUCTOR AS EARTH WIRE SHALL RUN ALONG MAINS.
- 6) POINT WIRING SHALL BE WITH 1.5mmsq COPPER CABLES
- 7) LIGHT CIRCUIT WIRING SHALL BE WITH 2.5mmsq COPPER CABLES OR AS INDICATED IN SCHEMATIC DRAWING OF D-B.
- 8) ECC SHALL BE OF THE SIZE OF MAIN CONDUCTOR OR AS INDICATED IN SCHEMATIC DRAWING OF D-B.
- 9) EACH LIGHT AND POWER CIRCUIT SHALL BE LAID IN SEPARATE CONDUIT.
- 10) FOR RISER POSITION WITH THE WALL, CAREFULLY CO-ORDINATE WITH THE CIVIL CONTRACTOR & HAVE THE SAME CONFIRMED.
- 11) NO CHISELING AND CUTTING OF STRUCTURE IS TO BE CARRIED OUT WITHOUT PRIOR WRITTEN PERMISSION OBTAINED FROM THE ARCHITECT / ENGINEER.
- 12) TELEPHONE WIRE-2 PAIR SHALL RUN IN 1" DIA PVC CONDUIT.

TITLE		LEGEND, GENERAL NOTES & EARTHING DETAIL	
PROJECT		GIRLS HOSTEL NO.03 MEHRAN UNIVERSITY OF ENGINEERING & TECHNOLOGY, JAMSHORO	
DESIGNED BY :		ENGR. ABDUL JABBAR ABRO	
DESIGNED BY :	PROJECT NO.	009/2013	
SCALE	DRAWING NO.	E-01	
DATE:		10-03-2013	
		CONSULTANT NAQVI AND SEDIQUITE INC. ARCHITECT & ENGINEER 100-A, 1ST FLOOR, PLOT NO. 1 KARACHI-74200 TEL: 021-77748-277668 ISLAMABAD	
		K-CONSULTANTS 100-A, 1ST FLOOR, PLOT NO. 1 KARACHI-74200 TEL: 021-77748-277668 ISLAMABAD	



SYMBOL		DESCRIPTION	NOTATION
1	Room	Room	Room
2	Corridor	Corridor	Corridor
3	Staircase	Staircase	Staircase
4	Entrance	Entrance	Entrance
5	Exit	Exit	Exit
6	Room	Room	Room
7	Room	Room	Room
8	Room	Room	Room
9	Room	Room	Room
10	Room	Room	Room
11	Room	Room	Room
12	Room	Room	Room
13	Room	Room	Room
14	Room	Room	Room
15	Room	Room	Room
16	Room	Room	Room
17	Room	Room	Room
18	Room	Room	Room
19	Room	Room	Room
20	Room	Room	Room
21	Room	Room	Room
22	Room	Room	Room
23	Room	Room	Room
24	Room	Room	Room
25	Room	Room	Room
26	Room	Room	Room
27	Room	Room	Room
28	Room	Room	Room
29	Room	Room	Room
30	Room	Room	Room
31	Room	Room	Room
32	Room	Room	Room
33	Room	Room	Room
34	Room	Room	Room
35	Room	Room	Room
36	Room	Room	Room
37	Room	Room	Room
38	Room	Room	Room
39	Room	Room	Room
40	Room	Room	Room
41	Room	Room	Room
42	Room	Room	Room
43	Room	Room	Room
44	Room	Room	Room
45	Room	Room	Room
46	Room	Room	Room
47	Room	Room	Room
48	Room	Room	Room
49	Room	Room	Room
50	Room	Room	Room
51	Room	Room	Room
52	Room	Room	Room
53	Room	Room	Room
54	Room	Room	Room
55	Room	Room	Room
56	Room	Room	Room
57	Room	Room	Room
58	Room	Room	Room
59	Room	Room	Room
60	Room	Room	Room
61	Room	Room	Room
62	Room	Room	Room
63	Room	Room	Room
64	Room	Room	Room
65	Room	Room	Room
66	Room	Room	Room
67	Room	Room	Room
68	Room	Room	Room
69	Room	Room	Room
70	Room	Room	Room
71	Room	Room	Room
72	Room	Room	Room
73	Room	Room	Room
74	Room	Room	Room
75	Room	Room	Room
76	Room	Room	Room
77	Room	Room	Room
78	Room	Room	Room
79	Room	Room	Room
80	Room	Room	Room
81	Room	Room	Room
82	Room	Room	Room
83	Room	Room	Room
84	Room	Room	Room
85	Room	Room	Room
86	Room	Room	Room
87	Room	Room	Room
88	Room	Room	Room
89	Room	Room	Room
90	Room	Room	Room
91	Room	Room	Room
92	Room	Room	Room
93	Room	Room	Room
94	Room	Room	Room
95	Room	Room	Room
96	Room	Room	Room
97	Room	Room	Room
98	Room	Room	Room
99	Room	Room	Room
100	Room	Room	Room

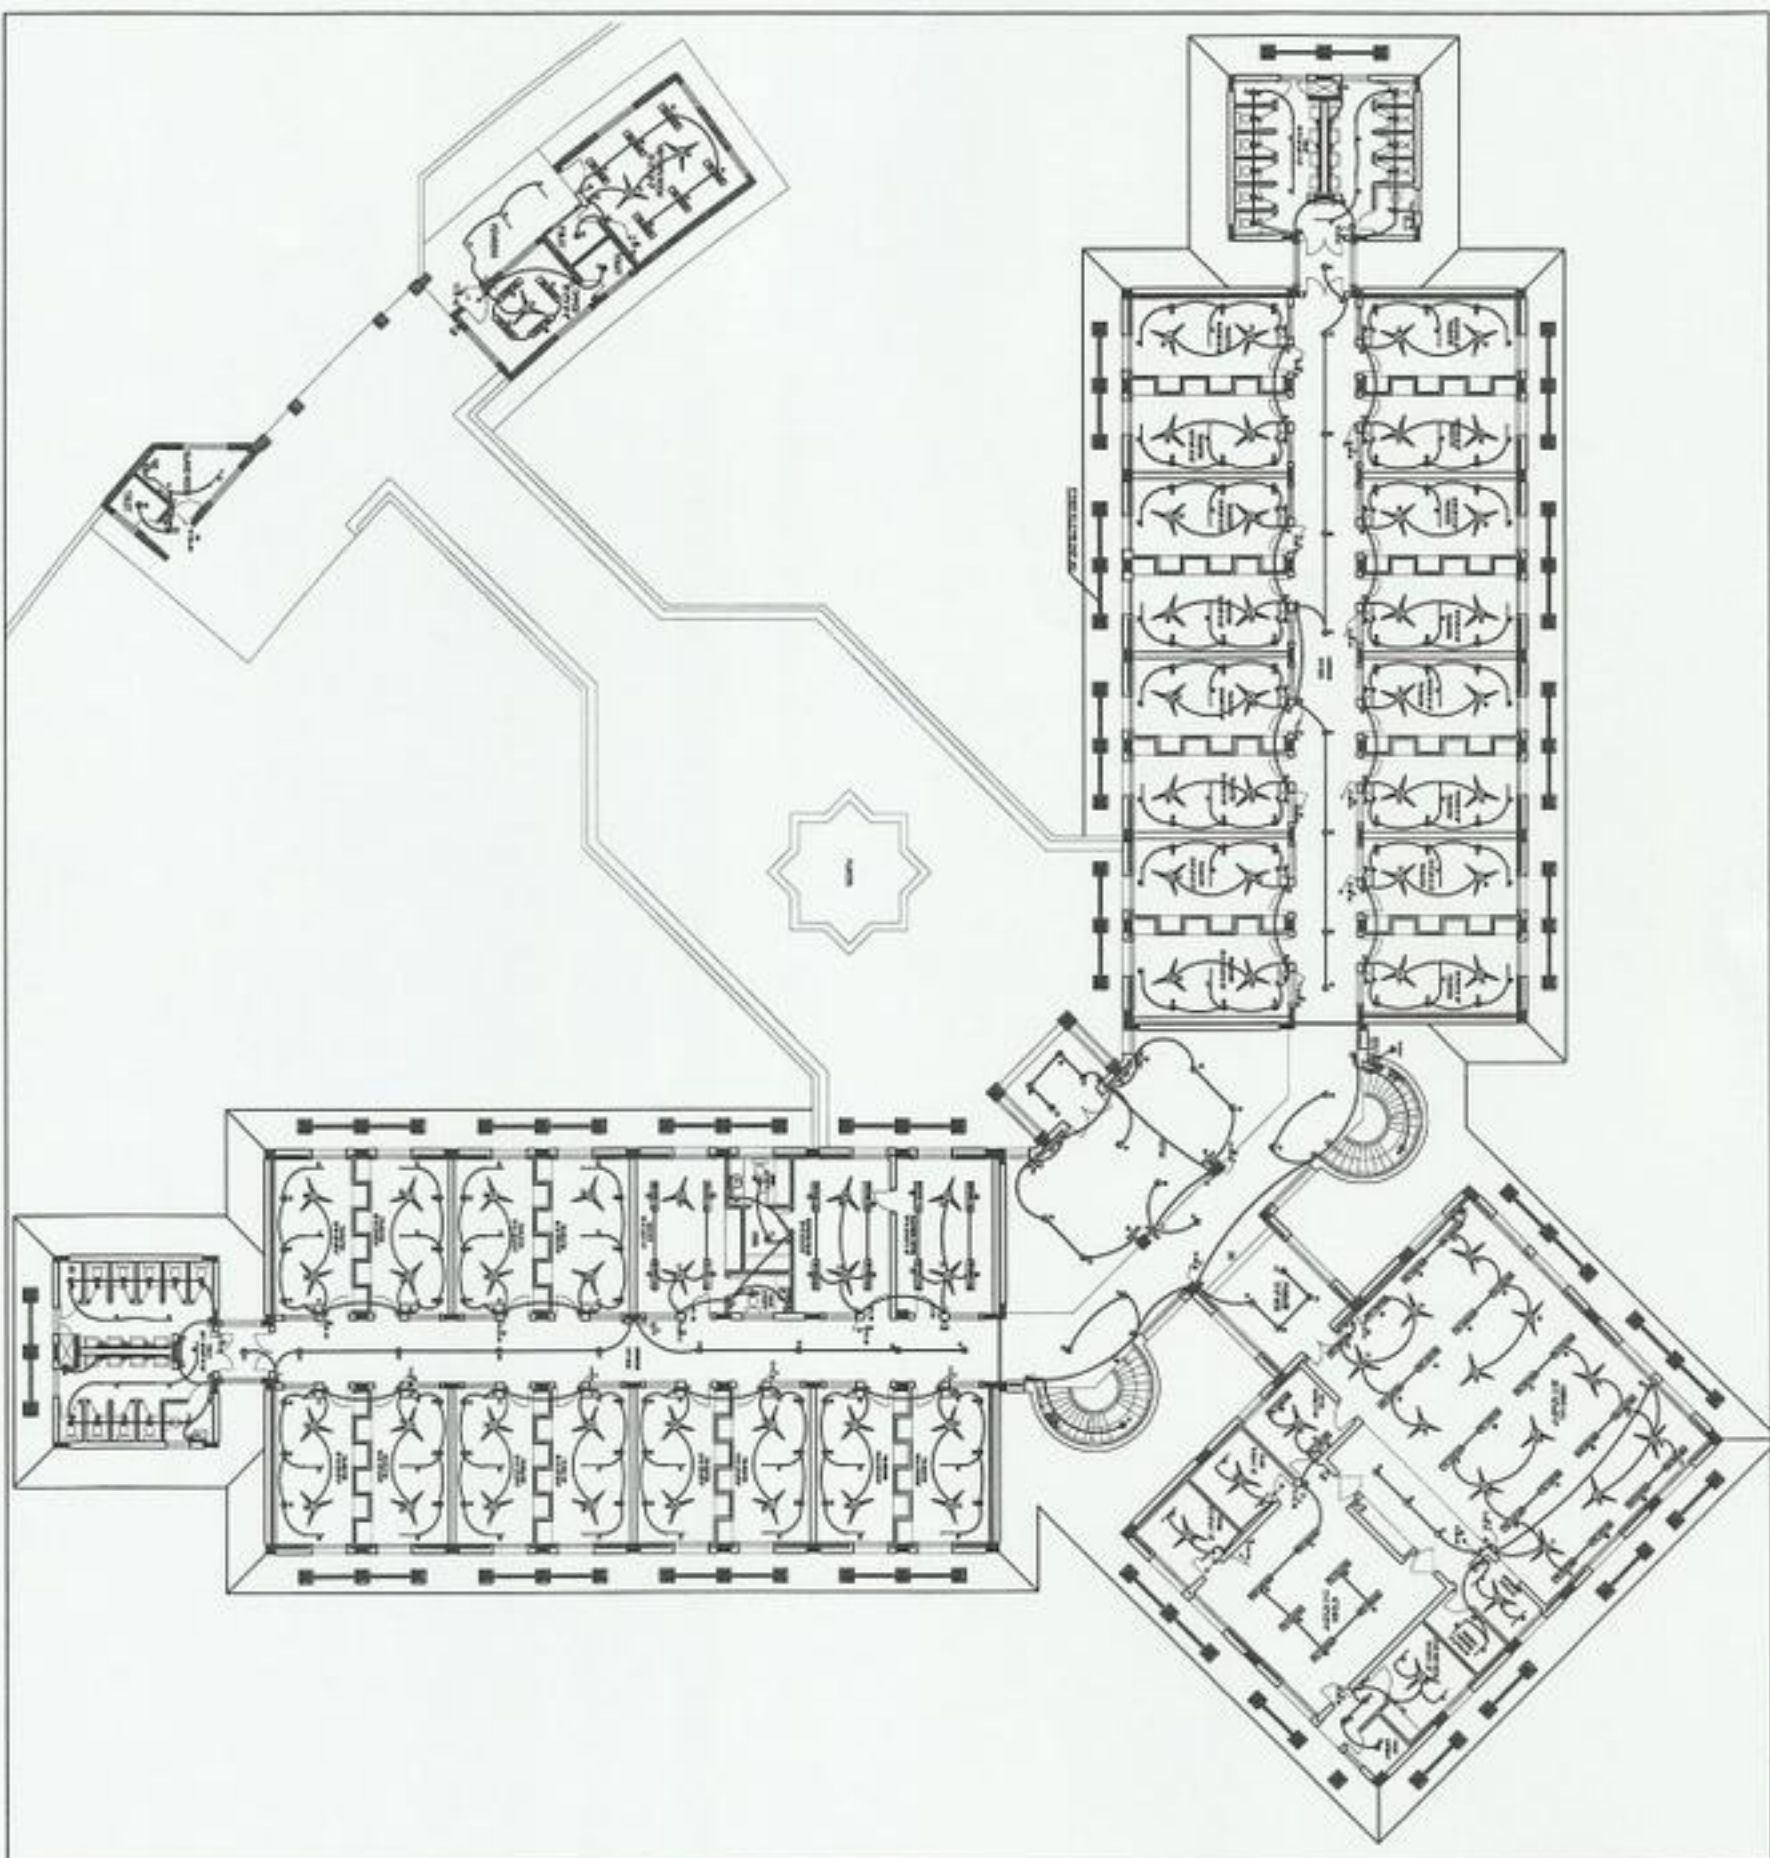

**TITLE**  
LIGHTING LAYOUT -  
GROUND FLOOR

**PROJECT**  
GIRLS HOSTEL NO.03  
MEHRAN UNIVERSITY  
OF ENGINEERING  
& TECHNOLOGY, JAMSHORO

**DESIGNED BY :**  
ENGR. ABDUL JABBAR ABERO

**DESIGNED BY :**  
Owais Khatri


**SCALE**  
N.T.S

**DATE:**  
11-03-2013

**NS**  
KADVI AND SODQUK  
ARCHITECTS & ENGINEERS  
SUITE 202 FIRST FLOOR  
KARACHI 7-8  
TEL: 3779796-3779798  
WWW.KADVIARCHITECTS.COM

**K**  
KADVI AND SODQUK  
ARCHITECTS & ENGINEERS  
SUITE 202 FIRST FLOOR  
KARACHI 7-8  
TEL: 3779796-3779798  
WWW.KADVIARCHITECTS.COM



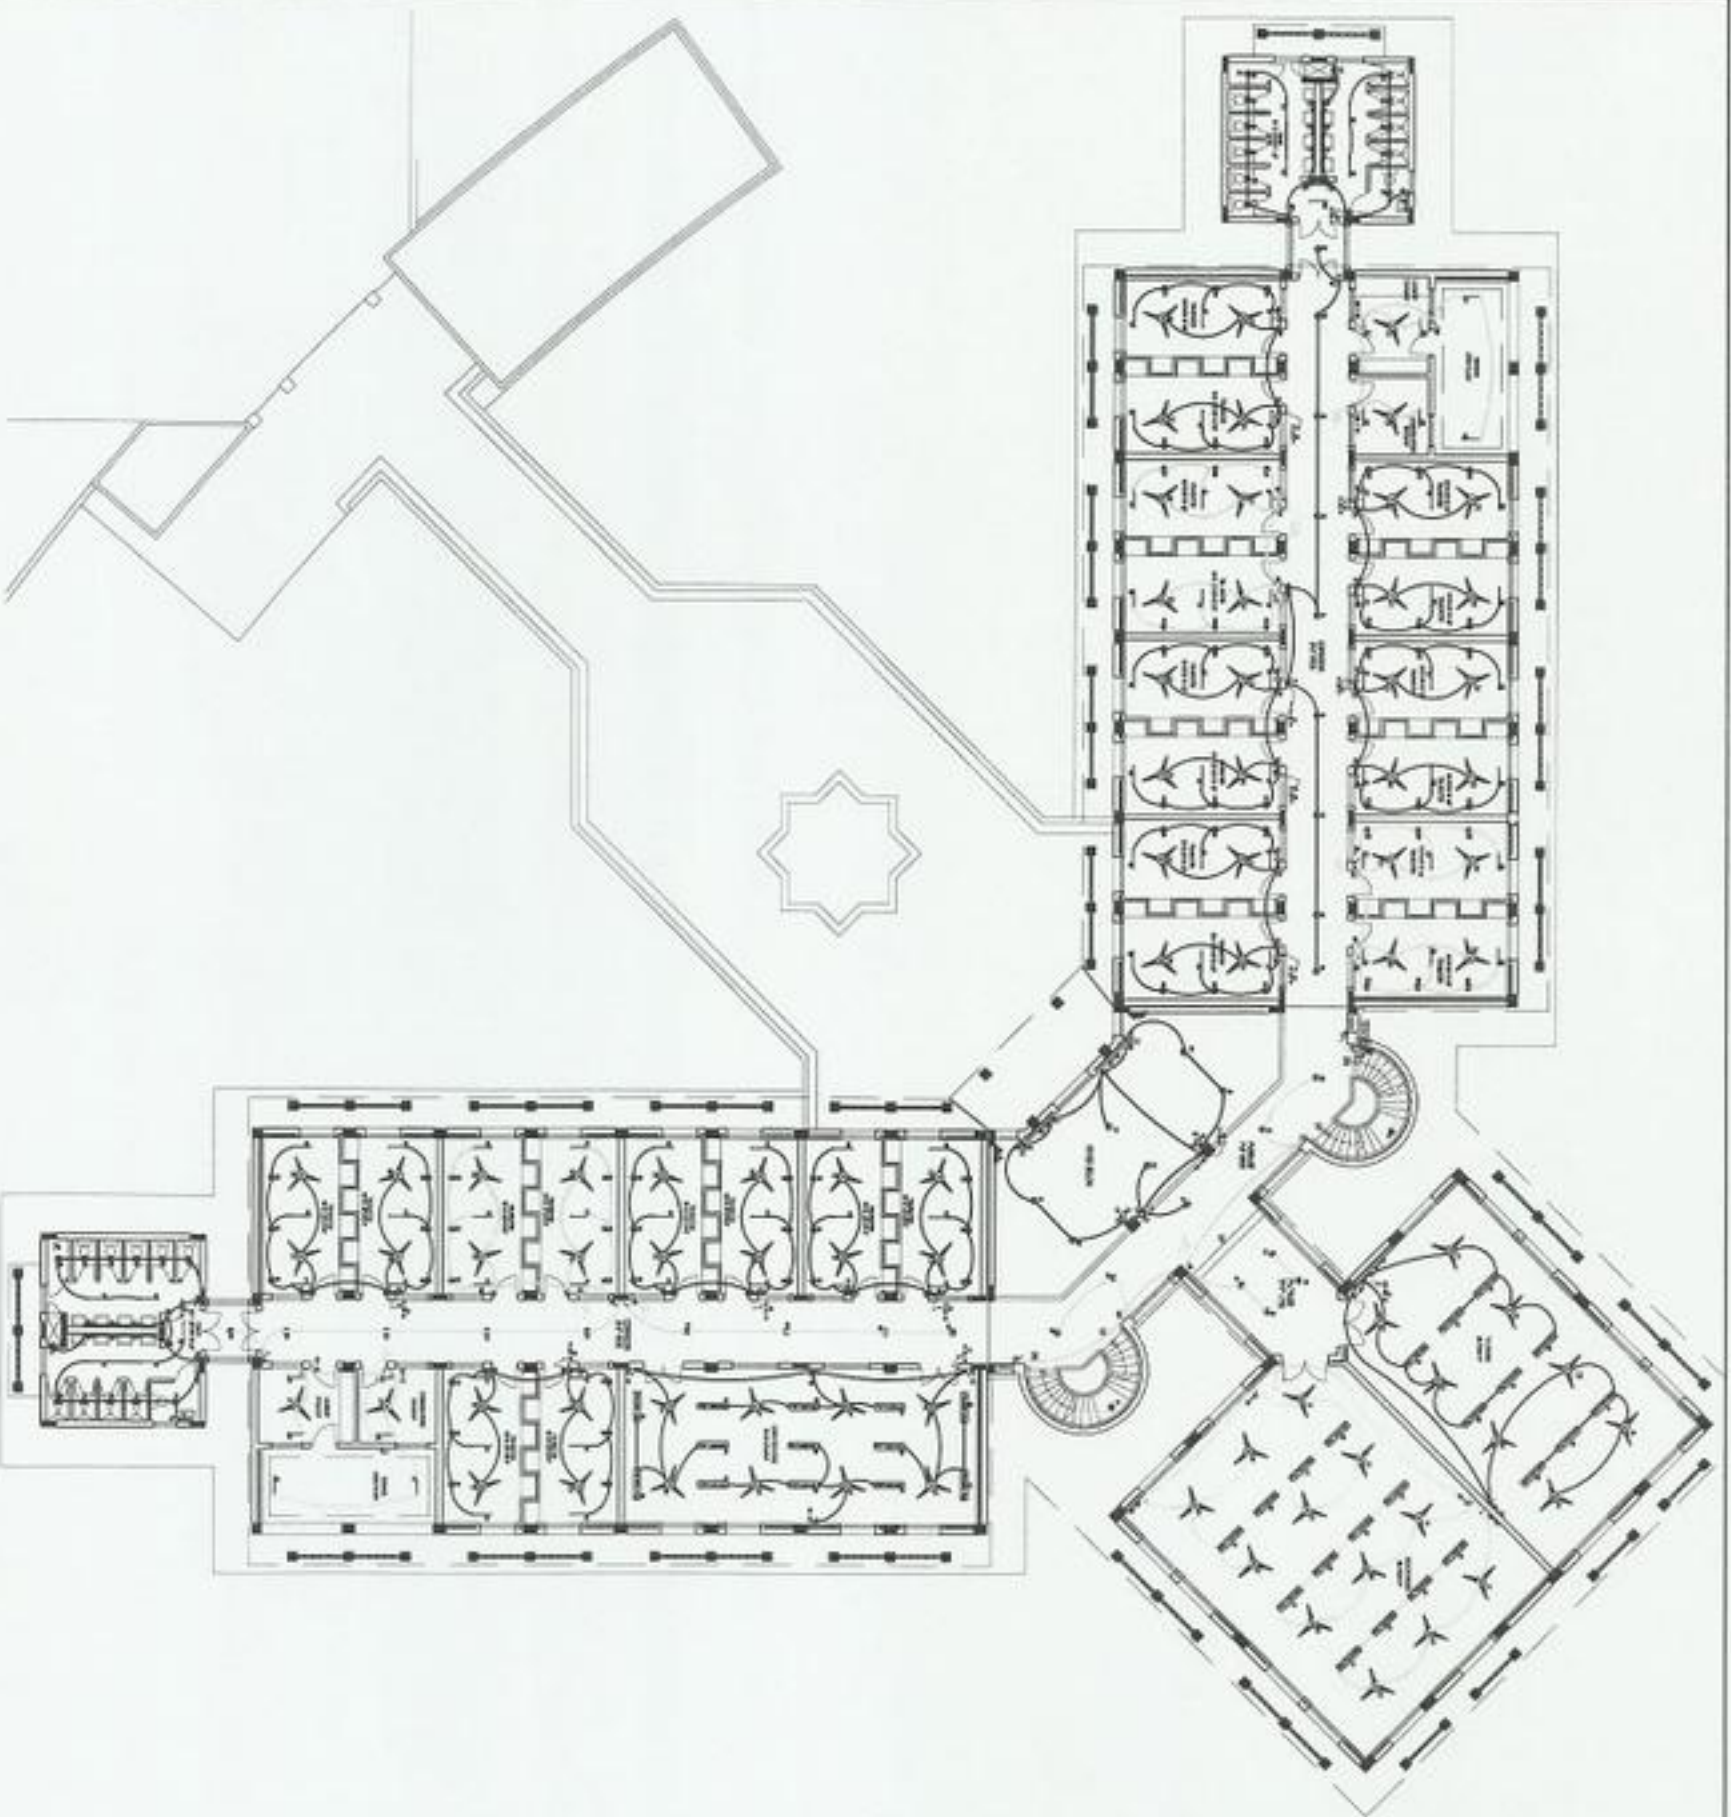

# 3.B-LEGEND

SYMBOL	DESCRIPTION	NOTES
1	RECEIVING ROOM (100-100)	100-100
2	RECEIVING ROOM (100-100)	100-100
3	RECEIVING ROOM (100-100)	100-100
4	RECEIVING ROOM (100-100)	100-100
5	RECEIVING ROOM (100-100)	100-100
6	RECEIVING ROOM (100-100)	100-100
7	RECEIVING ROOM (100-100)	100-100
8	RECEIVING ROOM (100-100)	100-100
9	RECEIVING ROOM (100-100)	100-100
10	RECEIVING ROOM (100-100)	100-100
11	RECEIVING ROOM (100-100)	100-100
12	RECEIVING ROOM (100-100)	100-100
13	RECEIVING ROOM (100-100)	100-100
14	RECEIVING ROOM (100-100)	100-100
15	RECEIVING ROOM (100-100)	100-100
16	RECEIVING ROOM (100-100)	100-100
17	RECEIVING ROOM (100-100)	100-100
18	RECEIVING ROOM (100-100)	100-100
19	RECEIVING ROOM (100-100)	100-100
20	RECEIVING ROOM (100-100)	100-100
21	RECEIVING ROOM (100-100)	100-100
22	RECEIVING ROOM (100-100)	100-100
23	RECEIVING ROOM (100-100)	100-100
24	RECEIVING ROOM (100-100)	100-100
25	RECEIVING ROOM (100-100)	100-100
26	RECEIVING ROOM (100-100)	100-100
27	RECEIVING ROOM (100-100)	100-100
28	RECEIVING ROOM (100-100)	100-100
29	RECEIVING ROOM (100-100)	100-100
30	RECEIVING ROOM (100-100)	100-100
31	RECEIVING ROOM (100-100)	100-100
32	RECEIVING ROOM (100-100)	100-100
33	RECEIVING ROOM (100-100)	100-100
34	RECEIVING ROOM (100-100)	100-100
35	RECEIVING ROOM (100-100)	100-100
36	RECEIVING ROOM (100-100)	100-100
37	RECEIVING ROOM (100-100)	100-100
38	RECEIVING ROOM (100-100)	100-100
39	RECEIVING ROOM (100-100)	100-100
40	RECEIVING ROOM (100-100)	100-100
41	RECEIVING ROOM (100-100)	100-100
42	RECEIVING ROOM (100-100)	100-100
43	RECEIVING ROOM (100-100)	100-100
44	RECEIVING ROOM (100-100)	100-100
45	RECEIVING ROOM (100-100)	100-100
46	RECEIVING ROOM (100-100)	100-100
47	RECEIVING ROOM (100-100)	100-100
48	RECEIVING ROOM (100-100)	100-100
49	RECEIVING ROOM (100-100)	100-100
50	RECEIVING ROOM (100-100)	100-100
51	RECEIVING ROOM (100-100)	100-100
52	RECEIVING ROOM (100-100)	100-100
53	RECEIVING ROOM (100-100)	100-100
54	RECEIVING ROOM (100-100)	100-100
55	RECEIVING ROOM (100-100)	100-100
56	RECEIVING ROOM (100-100)	100-100
57	RECEIVING ROOM (100-100)	100-100
58	RECEIVING ROOM (100-100)	100-100
59	RECEIVING ROOM (100-100)	100-100
60	RECEIVING ROOM (100-100)	100-100
61	RECEIVING ROOM (100-100)	100-100
62	RECEIVING ROOM (100-100)	100-100
63	RECEIVING ROOM (100-100)	100-100
64	RECEIVING ROOM (100-100)	100-100
65	RECEIVING ROOM (100-100)	100-100
66	RECEIVING ROOM (100-100)	100-100
67	RECEIVING ROOM (100-100)	100-100
68	RECEIVING ROOM (100-100)	100-100
69	RECEIVING ROOM (100-100)	100-100
70	RECEIVING ROOM (100-100)	100-100
71	RECEIVING ROOM (100-100)	100-100
72	RECEIVING ROOM (100-100)	100-100
73	RECEIVING ROOM (100-100)	100-100
74	RECEIVING ROOM (100-100)	100-100
75	RECEIVING ROOM (100-100)	100-100
76	RECEIVING ROOM (100-100)	100-100
77	RECEIVING ROOM (100-100)	100-100
78	RECEIVING ROOM (100-100)	100-100
79	RECEIVING ROOM (100-100)	100-100
80	RECEIVING ROOM (100-100)	100-100
81	RECEIVING ROOM (100-100)	100-100
82	RECEIVING ROOM (100-100)	100-100
83	RECEIVING ROOM (100-100)	100-100
84	RECEIVING ROOM (100-100)	100-100
85	RECEIVING ROOM (100-100)	100-100
86	RECEIVING ROOM (100-100)	100-100
87	RECEIVING ROOM (100-100)	100-100
88	RECEIVING ROOM (100-100)	100-100
89	RECEIVING ROOM (100-100)	100-100
90	RECEIVING ROOM (100-100)	100-100
91	RECEIVING ROOM (100-100)	100-100
92	RECEIVING ROOM (100-100)	100-100
93	RECEIVING ROOM (100-100)	100-100
94	RECEIVING ROOM (100-100)	100-100
95	RECEIVING ROOM (100-100)	100-100
96	RECEIVING ROOM (100-100)	100-100
97	RECEIVING ROOM (100-100)	100-100
98	RECEIVING ROOM (100-100)	100-100
99	RECEIVING ROOM (100-100)	100-100
100	RECEIVING ROOM (100-100)	100-100

## TITLE

LIGHTING LAYOUT -  
FIRST FLOOR

## PROJECT

GIRLS HOSTEL NO.03  
MEHRAN UNIVERSITY  
OF ENGINEERING  
& TECHNOLOGY, JAMSHORO

## DESIGNED BY :

ENGR. ABDUL JABBAR ABRO

## DESIGNED BY :

09/09/2013

## SCALE

N.T.S


## DATE

15-03-2013

CHARTERED  
NAQVI AND SIDDIQUI  
ARCHITECTS & ENGINEERS  
PVT. LTD.  
100, 101, 102, 103, 104, 105, 106, 107, 108, 109, 110, 111, 112, 113, 114, 115, 116, 117, 118, 119, 120, 121, 122, 123, 124, 125, 126, 127, 128, 129, 130, 131, 132, 133, 134, 135, 136, 137, 138, 139, 140, 141, 142, 143, 144, 145, 146, 147, 148, 149, 150, 151, 152, 153, 154, 155, 156, 157, 158, 159, 160, 161, 162, 163, 164, 165, 166, 167, 168, 169, 170, 171, 172, 173, 174, 175, 176, 177, 178, 179, 180, 181, 182, 183, 184, 185, 186, 187, 188, 189, 190, 191, 192, 193, 194, 195, 196, 197, 198, 199, 200, 201, 202, 203, 204, 205, 206, 207, 208, 209, 210, 211, 212, 213, 214, 215, 216, 217, 218, 219, 220, 221, 222, 223, 224, 225, 226, 227, 228, 229, 230, 231, 232, 233, 234, 235, 236, 237, 238, 239, 240, 241, 242, 243, 244, 245, 246, 247, 248, 249, 250, 251, 252, 253, 254, 255, 256, 257, 258, 259, 260, 261, 262, 263, 264, 265, 266, 267, 268, 269, 270, 271, 272, 273, 274, 275, 276, 277, 278, 279, 280, 281, 282, 283, 284, 285, 286, 287, 288, 289, 290, 291, 292, 293, 294, 295, 296, 297, 298, 299, 300, 301, 302, 303, 304, 305, 306, 307, 308, 309, 310, 311, 312, 313, 314, 315, 316, 317, 318, 319, 320, 321, 322, 323, 324, 325, 326, 327, 328, 329, 330, 331, 332, 333, 334, 335, 336, 337, 338, 339, 340, 341, 342, 343, 344, 345, 346, 347, 348, 349, 350, 351, 352, 353, 354, 355, 356, 357, 358, 359, 360, 361, 362, 363, 364, 365, 366, 367, 368, 369, 370, 371, 372, 373, 374, 375, 376, 377, 378, 379, 380, 381, 382, 383, 384, 385, 386, 387, 388, 389, 390, 391, 392, 393, 394, 395, 396, 397, 398, 399, 400, 401, 402, 403, 404, 405, 406, 407, 408, 409, 410, 411, 412, 413, 414, 415, 416, 417, 418, 419, 420, 421, 422, 423, 424, 425, 426, 427, 428, 429, 430, 431, 432, 433, 434, 435, 436, 437, 438, 439, 440, 441, 442, 443, 444, 445, 446, 447, 448, 449, 450, 451, 452, 453, 454, 455, 456, 457, 458, 459, 460, 461, 462, 463, 464, 465, 466, 467, 468, 469, 470, 471, 472, 473, 474, 475, 476, 477, 478, 479, 480, 481, 482, 483, 484, 485, 486, 487, 488, 489, 490, 491, 492, 493, 494, 495, 496, 497, 498, 499, 500, 501, 502, 503, 504, 505, 506, 507, 508, 509, 510, 511, 512, 513, 514, 515, 516, 517, 518, 519, 520, 521, 522, 523, 524, 525, 526, 527, 528, 529, 530, 531, 532, 533, 534, 535, 536, 537, 538, 539, 540, 541, 542, 543, 544, 545, 546, 547, 548, 549, 550, 551, 552, 553, 554, 555, 556, 557, 558, 559, 560, 561, 562, 563, 564, 565, 566, 567, 568, 569, 570, 571, 572, 573, 574, 575, 576, 577, 578, 579, 580, 581, 582, 583, 584, 585, 586, 587, 588, 589, 590, 591, 592, 593, 594, 595, 596, 597, 598, 599, 600, 601, 602, 603, 604, 605, 606, 607, 608, 609, 610, 611, 612, 613, 614, 615, 616, 617, 618, 619, 620, 621, 622, 623, 624, 625, 626, 627, 628, 629, 630, 631, 632, 633, 634, 635, 636, 637, 638, 639, 640, 641, 642, 643, 644, 645, 646, 647, 648, 649, 650, 651, 652, 653, 654, 655, 656, 657, 658, 659, 660, 661, 662, 663, 664, 665, 666, 667, 668, 669, 670, 671, 672, 673, 674, 675, 676, 677, 678, 679, 680, 681, 682, 683, 684, 685, 686, 687, 688, 689, 690, 691, 692, 693, 694, 695, 696, 697, 698, 699, 700, 701, 702, 703, 704, 705, 706, 707, 708, 709, 710, 711, 712, 713, 714, 715, 716, 717, 718, 719, 720, 721, 722, 723, 724, 725, 726, 727, 728, 729, 730, 731, 732, 733, 734, 735, 736, 737, 738, 739, 740, 741, 742, 743, 744, 745, 746, 747, 748, 749, 750, 751, 752, 753, 754, 755, 756, 757, 758, 759, 760, 761, 762, 763, 764, 765, 766, 767, 768, 769, 770, 771, 772, 773, 774, 775, 776, 777, 778, 779, 780, 781, 782, 783, 784, 785, 786, 787, 788, 789, 790, 791, 792, 793, 794, 795, 796, 797, 798, 799, 800, 801, 802, 803, 804, 805, 806, 807, 808, 809, 810, 811, 812, 813, 814, 815, 816, 817, 818, 819, 820, 821, 822, 823, 824, 825, 826, 827, 828, 829, 830, 831, 832, 833, 834, 835, 836, 837, 838, 839, 840, 841, 842, 843, 844, 845, 846, 847, 848, 849, 850, 851, 852, 853, 854, 855, 856, 857, 858, 859, 860, 861, 862, 863, 864, 865, 866, 867, 868, 869, 870, 871, 872, 873, 874, 875, 876, 877, 878, 879, 880, 881, 882, 883, 884, 885, 886, 887, 888, 889, 890, 891, 892, 893, 894, 895, 896, 897, 898, 899, 900, 901, 902, 903, 904, 905, 906, 907, 908, 909, 910, 911, 912, 913, 914, 915, 916, 917, 918, 919, 920, 921, 922, 923, 924, 925, 926, 927, 928, 929, 930, 931, 932, 933, 934, 935, 936, 937, 938, 939, 940, 941, 942, 943, 944, 945, 946, 947, 948, 949, 950, 951, 952, 953, 954, 955, 956, 957, 958, 959, 960, 961, 962, 963, 964, 965, 966, 967, 968, 969, 970, 971, 972, 973, 974, 975, 976, 977, 978, 979, 980, 981, 982, 983, 984, 985, 986, 987, 988, 989, 990, 991, 992, 993, 994, 995, 996, 997, 998, 999, 1000





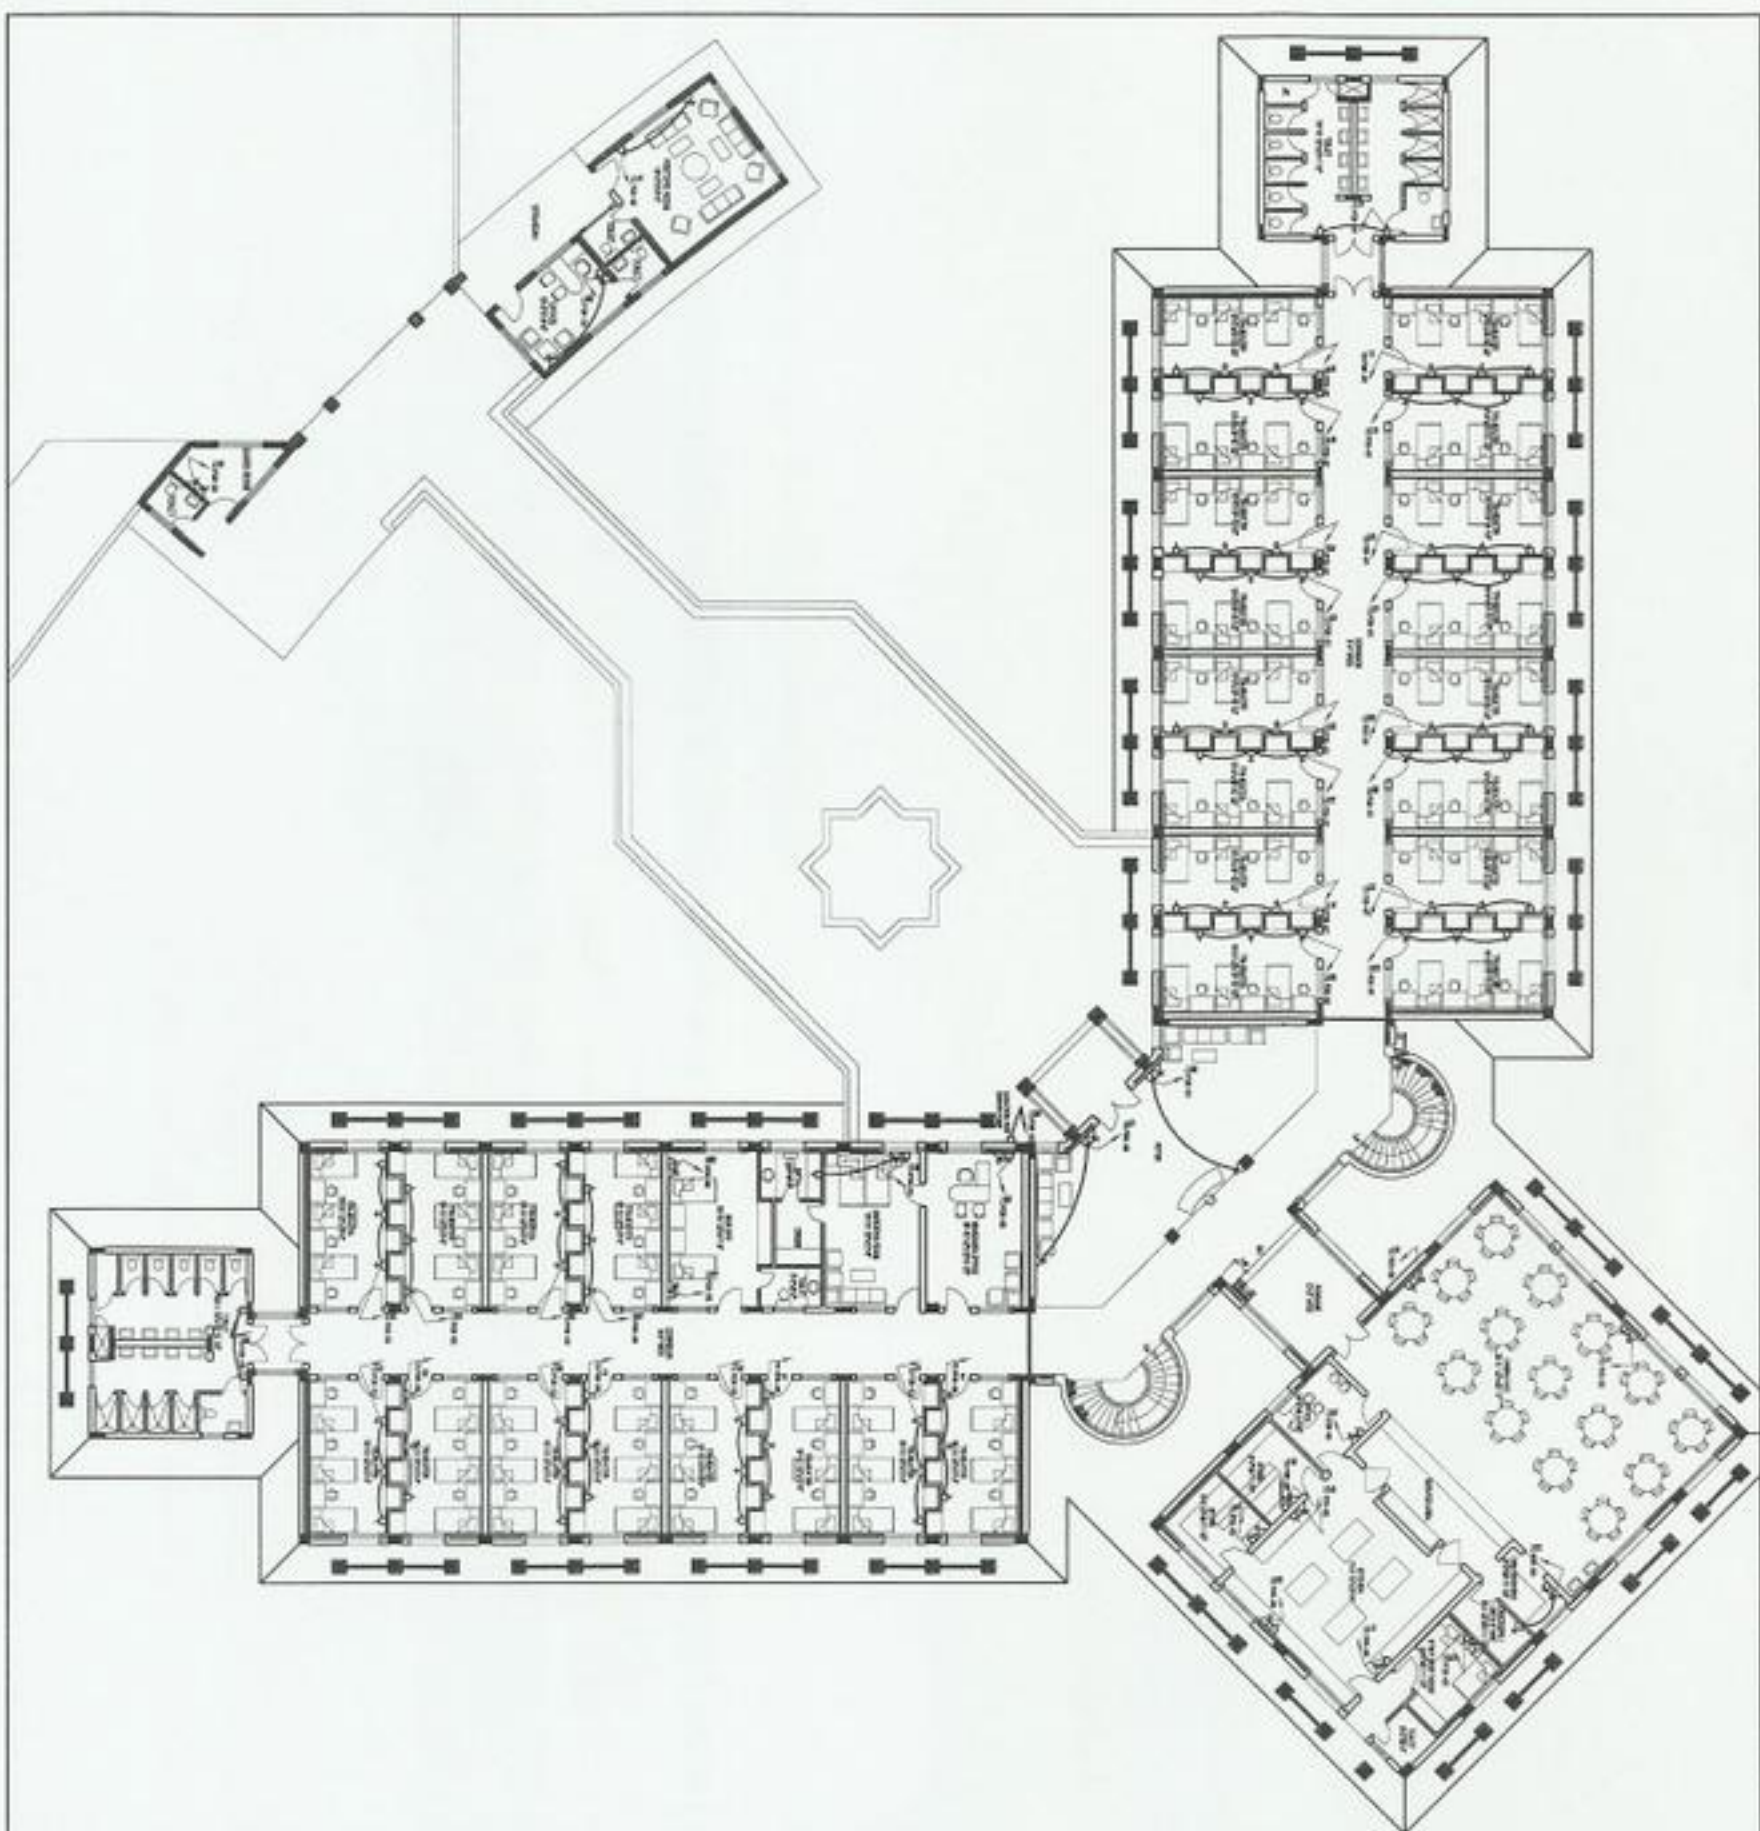

**SUB-LEGEND**

SYMBOL	DESCRIPTION	NOTATION
D+	1. 10' x 10' x 10' (10' x 10' x 10')	1'-0"
D-	2. 10' x 10' x 10' (10' x 10' x 10')	1'-0"
W	3. 10' x 10' x 10' (10' x 10' x 10')	1'-0"
W	4. 10' x 10' x 10' (10' x 10' x 10')	1'-0"
W	5. 10' x 10' x 10' (10' x 10' x 10')	1'-0"

**TITLE**  
GENERAL POWER  
LAYOUT  
OF GROUND FLOOR

**PROJECT**  
GIRLS HOSTEL, NO. 03  
MEHRAN UNIVERSITY  
OF ENGINEERING  
& TECHNOLOGY, JAMSHORO

**DESIGNED BY :**  
ENGR. ABDUL JABBAR ARSO

**DESIGNED BY :**  
PROJECT NO.  
Owais Khatri  
009/2013

**SCALE**  
N.T.S.  
DRAWING NO.  
E-04

**DATE**  
19-03-2013




**CONSULTANT**  
K. H. ENGINEERING & TECHNOLOGY  
PVT. LTD.  
100, 101, 102, 103, 104, 105, 106, 107, 108, 109, 110, 111, 112, 113, 114, 115, 116, 117, 118, 119, 120, 121, 122, 123, 124, 125, 126, 127, 128, 129, 130, 131, 132, 133, 134, 135, 136, 137, 138, 139, 140, 141, 142, 143, 144, 145, 146, 147, 148, 149, 150, 151, 152, 153, 154, 155, 156, 157, 158, 159, 160, 161, 162, 163, 164, 165, 166, 167, 168, 169, 170, 171, 172, 173, 174, 175, 176, 177, 178, 179, 180, 181, 182, 183, 184, 185, 186, 187, 188, 189, 190, 191, 192, 193, 194, 195, 196, 197, 198, 199, 200, 201, 202, 203, 204, 205, 206, 207, 208, 209, 210, 211, 212, 213, 214, 215, 216, 217, 218, 219, 220, 221, 222, 223, 224, 225, 226, 227, 228, 229, 230, 231, 232, 233, 234, 235, 236, 237, 238, 239, 240, 241, 242, 243, 244, 245, 246, 247, 248, 249, 250, 251, 252, 253, 254, 255, 256, 257, 258, 259, 260, 261, 262, 263, 264, 265, 266, 267, 268, 269, 270, 271, 272, 273, 274, 275, 276, 277, 278, 279, 280, 281, 282, 283, 284, 285, 286, 287, 288, 289, 290, 291, 292, 293, 294, 295, 296, 297, 298, 299, 300, 301, 302, 303, 304, 305, 306, 307, 308, 309, 310, 311, 312, 313, 314, 315, 316, 317, 318, 319, 320, 321, 322, 323, 324, 325, 326, 327, 328, 329, 330, 331, 332, 333, 334, 335, 336, 337, 338, 339, 340, 341, 342, 343, 344, 345, 346, 347, 348, 349, 350, 351, 352, 353, 354, 355, 356, 357, 358, 359, 360, 361, 362, 363, 364, 365, 366, 367, 368, 369, 370, 371, 372, 373, 374, 375, 376, 377, 378, 379, 380, 381, 382, 383, 384, 385, 386, 387, 388, 389, 390, 391, 392, 393, 394, 395, 396, 397, 398, 399, 400, 401, 402, 403, 404, 405, 406, 407, 408, 409, 410, 411, 412, 413, 414, 415, 416, 417, 418, 419, 420, 421, 422, 423, 424, 425, 426, 427, 428, 429, 430, 431, 432, 433, 434, 435, 436, 437, 438, 439, 440, 441, 442, 443, 444, 445, 446, 447, 448, 449, 450, 451, 452, 453, 454, 455, 456, 457, 458, 459, 460, 461, 462, 463, 464, 465, 466, 467, 468, 469, 470, 471, 472, 473, 474, 475, 476, 477, 478, 479, 480, 481, 482, 483, 484, 485, 486, 487, 488, 489, 490, 491, 492, 493, 494, 495, 496, 497, 498, 499, 500, 501, 502, 503, 504, 505, 506, 507, 508, 509, 510, 511, 512, 513, 514, 515, 516, 517, 518, 519, 520, 521, 522, 523, 524, 525, 526, 527, 528, 529, 530, 531, 532, 533, 534, 535, 536, 537, 538, 539, 540, 541, 542, 543, 544, 545, 546, 547, 548, 549, 550, 551, 552, 553, 554, 555, 556, 557, 558, 559, 560, 561, 562, 563, 564, 565, 566, 567, 568, 569, 570, 571, 572, 573, 574, 575, 576, 577, 578, 579, 580, 581, 582, 583, 584, 585, 586, 587, 588, 589, 590, 591, 592, 593, 594, 595, 596, 597, 598, 599, 600, 601, 602, 603, 604, 605, 606, 607, 608, 609, 610, 611, 612, 613, 614, 615, 616, 617, 618, 619, 620, 621, 622, 623, 624, 625, 626, 627, 628, 629, 630, 631, 632, 633, 634, 635, 636, 637, 638, 639, 640, 641, 642, 643, 644, 645, 646, 647, 648, 649, 650, 651, 652, 653, 654, 655, 656, 657, 658, 659, 660, 661, 662, 663, 664, 665, 666, 667, 668, 669, 670, 671, 672, 673, 674, 675, 676, 677, 678, 679, 680, 681, 682, 683, 684, 685, 686, 687, 688, 689, 690, 691, 692, 693, 694, 695, 696, 697, 698, 699, 700, 701, 702, 703, 704, 705, 706, 707, 708, 709, 710, 711, 712, 713, 714, 715, 716, 717, 718, 719, 720, 721, 722, 723, 724, 725, 726, 727, 728, 729, 730, 731, 732, 733, 734, 735, 736, 737, 738, 739, 740, 741, 742, 743, 744, 745, 746, 747, 748, 749, 750, 751, 752, 753, 754, 755, 756, 757, 758, 759, 760, 761, 762, 763, 764, 765, 766, 767, 768, 769, 770, 771, 772, 773, 774, 775, 776, 777, 778, 779, 780, 781, 782, 783, 784, 785, 786, 787, 788, 789, 790, 791, 792, 793, 794, 795, 796, 797, 798, 799, 800, 801, 802, 803, 804, 805, 806, 807, 808, 809, 810, 811, 812, 813, 814, 815, 816, 817, 818, 819, 820, 821, 822, 823, 824, 825, 826, 827, 828, 829, 830, 831, 832, 833, 834, 835, 836, 837, 838, 839, 840, 841, 842, 843, 844, 845, 846, 847, 848, 849, 850, 851, 852, 853, 854, 855, 856, 857, 858, 859, 860, 861, 862, 863, 864, 865, 866, 867, 868, 869, 870, 871, 872, 873, 874, 875, 876, 877, 878, 879, 880, 881, 882, 883, 884, 885, 886, 887, 888, 889, 890, 891, 892, 893, 894, 895, 896, 897, 898, 899, 900, 901, 902, 903, 904, 905, 906, 907, 908, 909, 910, 911, 912, 913, 914, 915, 916, 917, 918, 919, 920, 921, 922, 923, 924, 925, 926, 927, 928, 929, 930, 931, 932, 933, 934, 935, 936, 937, 938, 939, 940, 941, 942, 943, 944, 945, 946, 947, 948, 949, 950, 951, 952, 953, 954, 955, 956, 957, 958, 959, 960, 961, 962, 963, 964, 965, 966, 967, 968, 969, 970, 971, 972, 973, 974, 975, 976, 977, 978, 979, 980, 981, 982, 983, 984, 985, 986, 987, 988, 989, 990, 991, 992, 993, 994, 995, 996, 997, 998, 999, 1000.








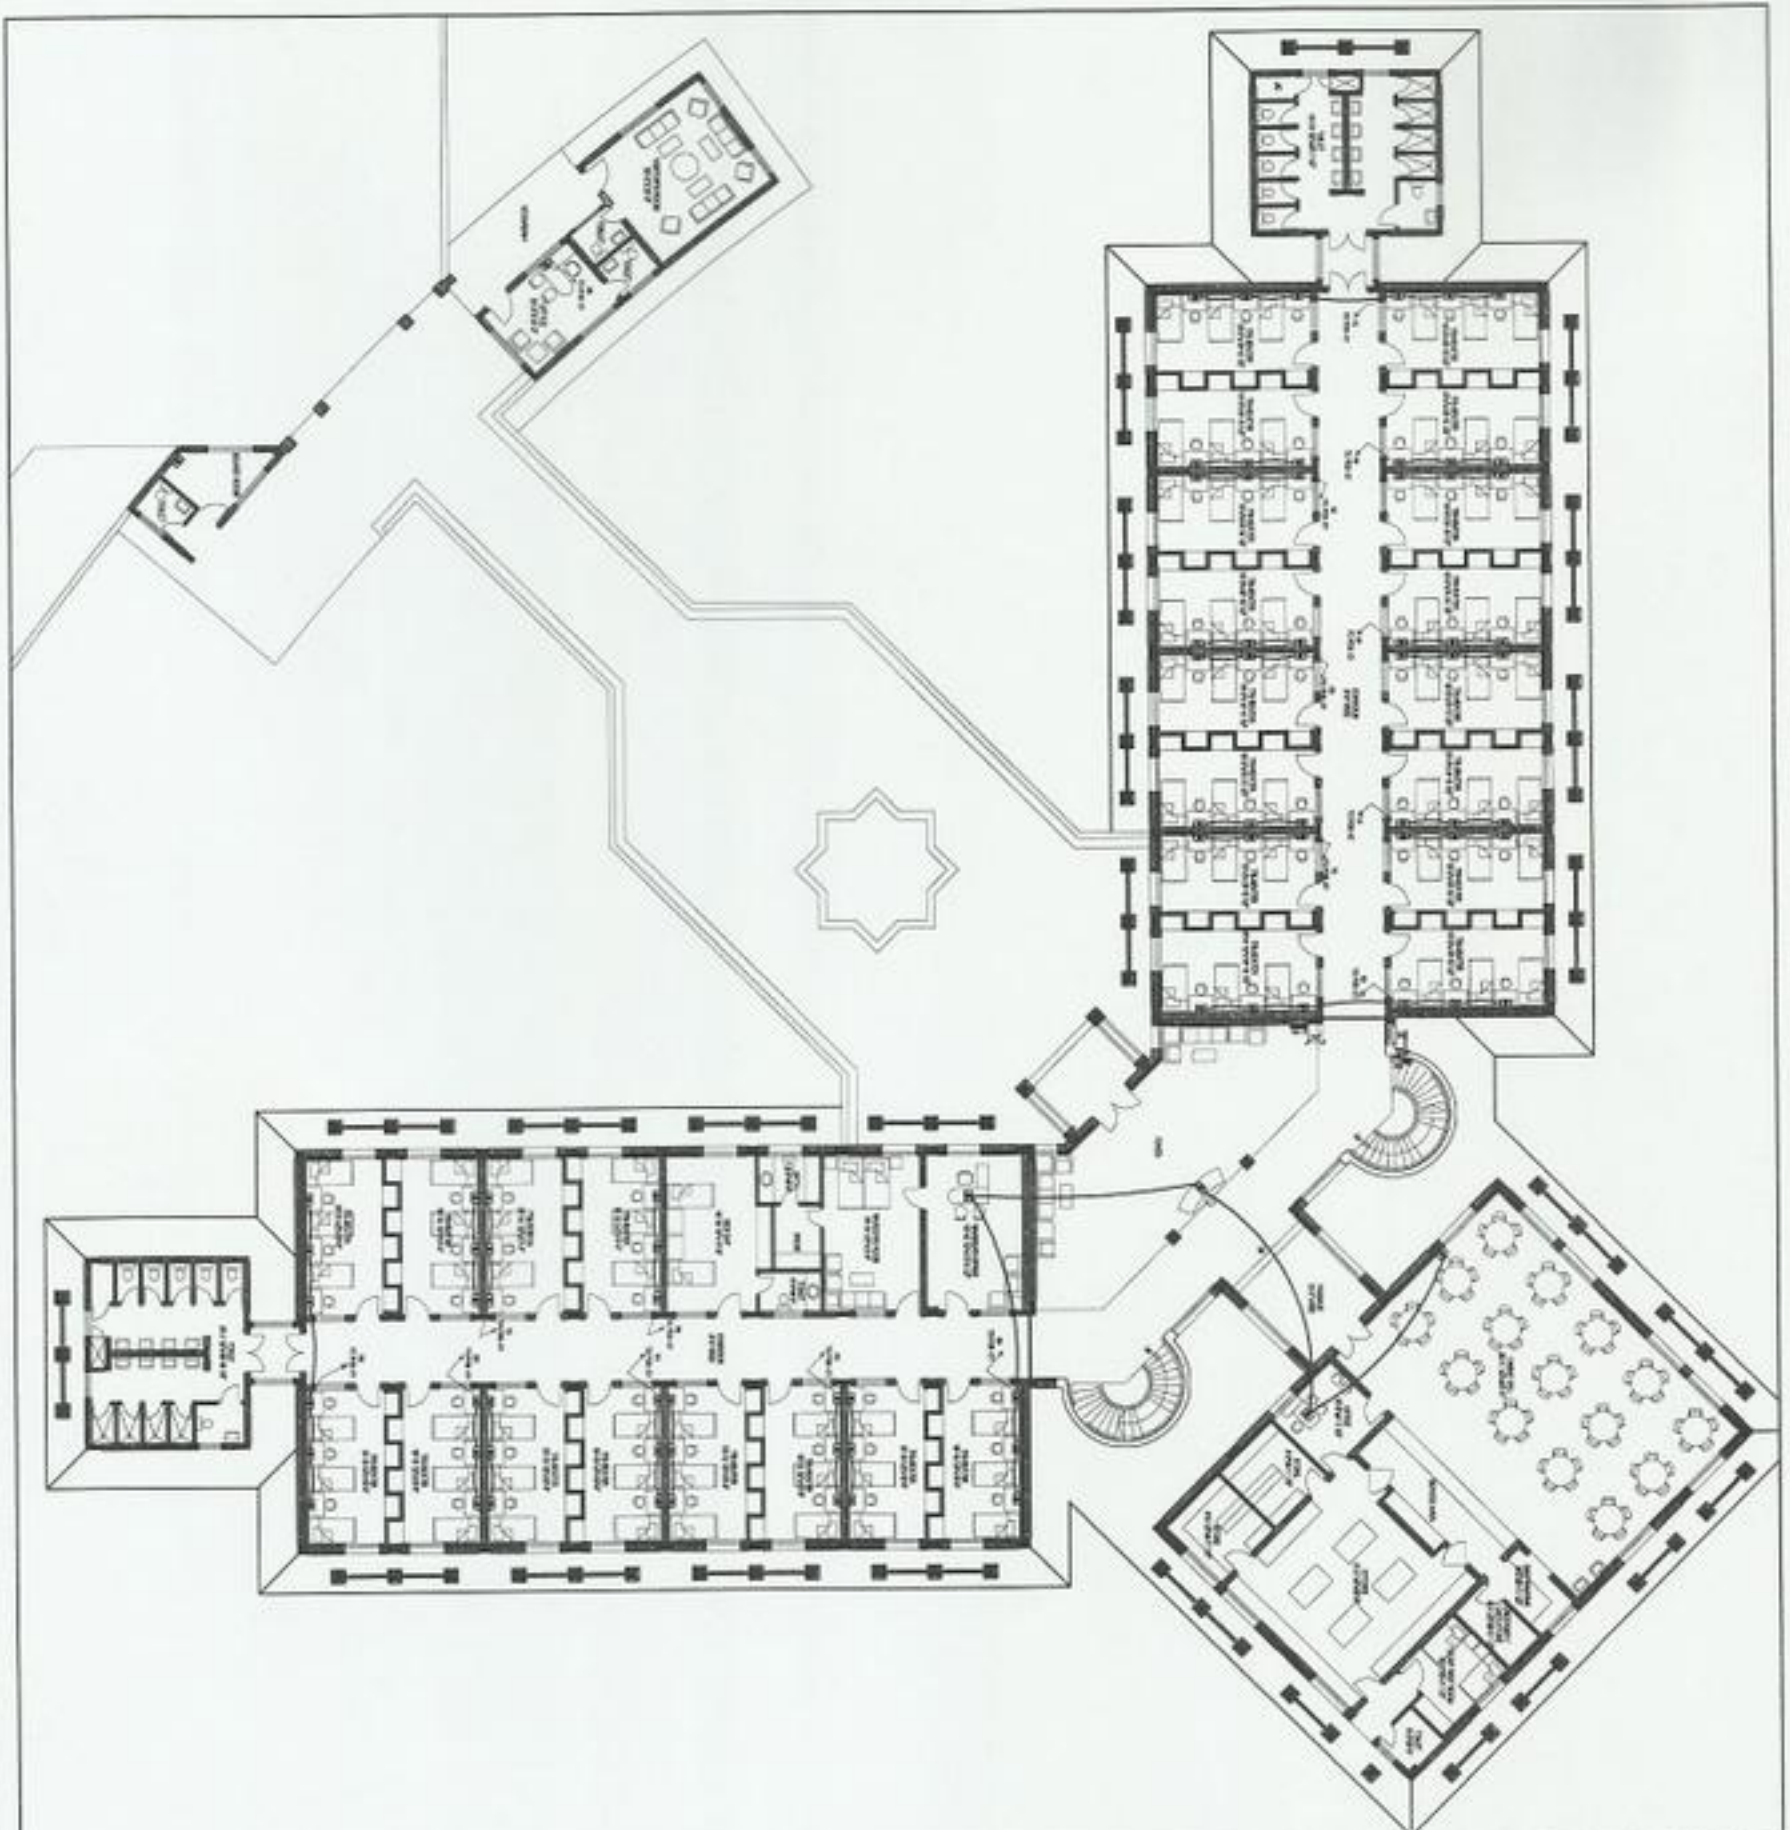

**3-B-LEGEND**

SYMBOL	DESCRIPTION	NOTES
1	DOOR	
2	WINDOW	
3	STAIR	
4	ELEVATOR	
5	TOILET	
6	SHOWER	
7	KITCHEN	
8	DINING	
9	CAFETERIA	
10	LIBRARY	
11	OFFICE	
12	CLASSROOM	
13	LABORATORY	
14	GYMNASIUM	
15	SPORTS FIELD	
16	PARKING	
17	LANDSCAPE	
18	WATER FEATURE	
19	SCULPTURE	
20	MONUMENT	
21	RELIGIOUS MONUMENT	
22	CEMETERY	
23	MAUSOLEUM	
24	MINARET	
25	MOON DOME	
26	SHRINE	
27	PRAYER AREA	
28	RELIGIOUS ART	
29	RELIGIOUS TEXT	
30	RELIGIOUS SYMBOL	
31	RELIGIOUS ORNAMENT	
32	RELIGIOUS FURNITURE	
33	RELIGIOUS EQUIPMENT	
34	RELIGIOUS SUPPLIES	
35	RELIGIOUS SERVICES	
36	RELIGIOUS EDUCATION	
37	RELIGIOUS RESEARCH	
38	RELIGIOUS PUBLICATIONS	
39	RELIGIOUS MEDIA	
40	RELIGIOUS ARTS	
41	RELIGIOUS CRAFTS	
42	RELIGIOUS FOOD	
43	RELIGIOUS DRINKS	
44	RELIGIOUS TOBACCO	
45	RELIGIOUS CLOTHING	
46	RELIGIOUS ACCESSORIES	
47	RELIGIOUS JEWELRY	
48	RELIGIOUS HAIR	
49	RELIGIOUS MAKEUP	
50	RELIGIOUS COSMETICS	
51	RELIGIOUS PERFUMES	
52	RELIGIOUS SOAP	
53	RELIGIOUS TOILET PAPER	
54	RELIGIOUS TOWELS	
55	RELIGIOUS RUGS	
56	RELIGIOUS PILLOWS	
57	RELIGIOUS BLANKETS	
58	RELIGIOUS CLOTHES	
59	RELIGIOUS SHOES	
60	RELIGIOUS BAGS	
61	RELIGIOUS CASES	
62	RELIGIOUS CONTAINERS	
63	RELIGIOUS UTENSILS	
64	RELIGIOUS VESSELS	
65	RELIGIOUS CUPBOARDS	
66	RELIGIOUS SHELVES	
67	RELIGIOUS TABLES	
68	RELIGIOUS CHAIRS	
69	RELIGIOUS BENCHES	
70	RELIGIOUS STAIRS	
71	RELIGIOUS ELEVATORS	
72	RELIGIOUS DOORS	
73	RELIGIOUS WINDOWS	
74	RELIGIOUS ROOFS	
75	RELIGIOUS WALLS	
76	RELIGIOUS FLOORS	
77	RELIGIOUS CEILINGS	
78	RELIGIOUS LIGHTING	
79	RELIGIOUS SOUND	
80	RELIGIOUS VIBRATION	
81	RELIGIOUS TEMPERATURE	
82	RELIGIOUS HUMIDITY	
83	RELIGIOUS AIR QUALITY	
84	RELIGIOUS NOISE	
85	RELIGIOUS VIBRATION	
86	RELIGIOUS TEMPERATURE	
87	RELIGIOUS HUMIDITY	
88	RELIGIOUS AIR QUALITY	
89	RELIGIOUS NOISE	
90	RELIGIOUS VIBRATION	
91	RELIGIOUS TEMPERATURE	
92	RELIGIOUS HUMIDITY	
93	RELIGIOUS AIR QUALITY	
94	RELIGIOUS NOISE	
95	RELIGIOUS VIBRATION	
96	RELIGIOUS TEMPERATURE	
97	RELIGIOUS HUMIDITY	
98	RELIGIOUS AIR QUALITY	
99	RELIGIOUS NOISE	
100	RELIGIOUS VIBRATION	



**TITLE**  
COMPUTER POWER  
LAYOUT OF  
GROUND FLOOR

**PROJECT**  
GIRLS HOSTEL NO.03  
MEHRAN UNIVERSITY  
OF ENGINEERING  
& TECHNOLOGY, JAMSHORO


**DESIGNED BY :**  
ENGR. ABDUL JABBAR ABRU

**DRAWN BY :**  
Owais Khatri

**SCALE**  
N.T.S

**DATE**  
27-03-2013

**K**  
KAS CONCEPTS  
ARCHITECTURE & INTERIOR DESIGN  
PVT. LTD.  
101, 102, 103, 104, 105, 106, 107, 108, 109, 110, 111, 112, 113, 114, 115, 116, 117, 118, 119, 120, 121, 122, 123, 124, 125, 126, 127, 128, 129, 130, 131, 132, 133, 134, 135, 136, 137, 138, 139, 140, 141, 142, 143, 144, 145, 146, 147, 148, 149, 150, 151, 152, 153, 154, 155, 156, 157, 158, 159, 160, 161, 162, 163, 164, 165, 166, 167, 168, 169, 170, 171, 172, 173, 174, 175, 176, 177, 178, 179, 180, 181, 182, 183, 184, 185, 186, 187, 188, 189, 190, 191, 192, 193, 194, 195, 196, 197, 198, 199, 200, 201, 202, 203, 204, 205, 206, 207, 208, 209, 210, 211, 212, 213, 214, 215, 216, 217, 218, 219, 220, 221, 222, 223, 224, 225, 226, 227, 228, 229, 230, 231, 232, 233, 234, 235, 236, 237, 238, 239, 240, 241, 242, 243, 244, 245, 246, 247, 248, 249, 250, 251, 252, 253, 254, 255, 256, 257, 258, 259, 260, 261, 262, 263, 264, 265, 266, 267, 268, 269, 270, 271, 272, 273, 274, 275, 276, 277, 278, 279, 280, 281, 282, 283, 284, 285, 286, 287, 288, 289, 290, 291, 292, 293, 294, 295, 296, 297, 298, 299, 300, 301, 302, 303, 304, 305, 306, 307, 308, 309, 310, 311, 312, 313, 314, 315, 316, 317, 318, 319, 320, 321, 322, 323, 324, 325, 326, 327, 328, 329, 330, 331, 332, 333, 334, 335, 336, 337, 338, 339, 340, 341, 342, 343, 344, 345, 346, 347, 348, 349, 350, 351, 352, 353, 354, 355, 356, 357, 358, 359, 360, 361, 362, 363, 364, 365, 366, 367, 368, 369, 370, 371, 372, 373, 374, 375, 376, 377, 378, 379, 380, 381, 382, 383, 384, 385, 386, 387, 388, 389, 390, 391, 392, 393, 394, 395, 396, 397, 398, 399, 400, 401, 402, 403, 404, 405, 406, 407, 408, 409, 410, 411, 412, 413, 414, 415, 416, 417, 418, 419, 420, 421, 422, 423, 424, 425, 426, 427, 428, 429, 430, 431, 432, 433, 434, 435, 436, 437, 438, 439, 440, 441, 442, 443, 444, 445, 446, 447, 448, 449, 450, 451, 452, 453, 454, 455, 456, 457, 458, 459, 460, 461, 462, 463, 464, 465, 466, 467, 468, 469, 470, 471, 472, 473, 474, 475, 476, 477, 478, 479, 480, 481, 482, 483, 484, 485, 486, 487, 488, 489, 490, 491, 492, 493, 494, 495, 496, 497, 498, 499, 500, 501, 502, 503, 504, 505, 506, 507, 508, 509, 510, 511, 512, 513, 514, 515, 516, 517, 518, 519, 520, 521, 522, 523, 524, 525, 526, 527, 528, 529, 530, 531, 532, 533, 534, 535, 536, 537, 538, 539, 540, 541, 542, 543, 544, 545, 546, 547, 548, 549, 550, 551, 552, 553, 554, 555, 556, 557, 558, 559, 560, 561, 562, 563, 564, 565, 566, 567, 568, 569, 570, 571, 572, 573, 574, 575, 576, 577, 578, 579, 580, 581, 582, 583, 584, 585, 586, 587, 588, 589, 590, 591, 592, 593, 594, 595, 596, 597, 598, 599, 600, 601, 602, 603, 604, 605, 606, 607, 608, 609, 610, 611, 612, 613, 614, 615, 616, 617, 618, 619, 620, 621, 622, 623, 624, 625, 626, 627, 628, 629, 630, 631, 632, 633, 634, 635, 636, 637, 638, 639, 640, 641, 642, 643, 644, 645, 646, 647, 648, 649, 650, 651, 652, 653, 654, 655, 656, 657, 658, 659, 660, 661, 662, 663, 664, 665, 666, 667, 668, 669, 670, 671, 672, 673, 674, 675, 676, 677, 678, 679, 680, 681, 682, 683, 684, 685, 686, 687, 688, 689, 690, 691, 692, 693, 694, 695, 696, 697, 698, 699, 700, 701, 702, 703, 704, 705, 706, 707, 708, 709, 710, 711, 712, 713, 714, 715, 716, 717, 718, 719, 720, 721, 722, 723, 724, 725, 726, 727, 728, 729, 730, 731, 732, 733, 734, 735, 736, 737, 738, 739, 740, 741, 742, 743, 744, 745, 746, 747, 748, 749, 750, 751, 752, 753, 754, 755, 756, 757, 758, 759, 760, 761, 762, 763, 764, 765, 766, 767, 768, 769, 770, 771, 772, 773, 774, 775, 776, 777, 778, 779, 780, 781, 782, 783, 784, 785, 786, 787, 788, 789, 790, 791, 792, 793, 794,

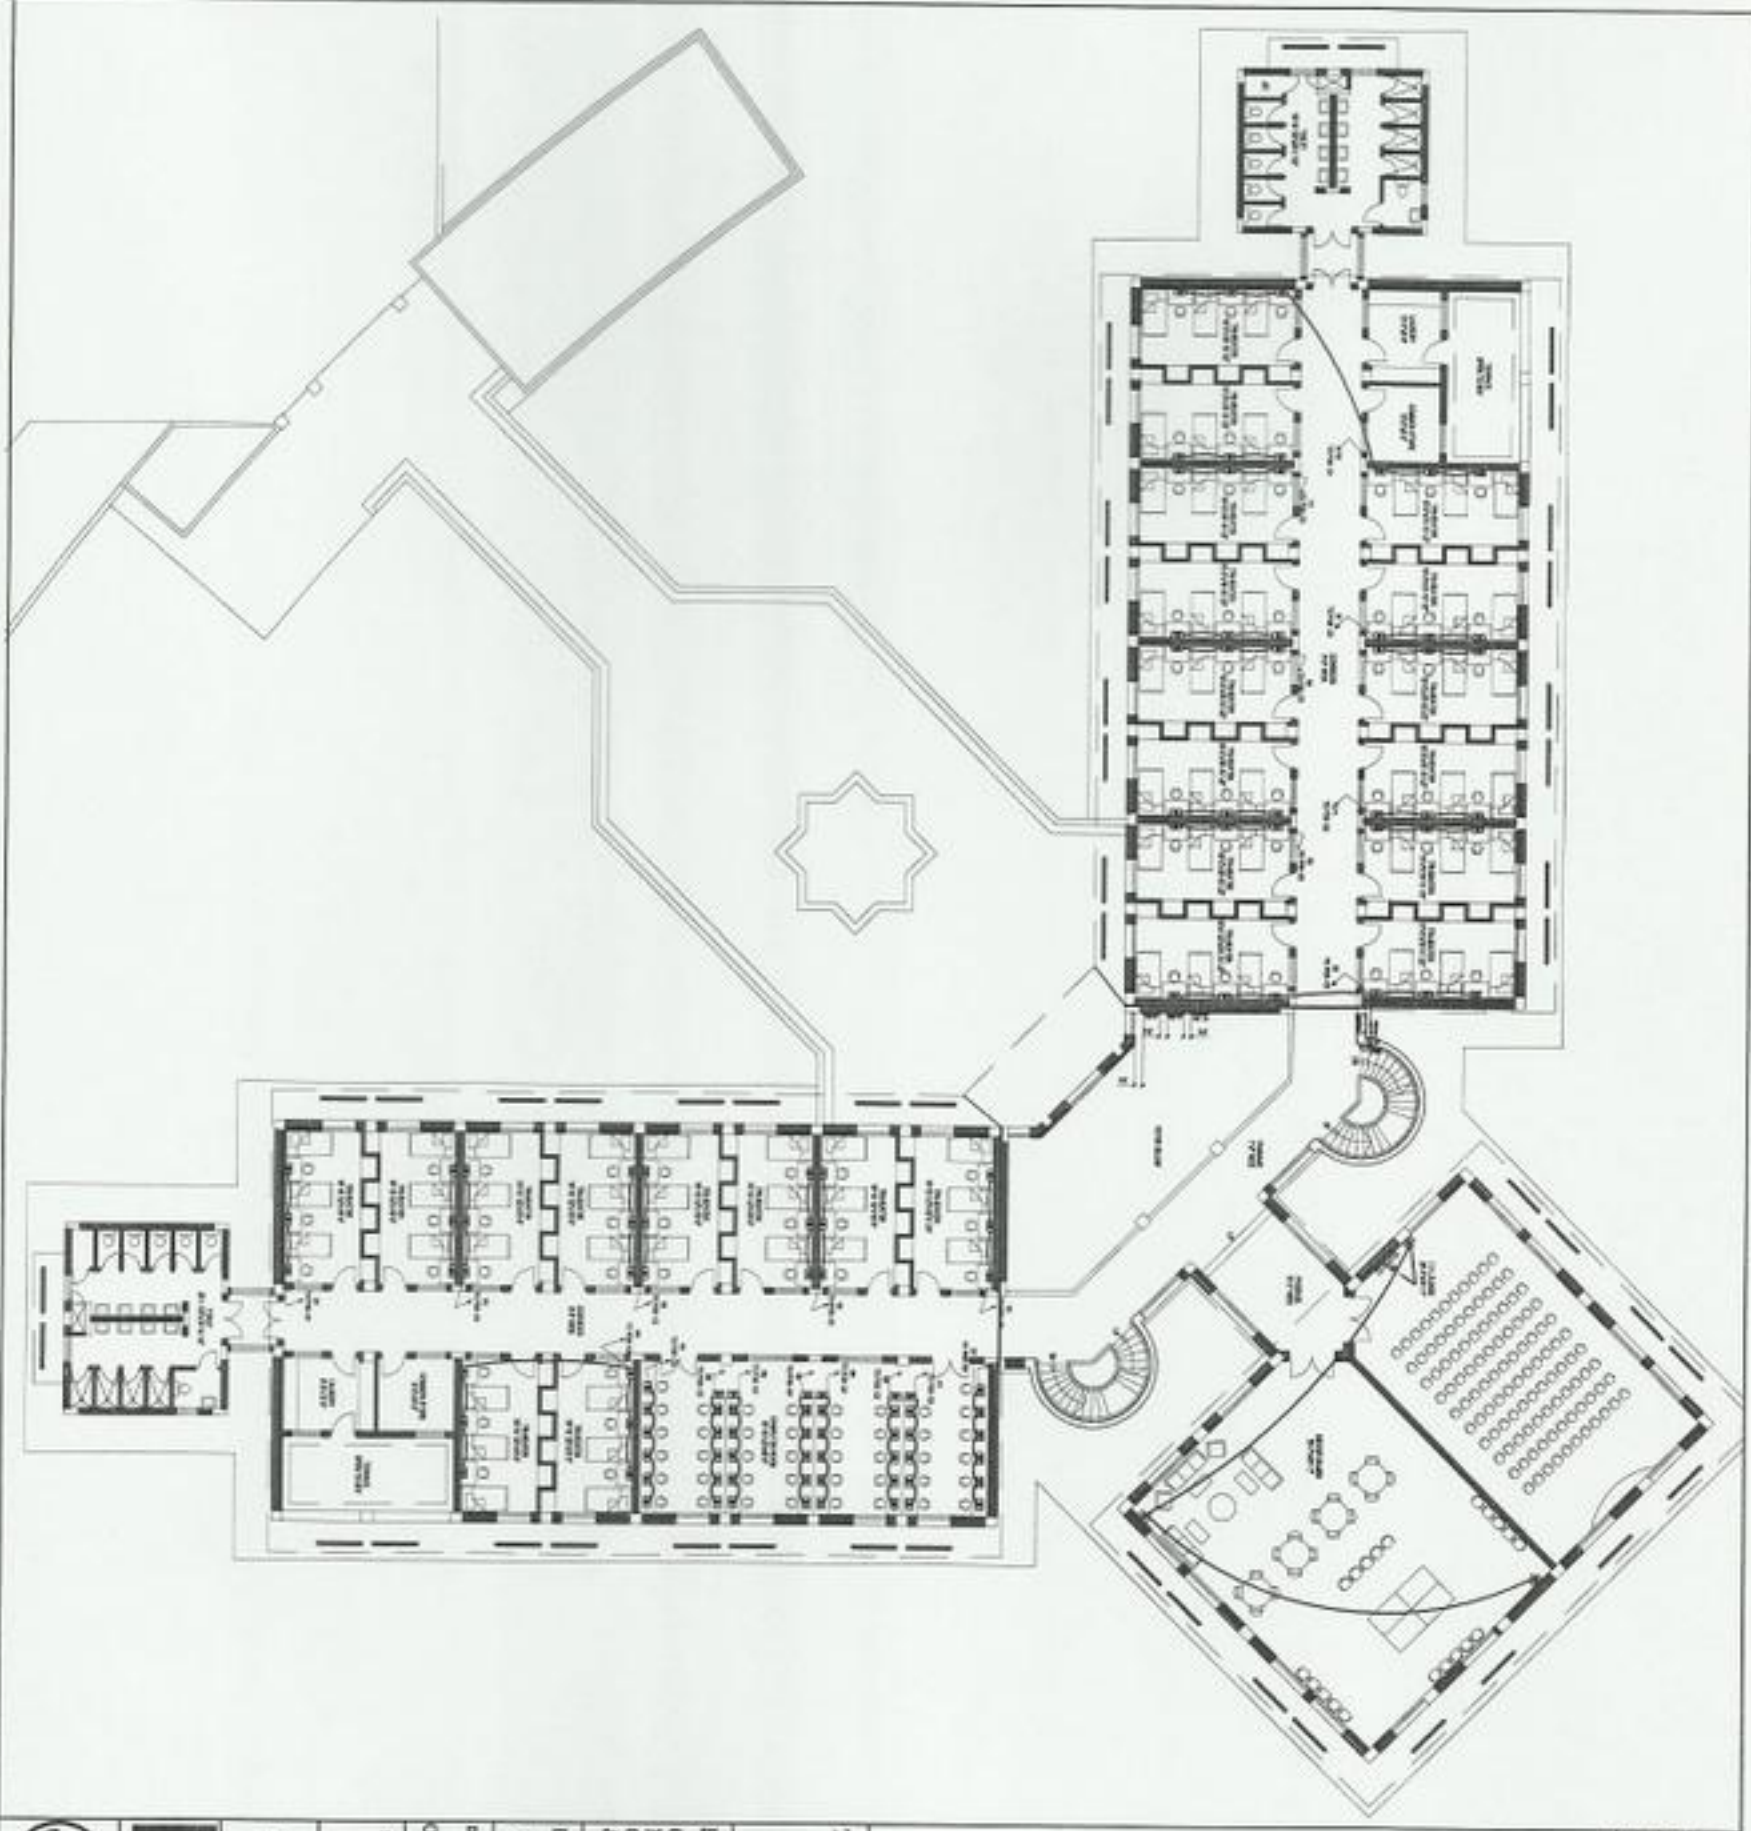

**SIB-LEGEND**

SYMBOL	DESCRIPTION	REMARKS
[Symbol]	DOOR	
[Symbol]	WINDOW	
[Symbol]	STAIR	
[Symbol]	TOILET	
[Symbol]	WATER	
[Symbol]	WATER	



**TITLE**

**COMPUTER POWER  
LAYOUT OF  
FIRST FLOOR**

**PROJECT**

GHS HOSTEL NO.03  
MEHRAN UNIVERSITY  
OF ENGINEERING  
& TECHNOLOGY, JAMSHORO

**DESIGNED BY :**

ENGR. ABDUL JABBAR ABBO

**DESIGNED BY :**

Owais Khatri

**PROJECT NO.**

009/2013

**SCALE**

N.T.S

**DATE:**


31-03-2013

**MEHRAAN UNIVERSITY**  
JAMSHORO  
SCHOOL OF DISTANCE EDUCATION  
JAMSHORO  
P.O. BOX 1000  
JAMSHORO  
GUJARAT  
INDIA  
WWW.MUJAMSHORO.EDU








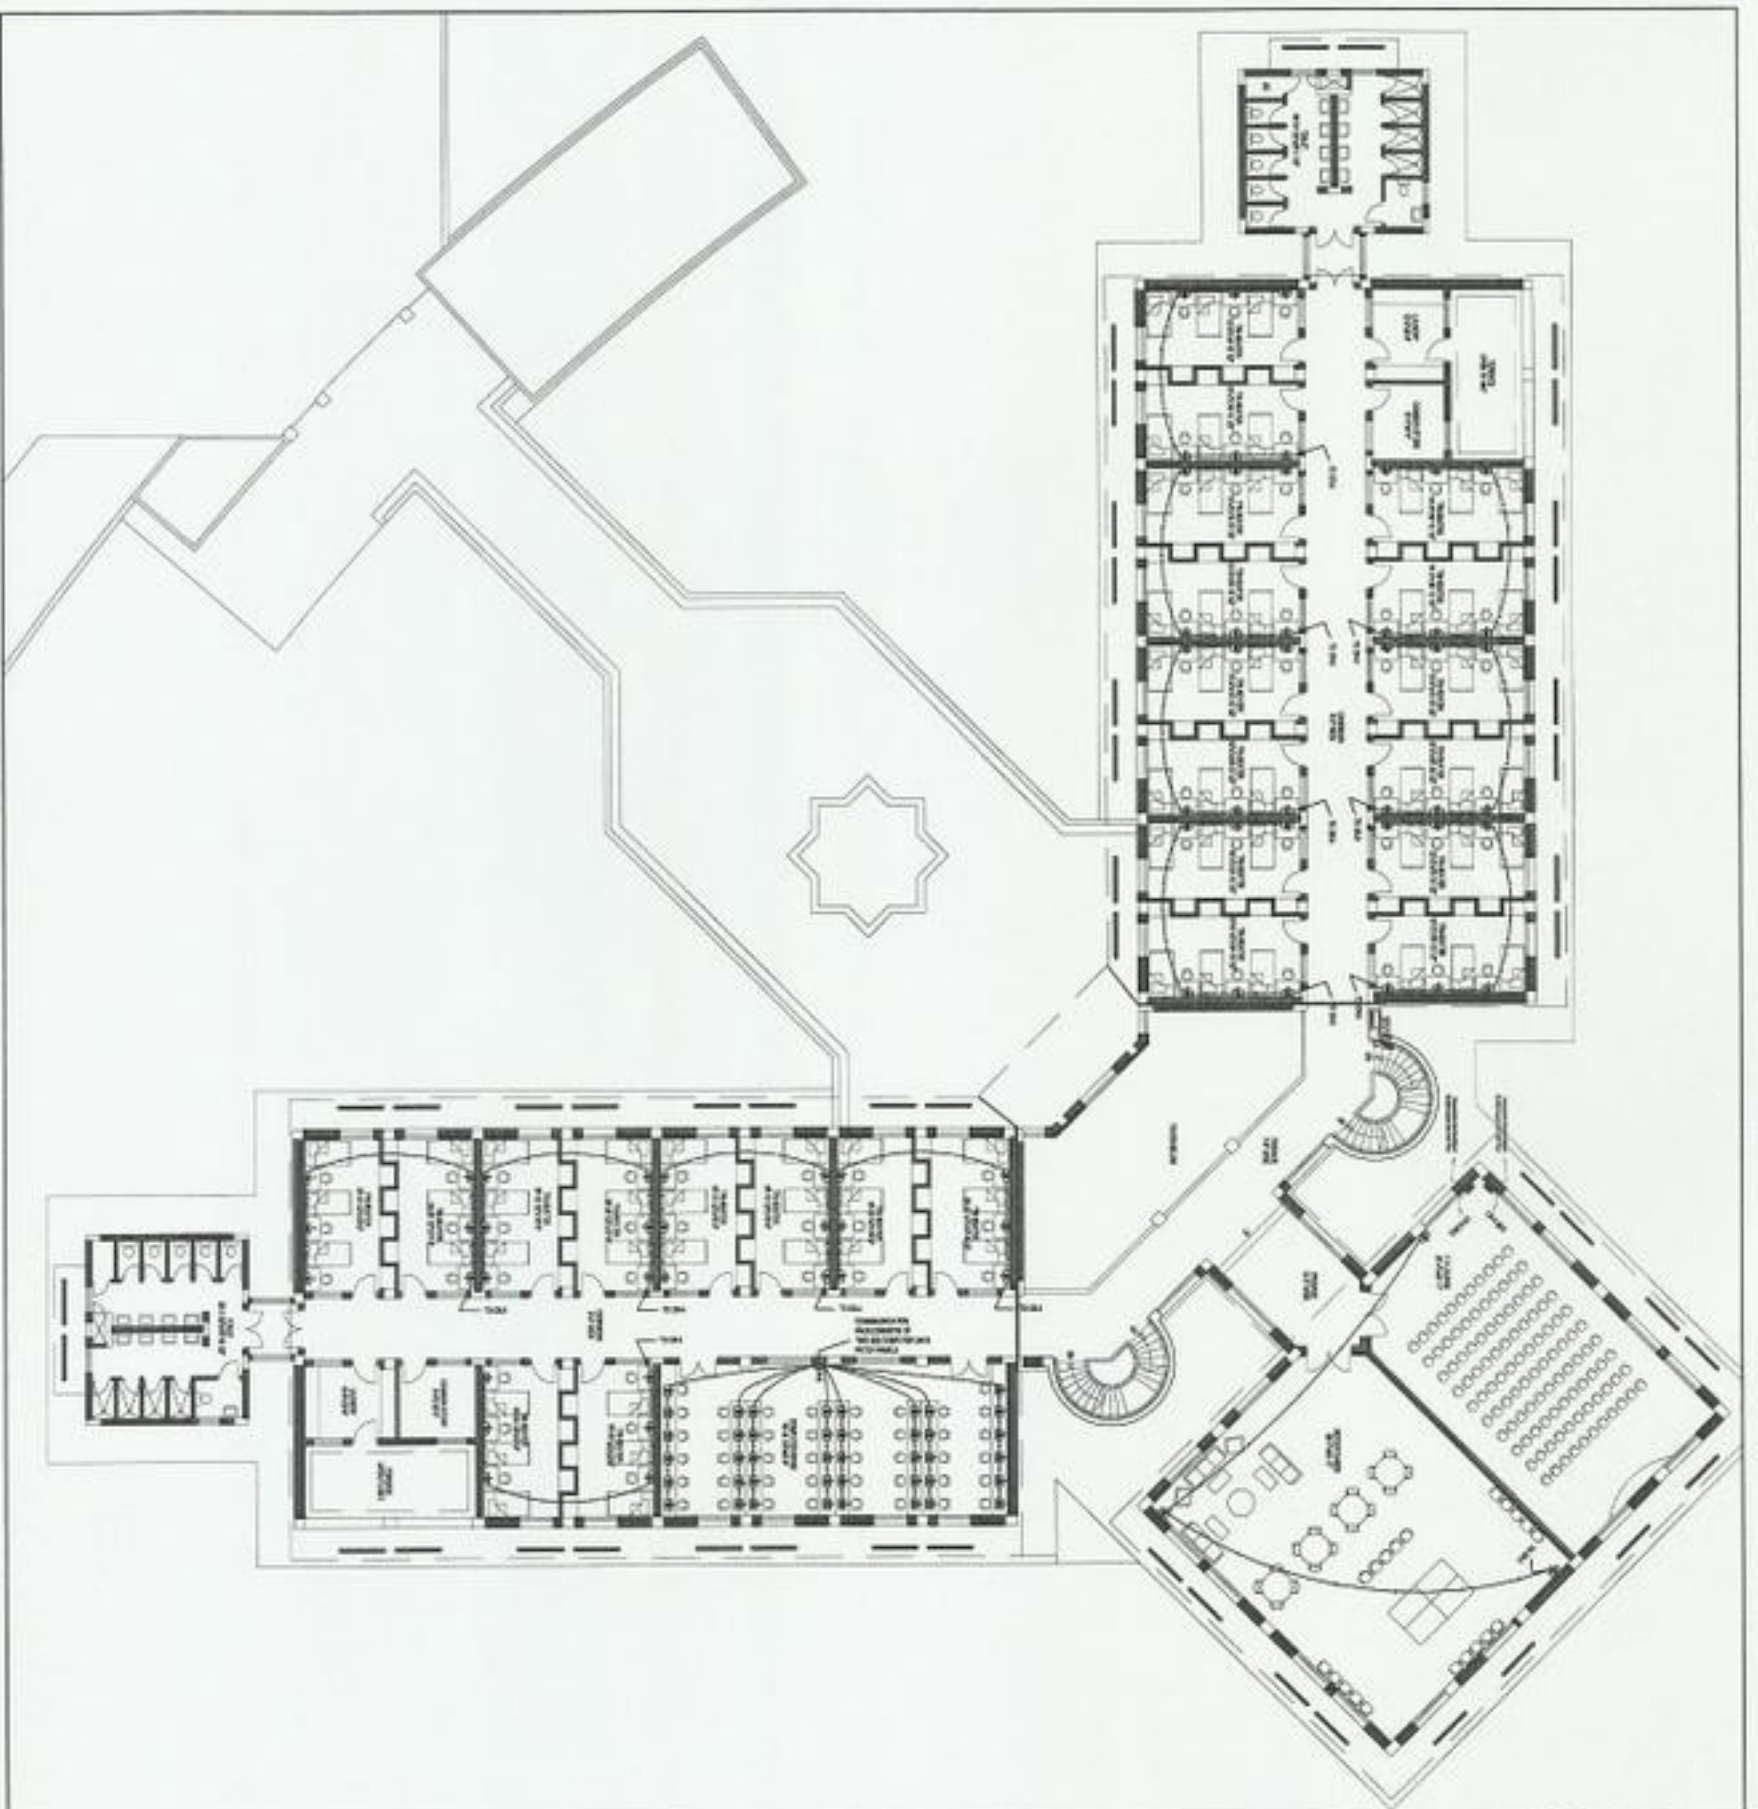

# LEGEND

SYMBOL	DESCRIPTION	REMARKS
1	RECEPTION	RECEPTION
2	OFFICE	OFFICE
3	COMPUTER LAB	COMPUTER LAB
4	SERVER ROOM	SERVER ROOM
5	STORAGE ROOM	STORAGE ROOM
6	RESTROOM	RESTROOM
7	CLOSET	CLOSET
8	STAIR	STAIR
9	ELEVATOR	ELEVATOR



## TITLE

COMPUTER DATA  
LAYOUT OF  
FIRST FLOOR

## PROJECT

GIRLS HOSTEL, NO.03  
MEHRAN UNIVERSITY  
OF ENGINEERING  
& TECHNOLOGY, JAMSHORO

## DESIGNED BY :

ENGR. ABDUL JABBAR ABRO

## COORDINATED BY :

OWAIS KHATRI

## SCALE

N.T.S

## DATE

08-04-2013

**K** KAD CONSULTANTS PVT. LTD.  
ARCHITECTS & ENGINEERS  
PLOT NO. 11, PHASE II, INDUSTRIAL AREA,  
JAMSHORO, GUJARAT, INDIA  
TEL: 079-25555555  
WWW.KADCONSULTANTS.COM



























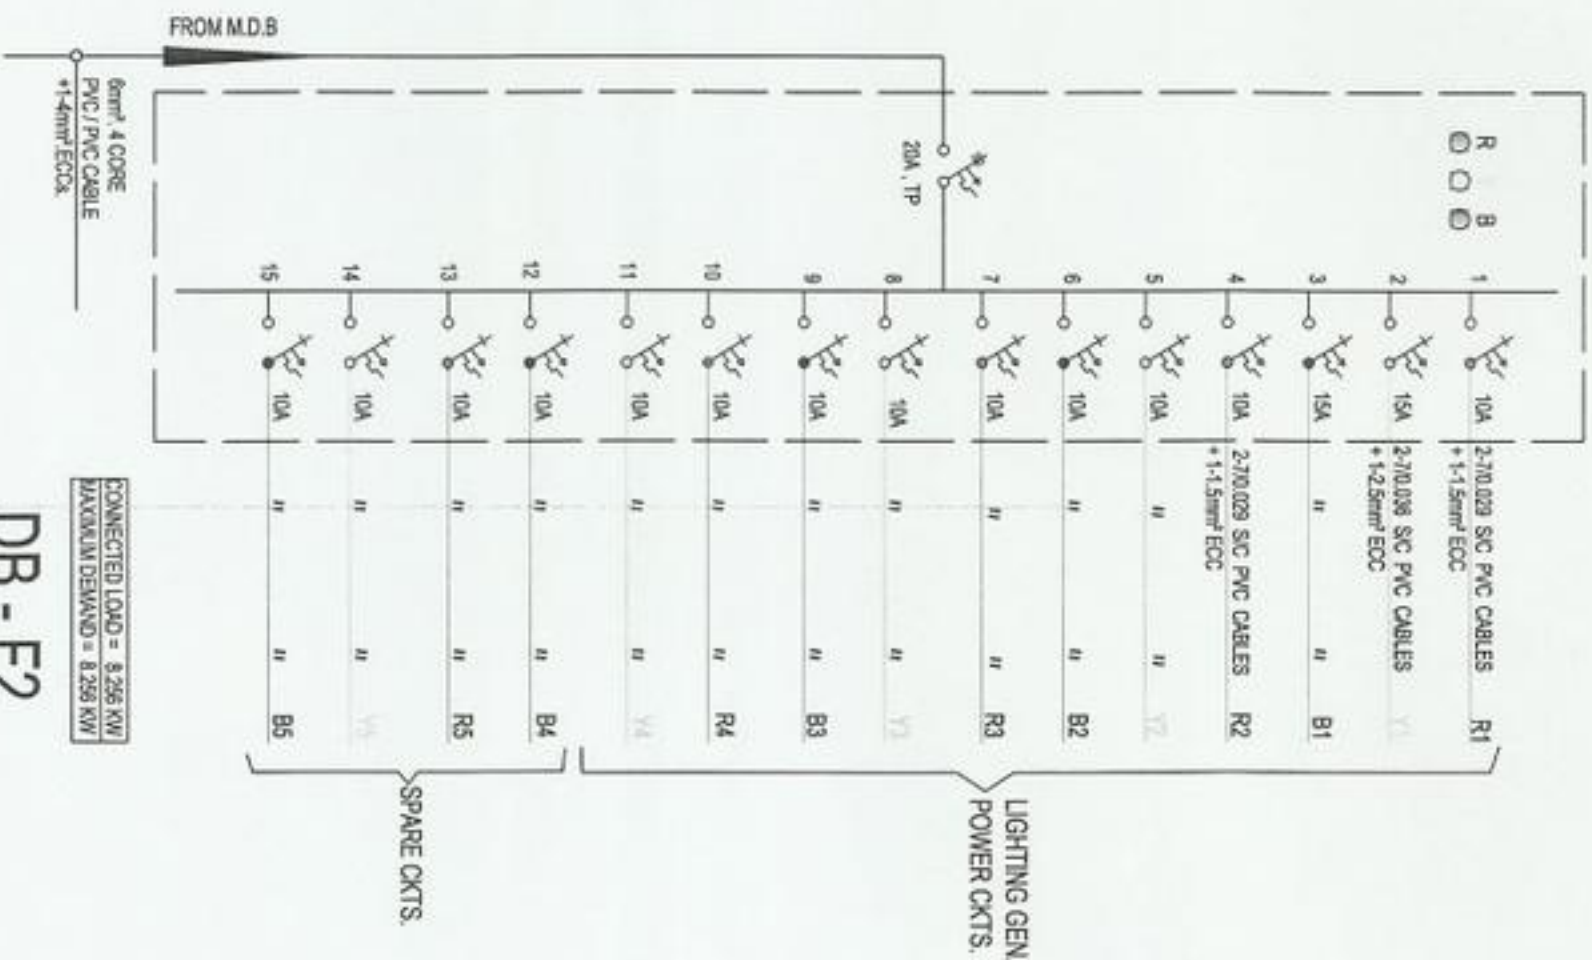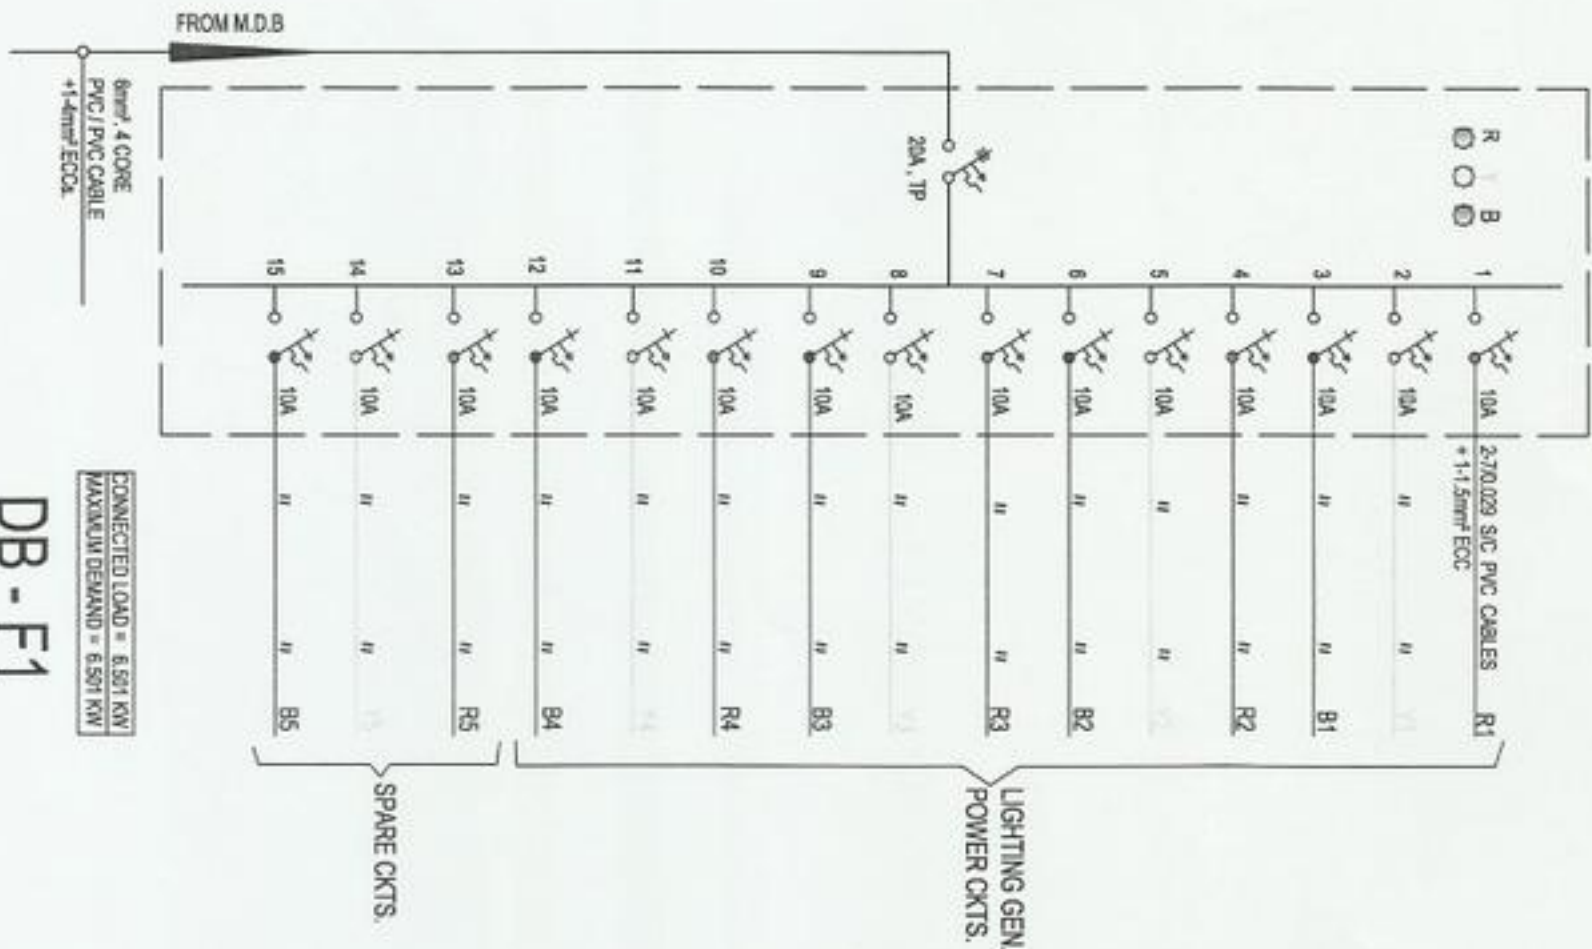

**TITLE**  
SCHEMATIC DIAGRAM  
OF LIGHTING  
DISTRIBUTION  
BOARDS

**PROJECT.**  
GIRLS HOSTEL, NO.03  
MEHRAN UNIVERSITY  
OF ENGINEERING  
& TECHNOLOGY, JAMSHORO

**DESIGNED BY :**  
ENGR. ABDUL JABBAR ABRO

**DRAWN BY :**  
Orwais Khatiri


**SCALE**  
N.T.S

**DATE:**  
15-04-2013


**CONTRACTOR**  
NAQVI AND SINDOQUI  
PVT. LIMITED  
SUITE # 202 FIRST FLOOR  
7th, SEVEN-SEVEN  
ISLAMABAD

**K**  
KAS CHINTAN ENGINEERING  
PVT. LIMITED  
SUITE # 202 FIRST FLOOR  
7th, SEVEN-SEVEN  
ISLAMABAD




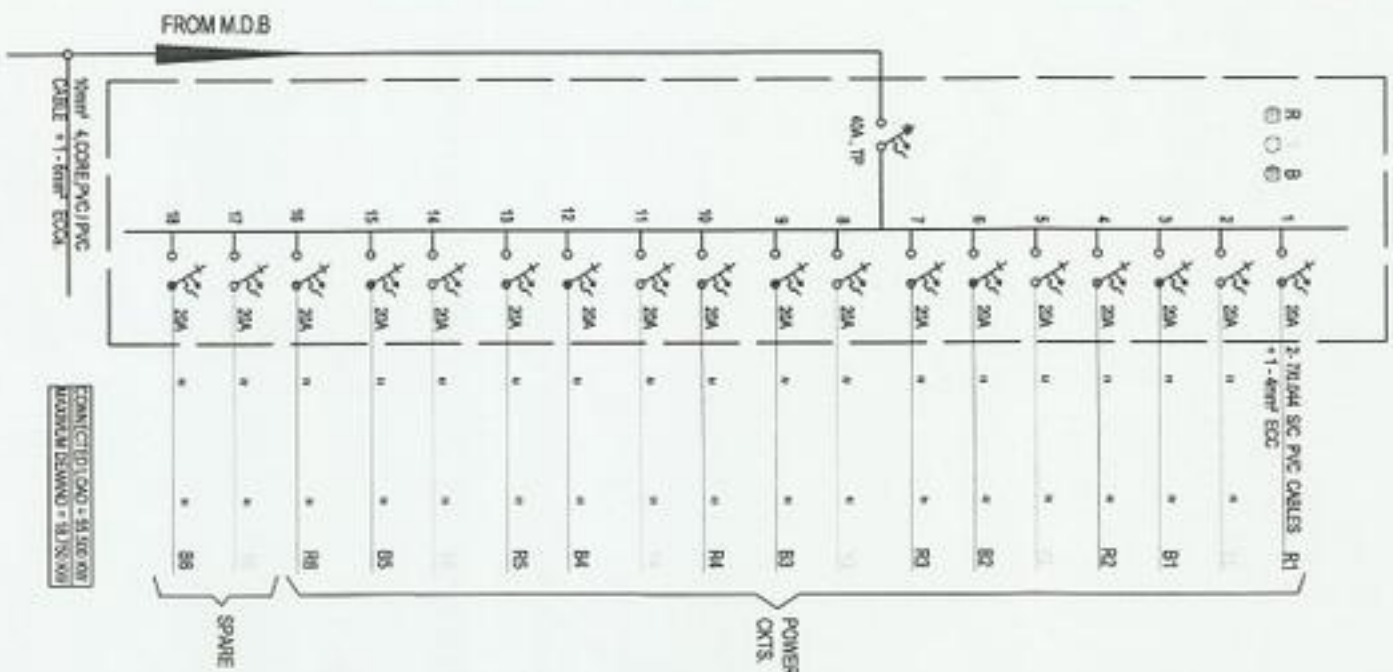

PDB-F1(FIRST FLOOR)

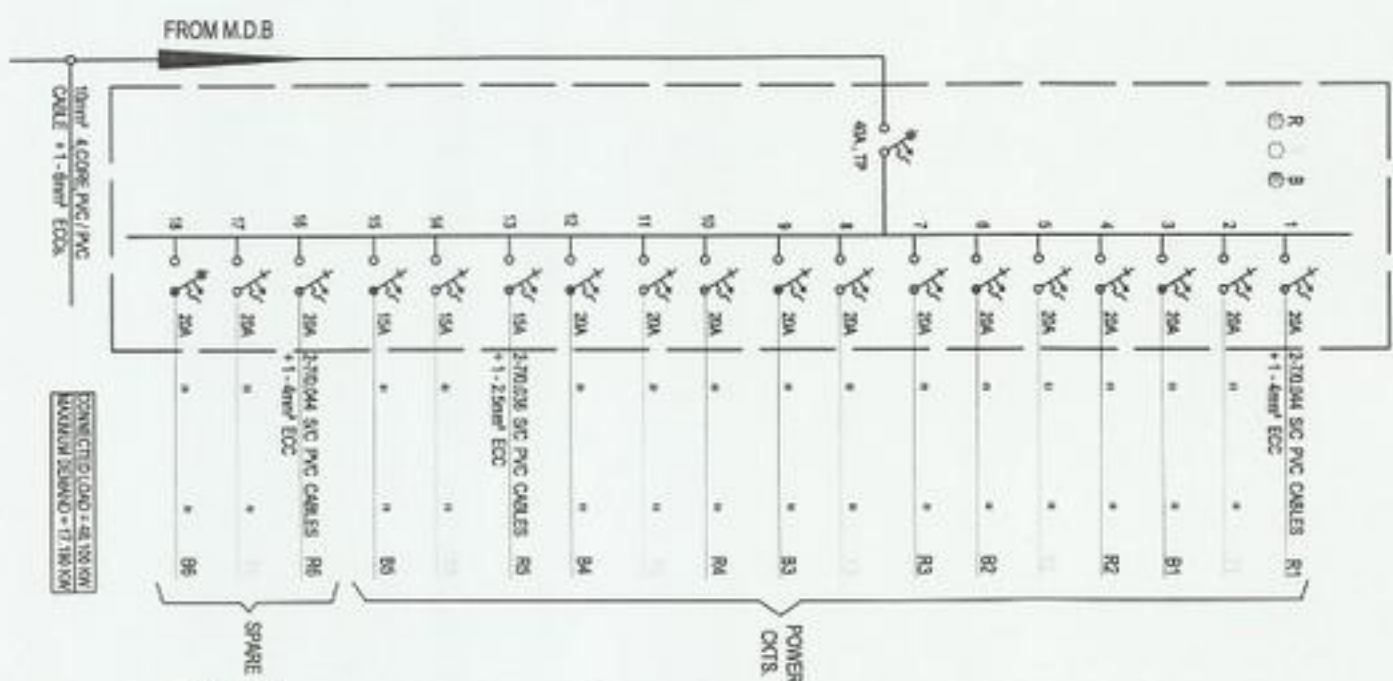


PDB-F2(FIRST FLOOR)

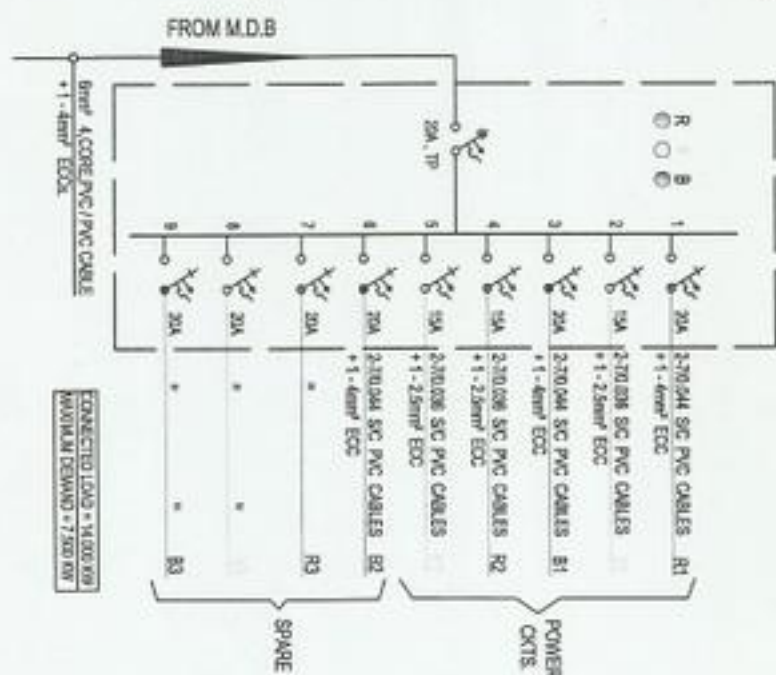


PDB-F3(FIRST FLOOR)


<b>TITLE</b> SCHEMATIC DIAGRAM OF POWER DISTRIBUTION BOARDS	
<b>PROJECT.</b> GIRLS HOSTEL NO.03 MEHRAN UNIVERSITY OF ENGINEERING & TECHNOLOGY, JAMSHORO	
<b>DESIGNED BY :</b> ENGR. ABDUL JABBAR ABERO	
<b>DESIGNED BY :</b> Owais Khattak	<b>PROJECT NO.:</b> 009/2013
<b>SCALE:</b> N.T.S	<b>ISSUING NO.:</b> SC-E-04
<b>DATE:</b> 18-04-2013	
 <b>K</b> ENGINEERING & TECHNOLOGY JAMSHORO	

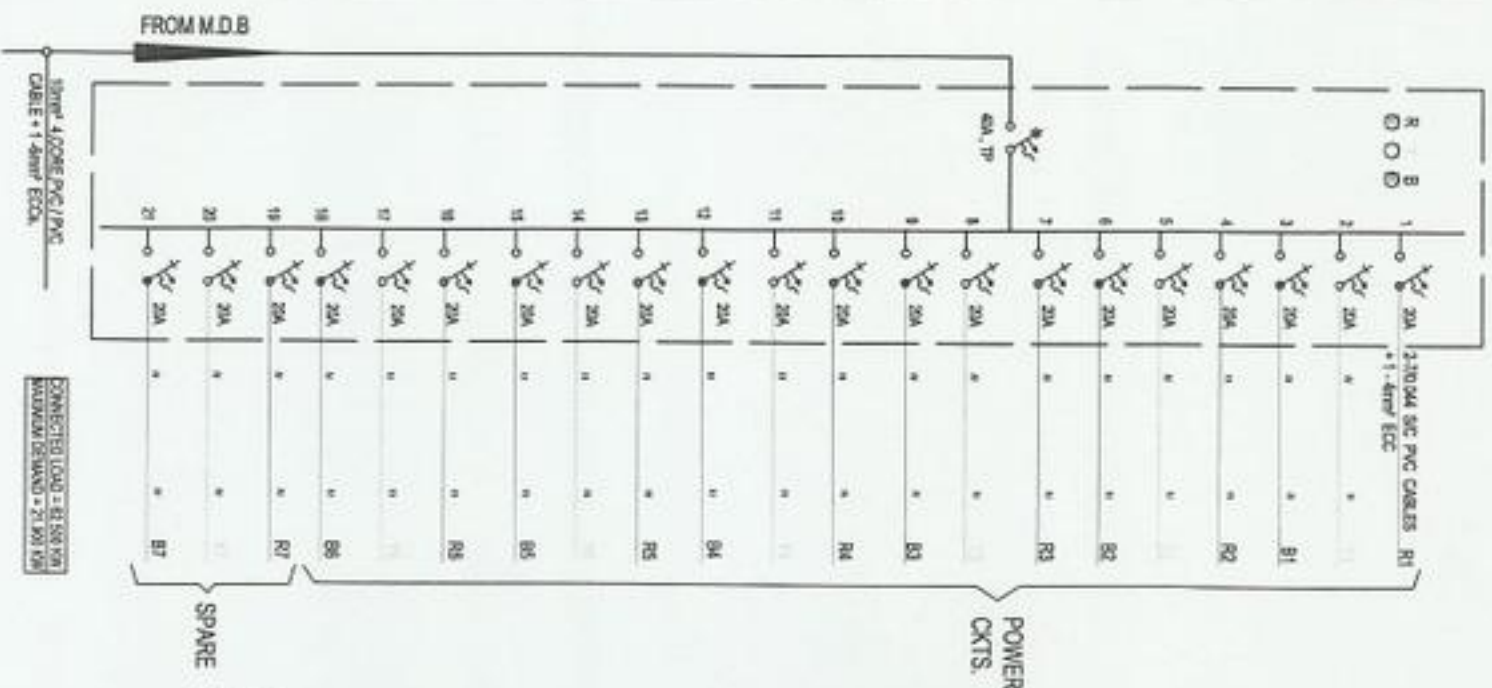

PDB-G1 (GROUND FLOOR)

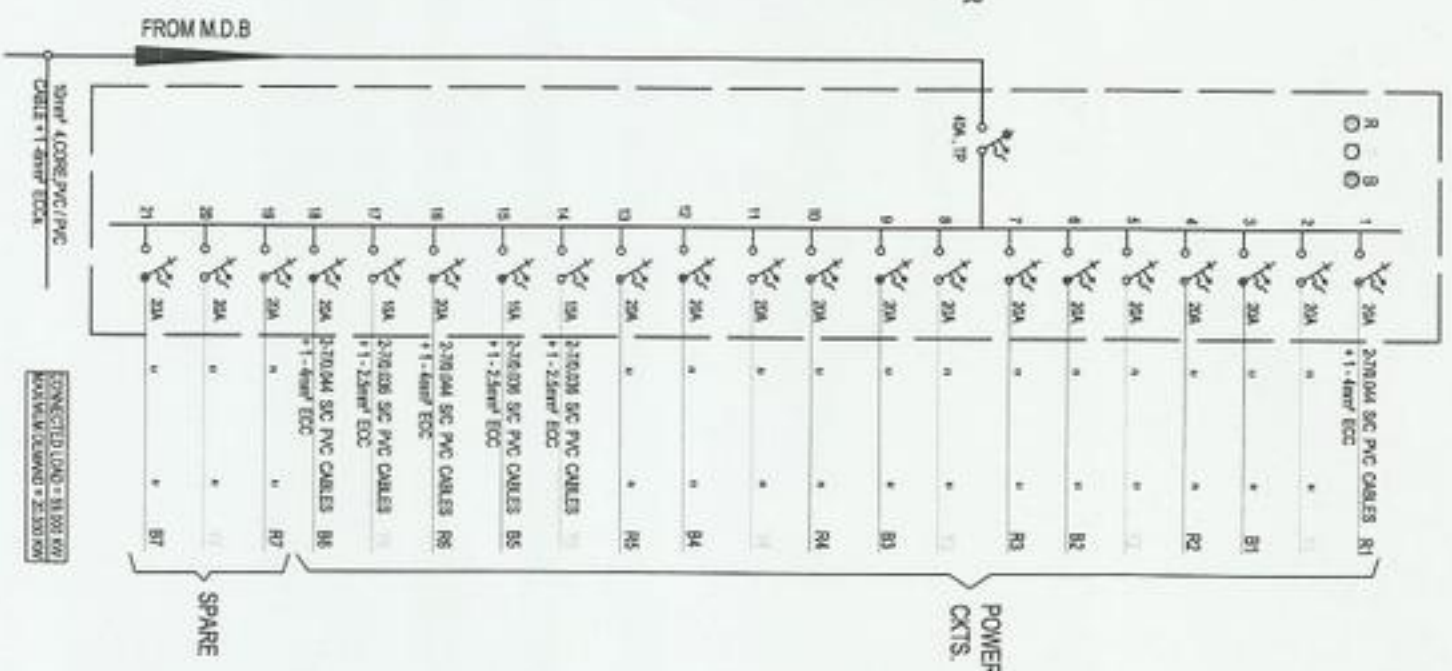

PDB-G2 (GROUND FLOOR)

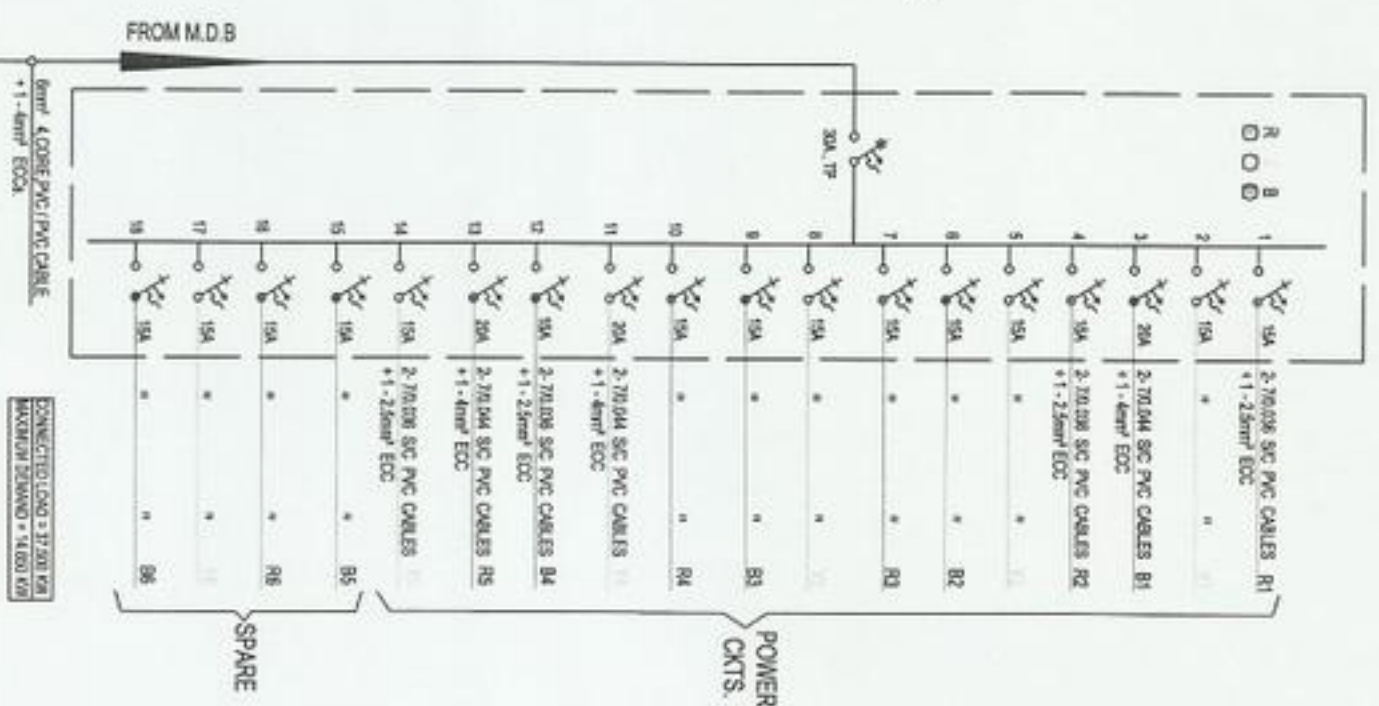

PDB-G3 (GROUND FLOOR)

TITLE  
SCHEMATIC DIAGRAM  
OF POWER  
DISTRIBUTION BOARDS

PROJECT  
GIRLS HOSTEL NO.03  
MEHRAN UNIVERSITY  
OF ENGINEERING  
& TECHNOLOGY, JAMSHORO

DESIGNED BY :  
ENR. ABUL JABBAR ABRO

DRAWN BY :  
PROJECT NO.  
009/2013


SCALE  
N.T.S  
DRAWING NO.  
SC-E-05

DATE  
17-04-2013








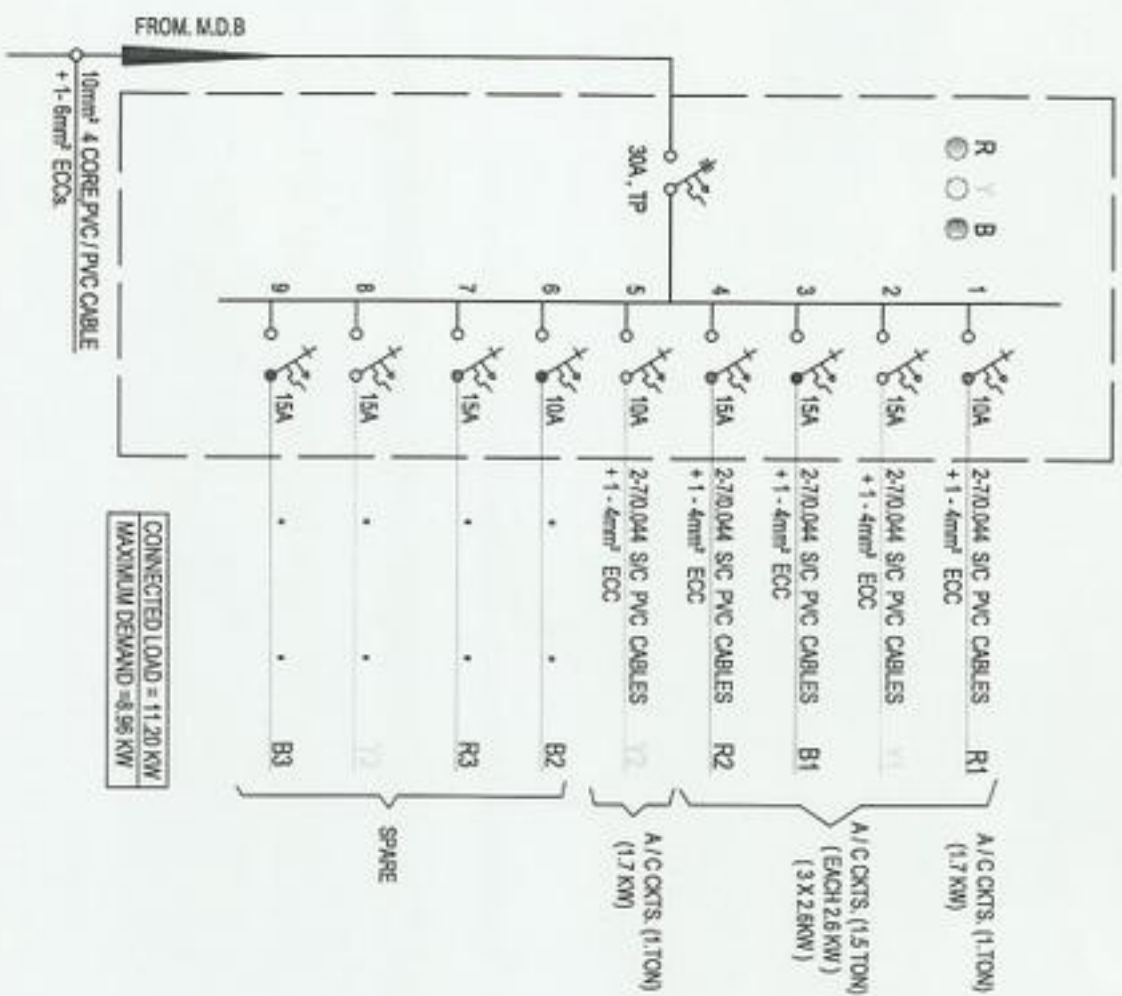

DB - A / C G1 (GROUND FLOOR)

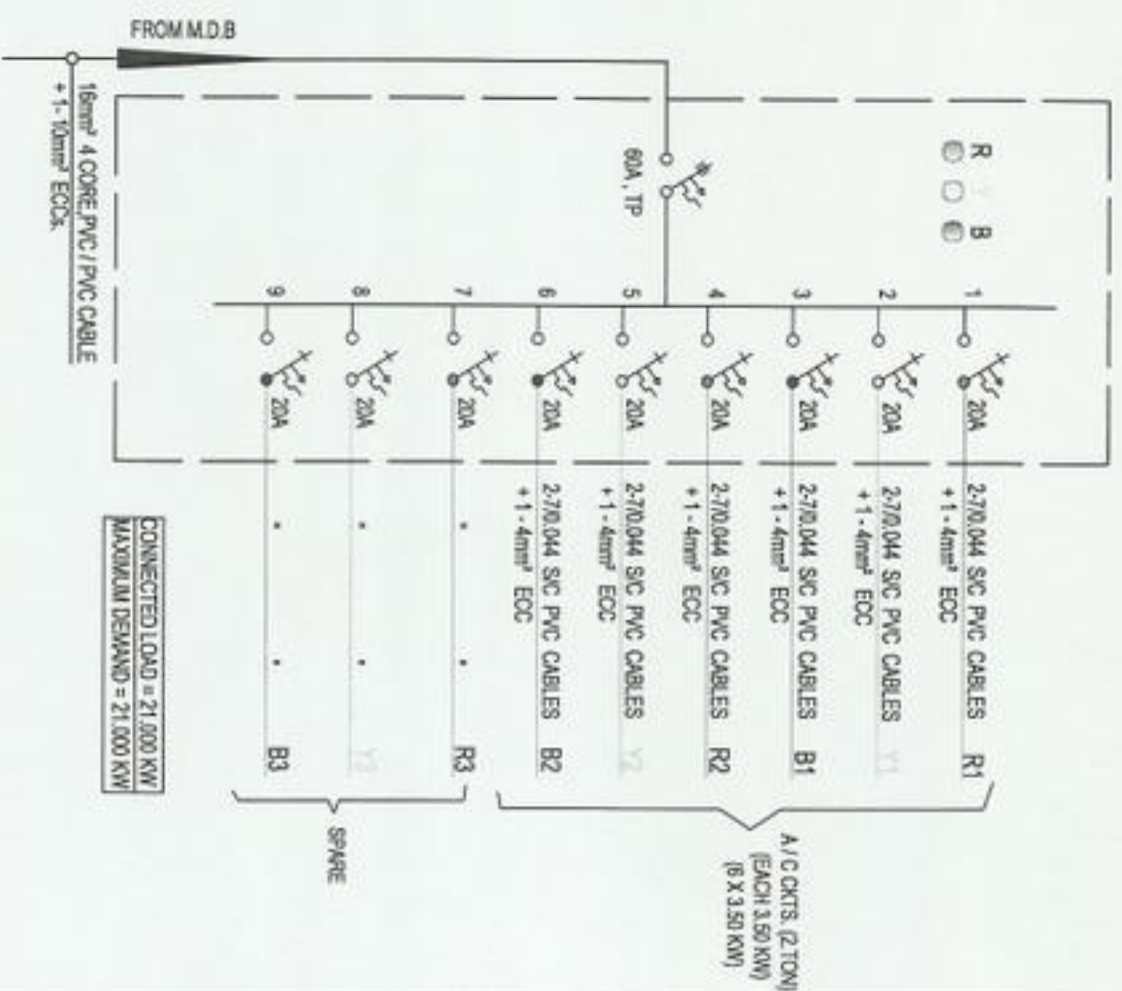

DB - A / C F1 (FIRST FLOOR)

**TITLE**  
SCHEMATIC DIAGRAM  
OF A/C DISTRIBUTION  
BOARDS

**PROJECT**  
GIRLS HOSTEL NO.03  
MEHRAN UNIVERSITY  
OF ENGINEERING  
& TECHNOLOGY, JAMSHORO

**DESIGNED BY :**  
ENGR. ABDUL JABBAR ABRIO

**CHECKED BY :** PROJECT NO.  
Owais Khaliq 009/2013

**SCALE** DRAWING NO.  
N.T.S SC-E-07

**DATE**  
19-04-2013

